

STRUCTURAL PEER REVIEW STATEMENT

This structural peer review and report, dated 22 September 2014, is complete for the superstructure and foundations.

Structural Peer Reviewer Name: William J. Faschan
Leslie E. Robertson Associates

Structural Peer Reviewer Address: 40 Wall Street, FL 23
New York, NY 10005

Project Address: 111 West 57th Street, Block #1010, Lot #25

Department Application Number for Structural Work: #121332968


Structural Peer Reviewer Statement:

I, William J. Faschan, am a qualified and independent NYS licensed and registered engineer in accordance with BC Section 1627.4, and I have reviewed the structural plans, specifications, and supplemental reports for 111 West 57th Street, Block #1010, Lot #25, Application #121332968 and found that the structural design shown on the plans and specifications generally conforms to the foundation and structural requirements of Title 28 of the Administrative Code and the 2008 NYC Construction Codes. The Structural Peer Review Report is attached.

New York State Registered Design Professional
(for Structural Peer Review only)

Name William J. Faschan

Signature [Signature] Date 12/18/14

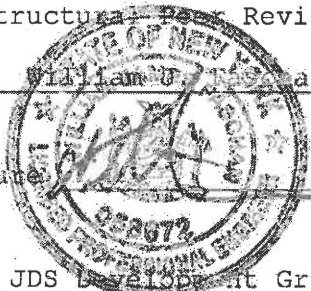

Cc: Project Owner: Simon Koster, JDS Development Group
Project Registered Design Professional: Silvian Marcus, WSP

LERA

Leslie E. Robertson Associates International,
Consulting Engineers, PLLC

40 Wall Street, 23rd Floor
New York, NY 10005-1339

Tel: (212) 750-9000
Fax: (212) 750-9002
<http://www.lera.com>

William J. Faschan
Partner
william.faschan@lera.com

28 August 2014
File: P890

Mr. Simon Koster

JDS Development Group
210 West 18th Street
New York, NY 10011

Via e-mail: skoster@jdsdevelopmentgroup.com

111 West 57th Street
Foundation Permit Application
Structural Peer Review

Dear Simon:

At the request of JDS Development Group, Leslie E. Robertson Associates, R.L.L.P. has conducted a Structural Peer Review of the foundation design of 111 West 57th Street as required by New York City Building Code Section 1627. This report summarizes the extent and findings of our review.

We have reviewed the plans listed in Appendix A, as well as the available wind tunnel and geotechnical reports, copies of which are attached to this report as Appendix B.

Through our review, we have confirmed the following aspects of the foundation design, as required by Section 1627.6.1:

- the design loads conform to the Building Code;
- the design criteria and design assumptions conform to the Building Code;
- the design properly incorporates the recommendations of the geotechnical engineer;
- the structure has a complete load path;
- based on our independent calculations of representative footings and foundation wall sections, we find that the design of the foundations have adequate strength;
- the structural plans are in general conformance with the architectural plans regarding loads and other conditions that affect the structural design; and
- the structural foundation plans are generally complete.

LERA

Mr. Simon Koster

28 August 2014

Page 2

Accordingly, we find the design of the foundations to be in general conformance with the structural and foundation design provisions of the Building Code.

The opinions expressed in this letter represent our professional view, based on the information made available to us. In developing these opinions, we have exercised a degree of care and skill commensurate with that exercised by professional engineers licensed in the State of New York for similar types of projects. No other warranty, expressed or implied, is made as to the professional advice included in this letter.

Regards,

LESLIE E. ROBERTSON ASSOCIATES INTERNATIONAL, P.L.L.C.



William J. Faschan

WJF/pi

cc: Mr. Silvian Marcus, WSPCS via e-mail: silvian.marcus@wspcs.com
Mr. Matthew Phillips, JDS Development via e-mail:
mphillips@jdsdevelopmentgroup.com

APPENDIX A

Reviewed Plans

111 WEST 57TH STREET

STRUCTURAL DRAWING LIST

DRAWING NUMBER	DRAWING TITLE	NO.	DATE	SUBMISSION
FO-001	GENERAL NOTES, LEGEND AND ABBREVIATIONS			100% CD FOUNDATION
			06-25-14	SET
FO-100	FOUNDATION PLAN			100% CD FOUNDATION
			06-25-14	SET
FO-200	FOUNDATION TYPICAL DETAILS 1			100% CD FOUNDATION
			06-25-14	SET
FO-201	FOUNDATION TYPICAL DETAILS 2			100% CD FOUNDATION
			06-25-14	SET
FO-202	FOUNDATION TYPICAL DETAILS 3			100% CD FOUNDATION
			06-25-14	SET
FO-203	FOUNDATION TYPICAL DETAILS 4			100% CD FOUNDATION
			06-25-14	SET
FO-300	FOUNDATION SECTION			100% CD FOUNDATION
			06-25-14	SET
FO-301	FOUNDATION SECTION			100% CD FOUNDATION
			06-25-14	SET
S-940	SHEAR WALL REINFORCEMENT PLAN			100% CD FOUNDATION
			06-25-14	SET
S-945	TYPICAL SHEARWALL DETAILS			100% CD FOUNDATION
			06-25-14	SET
S-955	CONCRETE COLUMN SCHEDULE			100% CD FOUNDATION
			06-25-14	SET
S-956	CONCRETE TYPICAL COLUMN DETAILS			100% CD FOUNDATION
			06-25-14	SET

APPENDIX B

Wind Tunnel and Geotechnical Reports

Preliminary Results - Wind-Induced Structural Responses
105-111 W57th Street - New York City, New York, RWDI Project #1400320
April 17, 2014

Table A: Predicted Peak Total Accelerations at Top Occupied Floors (Lvl 77, el. 1133.5' and Lvl 74, el. 1087')
 Configuration 3 with Upwind Buildings to West of Surroundings Model, April 14, 2014 Properties

Period Case Case 1 (T1 = 11.7 sec)	Return Period (years)	140403 Option 1 - 1421 ft Accelerations (milli-g)			140403 Option 2 - 1421 ft Accelerations (milli-g)		
		Level 77	Level 74	Level 74	Level 77	Level 74	Level 74
1.5% Damping	1 month	11.2	10.3	10.8	10.0	10.0	10.0
	1	18.1	16.7	17.0	15.7	15.7	15.7
6% Damping	10	24.6	22.7	23.3	21.5	21.5	21.5
	1 month	5.6	5.2	5.4	5.0	5.0	5.0
6% Damping	1	9.1	8.4	8.5	7.9	7.9	7.9
	10	12.3	11.4	11.7	10.8	10.8	10.8

Notes:

- (1) The various building Options test cases are defined below:
 140403_Option 1 - 1421 ft - with Glass 11.5% Opaque, Bronze 18% Opaque
 140403_Option 2 - 1421 ft - Structure + BMU
- (2) The test configurations are defined as follows:
Surroundings Configuration 3 - Including the proposed Extell Project 865 and proposed 220 Central Park and Tall Buildings Upwind of Surroundings Model
- (3) The above accelerations are based on the structural properties as provided on April 14, 2014. The natural building periods were as follows:

Case	T1 (sec)	T2 (sec)	T3 (sec)
1	11.7	10.1	3.5
2	12.3	10.6	3.7
3	12.9	11.1	3.9
4	11.1	9.6	3.3
5	10.5	9.1	3.2
6	9.9	8.6	3.0

- (4) The accelerations are provided for 1.5%, and 6% of critical damping.
- (5) With the inclusion of hurricanes, it is not appropriate to consider events beyond the 1-year return period when evaluating occupant comfort. Therefore the 10-year acceleration values do NOT include the influence of hurricanes in the wind climate.

Preliminary Results - Wind-Induced Structural Responses - April 14, 2014 Properties
105-111 W57th Street - New York City, New York, RWDI Project #1400320
April 17, 2014

The wind loads provided in this report include the effects of directionality in the local wind climate. These loads do not contain safety or load factors and are to be applied to the building's structural system in the same manner as would wind loads calculated by code analytical methods.

Table 2: Summary of Predicted Peak Overall Structural Wind Loads
140403_Option 1 - 1421 ft

Configuration 3, April 14, 2014 Properties						
Period Case	Damping	My (lb-ft)	Mx (lb-ft)	Mz (lb-ft)	Fx (lb)	Fy (lb)
Case1	2%	2.69E+09	2.95E+09	4.09E+07	3.04E+06	3.28E+06
Case1	3%	2.47E+09	2.71E+09	3.49E+07	2.82E+06	3.04E+06

Notes:

- (1) The various building Options test cases are defined below:
 140403_Option 1 - 1421 ft - with Glass 11.5% Opaque, Bronze 18% Opaque
 140403_Option 2 - 1421 ft - Structure + BMU
- (2) The test configurations are defined as follows:
Surroundings Configuration 3 - Including the proposed Extell Project 865 and proposed 220 Central Park and Tall Buildings Upwind of Surroundings Model
- (3) The above loads are the cumulative summation of the wind-induced loads at the structural level '1' (ie grade), exclusive of load combination factors. The loads are centered about a reference axis located at (26.0 ft, 9.0 ft) from the origin.
- (4) Total damping ratios of 2.0% and 3.0% of critical were used for structural load calculations, as indicated.
- (5) The above loads are based on the structural properties as provided on April 14, 2014. The natural building periods were as follows:

Case	T1 (sec)	T2 (sec)	T3 (sec)	
1	11.7	10.1	3.5	0.285714286
2	12.3	10.6	3.7	
3	12.9	11.1	3.9	
4	11.1	9.6	3.3	
5	10.5	9.1	3.2	
6	9.9	8.6	3.0	
- (6) The above loads correspond to a 50-year return period basic wind speed (3-second gust) of 98 mph.

Table 3: Effective Static Floor-by-Floor Wind Loads
140403_Revised Actual Top, 2% Damping
(Centered at (26.0 ft, 9.0 ft) from origin)

Floor	Height (ft)	Above Level 1	Fx (lb)	Fy (lb)	Mz (lb-ft)
1	0.0	200	3200	13000	
2	15.0	300	6000	15000	
3	28.5	800	6500	36000	
4	44.8	900	6400	34000	
5	56.4	900	5400	44000	
6	67.8	1300	5600	65000	
7	79.8	2900	6500	133000	
8	91.4	1800	5800	40000	
9	103.1	4600	6300	105000	
10	114.8	4600	6600	113000	
11	126.4	4600	6800	138000	
12	138.1	4600	7000	117000	
13	149.8	5700	7800	156000	
14	161.8	6400	8400	164000	
15	174.8	7700	9200	155000	
16	187.8	10000	11100	232000	
17	203.4	12300	13500	228000	
18	219.0	12300	13500	141000	
19	234.5	12200	12900	119000	
20	250.0	12200	12800	106000	
21	265.5	12200	13200	117000	
22	281.0	12200	13700	130000	
23	296.5	12200	14200	144000	
24	312.0	12700	14700	160000	
25	327.5	13600	15300	177000	
26	343.0	14500	15900	194000	
27	358.5	15500	16600	212000	
28	374.0	16500	17300	231000	
29	389.5	17500	18000	250000	
30	405.0	18600	18800	268000	
31	420.5	19600	19600	284000	
32	436.0	20700	20400	304000	
33	451.5	21800	21300	324000	
34	467.0	27900	26500	453000	
35	482.5	30800	29000	513000	
36	498.0	26000	24700	406000	
37	513.5	25500	24300	378000	
38	529.0	26700	25200	398000	
39	544.5	27900	26300	416000	
40	560.0	29200	27400	439000	
41	575.5	30500	28500	461000	
42	591.0	31800	29600	479000	
43	606.5	33000	30700	497000	
44	622.0	34300	31800	512000	

Table 4: Recommended Wind Load Combination Factors


Load Case	Factor for Simultaneous Application of Loads in Table 3		
	X Forces (Fx)	Y Forces (Fy)	Torsion (Mz)
1	+100%	+30%	+30%
2	+100%	+30%	-40%
3	+100%	-45%	+30%
4	+100%	-45%	-40%
5	-95%	+30%	+30%
6	-95%	+30%	-30%
7	-95%	-55%	+30%
8	-95%	-55%	-30%
9	+30%	+100%	+40%
10	+30%	+100%	-30%
11	+30%	-100%	+30%
12	+30%	-100%	-45%
13	-30%	+100%	+40%
14	-30%	+100%	-30%
15	-30%	-100%	+30%
16	-30%	-100%	-45%
17	+30%	+40%	+95%
18	+30%	+30%	-100%
19	+30%	-60%	+95%
20	+30%	-65%	-100%
21	-30%	+40%	+95%
22	-30%	+30%	-100%
23	-30%	-60%	+95%
24	-30%	-65%	-100%

Note:
 (1) Load combination factors have been produced through consideration of the structure's response to various wind directions, modal coupling, correlation of wind gusts and the directionality of strong winds in the local wind climate.


45	637.5	31600	28500	460000
46	653.0	33000	30800	451000
47	668.5	35800	34300	497000
48	684.0	37100	35400	513000
49	699.5	38500	36700	530000
50	715.0	39800	38000	549000
51	730.5	41200	39400	567000
52	746.0	42500	40600	581000
53	761.5	43900	42000	599000
54	777.0	45200	43300	618000
55	792.5	46500	44600	636000
56	808.0	47800	46000	654000
57	823.5	49100	47400	672000
58	839.0	50400	48800	690000
59	854.5	51700	50200	708000
60	870.0	53000	51600	726000
61	885.5	54300	53000	744000
62	901.0	55600	54400	762000
63	916.5	56900	55800	780000
64	932.0	58200	57200	798000
65	947.5	59500	58600	816000
66	963.0	60800	60000	834000
67	978.5	62100	61400	852000
68	994.0	63400	62800	870000
69	1009.5	64700	64200	888000
70	1025.0	66000	65600	906000
71	1040.5	67300	67000	924000
72	1056.0	68600	68400	942000
73	1071.5	69900	69800	960000
74	1087.0	71200	71200	978000
75	1102.5	72500	72600	996000
76	1118.0	73800	74000	1014000
77	1133.5	75100	75400	1032000
78	1149.0	76400	76800	1050000
79	1164.5	77700	78200	1068000
80	1180.0	79000	79600	1086000
81	1195.5	80300	81000	1104000
82	1211.0	81600	82400	1122000
83	1226.5	82900	83800	1140000
84	1242.0	84200	85200	1158000
85	1257.5	85500	86600	1176000
86	1273.0	86800	88000	1194000
87	1288.5	88100	89400	1212000
88	1304.0	89400	90800	1230000
89	1319.5	90700	92200	1248000
90	1335.0	92000	93600	1266000
91	1350.5	93300	95000	1284000
92	1366.0	94600	96400	1302000
93	1381.5	95900	97800	1320000
94	1397.0	97200	99200	1338000
95	1412.5	98500	100600	1356000
96	1421.0	99000	101000	1360000
SUMS	-	3.04E+06	3.28E+06	4.09E+07

Notes:

- (1) The loads given in this table should be used with the load combination factors given in Table 4.
- (2) The loads given in this table are centered about the reference axis centered at (26.0 ft, 9.0 ft) from origin.
- (3) The above loads correspond to a 50-year return period basic wind speed (3-second gust) of 98 mph.

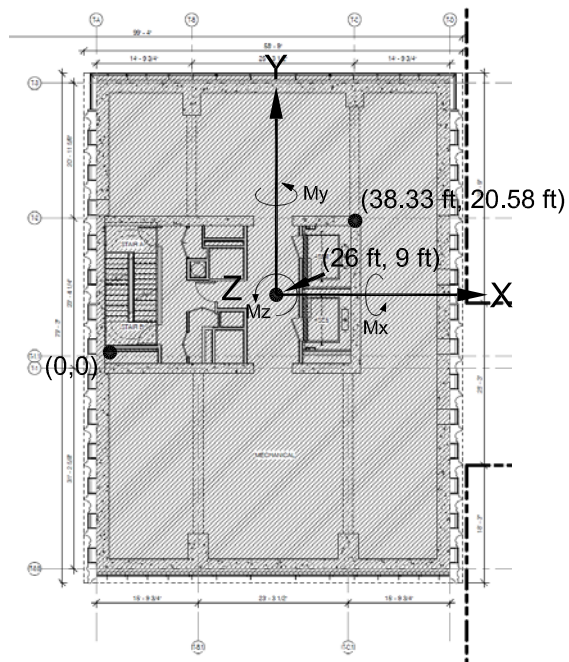


34TH FLOOR

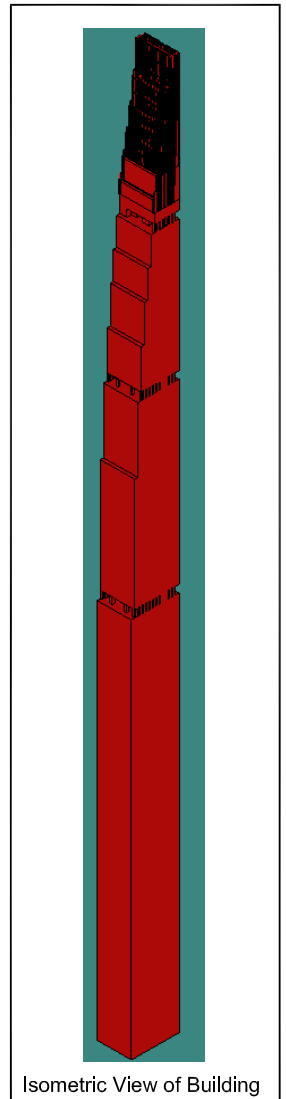

Isometric View of Building

Note:
Point (38.33 ft, 20.58 ft) provided by the structural engineer.



Co-ordinate System for Structural Loading

105 – 111 West 57th Street - New York City, NY



Project #1400320

Drawn by: CBD	Figure: 4
Approx. Scale: 1"=30'	
Date Revised: April 17, 2014	




OPT 2:
GLASS 11.5% OPAQUE,
BRONZE 18% OPAQUE

OPT 1:
GLASS 11.5% OPAQUE,
BRONZE 18% OPAQUE

OPT 2:
GLASS 11.5% OPAQUE,
BRONZE 18% OPAQUE

OPT 1:
GLASS 11.5% OPAQUE,
BRONZE 18% OPAQUE

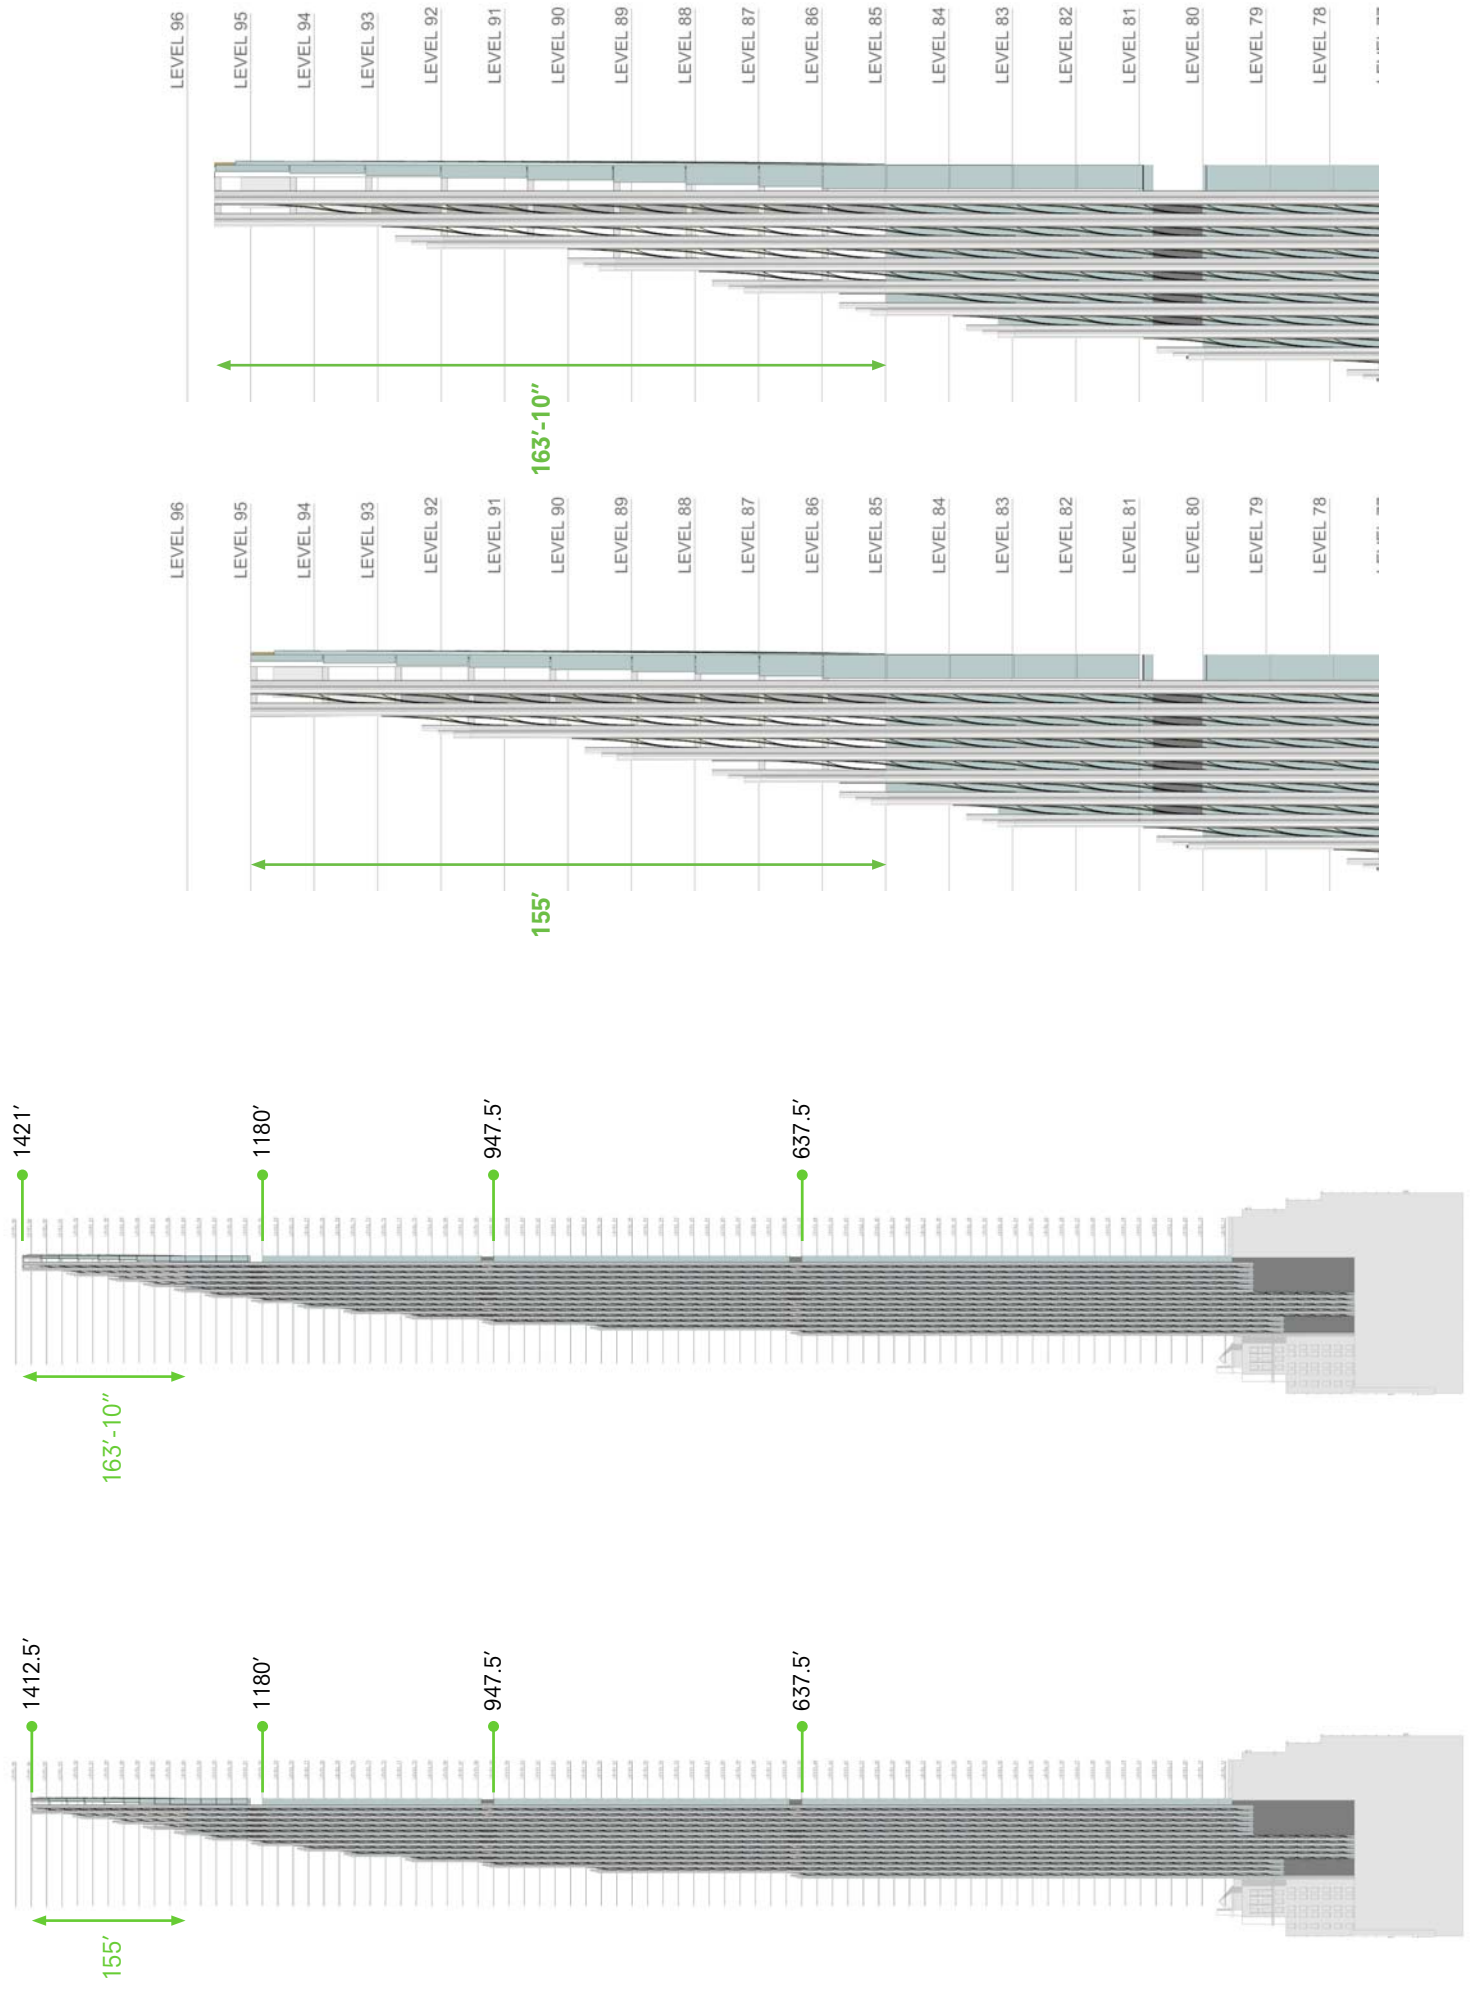


TOWER TOP

EAST ELEVATION

OPT 2: GLASS 11.5% OPAQUE,
BRONZE 18% OPAQUE




OPT 1: GLASS 11.5% OPAQUE,
BRONZE 18% OPAQUE

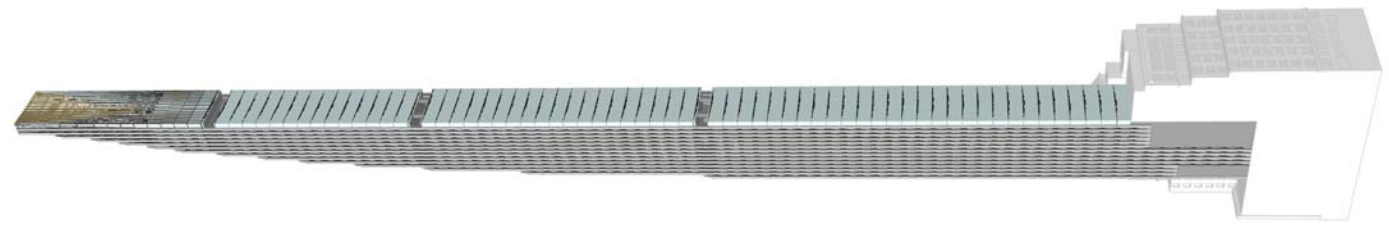


NORTHEAST

OPT 2: GLASS 11.5% OPAQUE,
BRONZE 18% OPAQUE

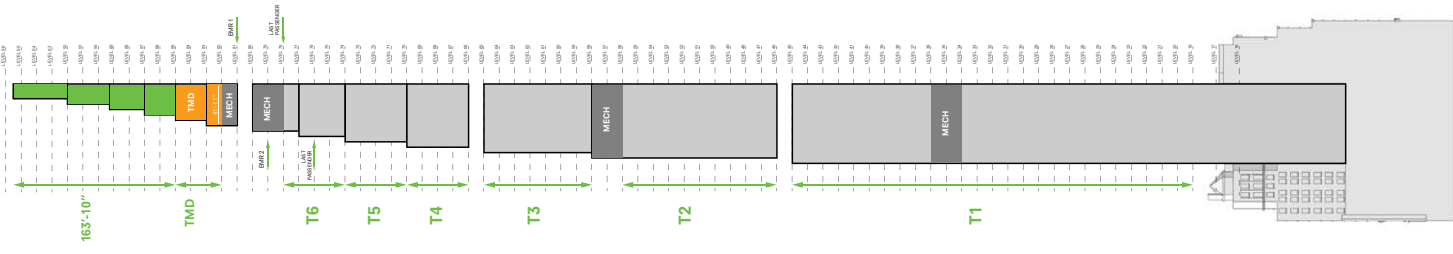

OPT 1: GLASS 11.5% OPAQUE,
BRONZE 18% OPAQUE

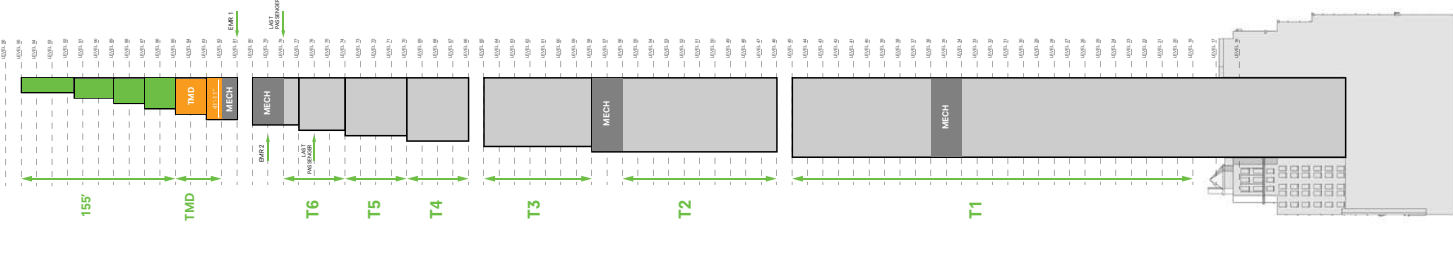

EAST ELEVATION

OPT 1: GLASS 11.5% OPAQUE,
BRONZE 18% OPAQUE



OPT 2 GLASS 11.5% OPAQUE,
BRONZE 18% OPAQUE




SOUTHEAST

OPT 1: GLASS 11.5% OPAQUE,
BRONZE 18% OPAQUE



NORTH ELEVATION

OPT 2: STRUCTURE + BMU

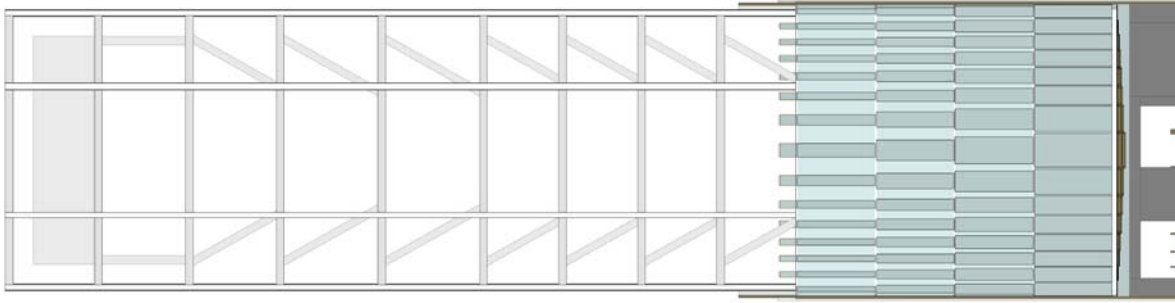

NORTH ELEVATION

OPT 1: GLASS 11.5% OPAQUE,
BRONZE 18% OPAQUE



NORTHEAST

OPT 2: GLASS 11.5% OPAQUE,
BRONZE 18% OPAQUE




SOUTHEAST

OPT 1: GLASS 11.5% OPAQUE,
BRONZE 18% OPAQUE



NORTH ELEVATION

OPT 2: STRUCTURE + BMU

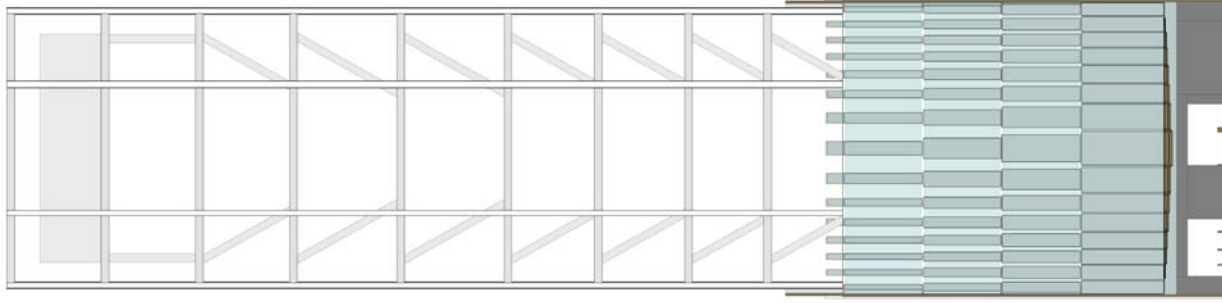


NORTH ELEVATION

OPT 1: GLASS 11.5% OPAQUE,
BRONZE 18% OPAQUE



NORTHEAST

OPT 2: GLASS 11.5% OPAQUE,
BRONZE 18% OPAQUE

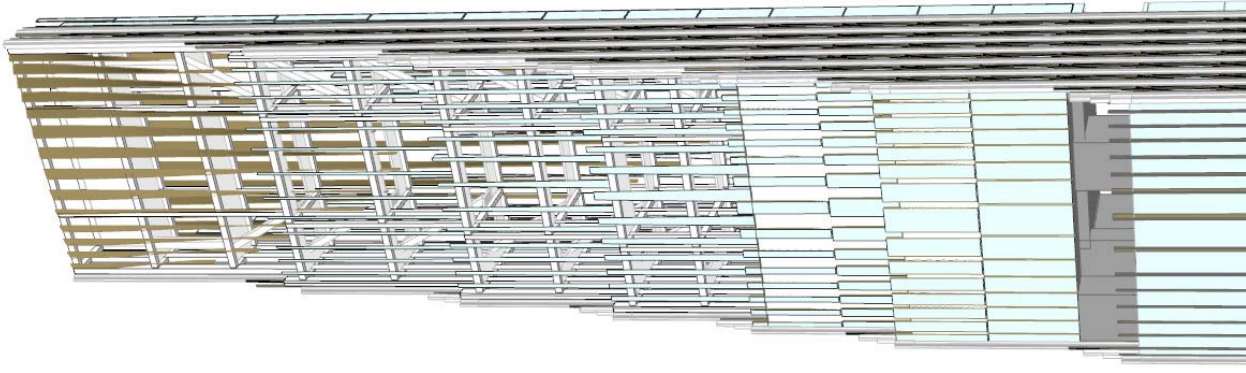


SOUTHEAST

**Geotechnical Report
111 W57 Street Project
New York, New York**

**JDS Development Group
104 Fifth Avenue
New York, NY 10011**

**Mueser Rutledge Consulting Engineers
14 Penn Plaza - 225 West 34th Street
New York, NY 10122**

January 26, 2014



Mueser Rutledge Consulting Engineers

14 Penn Plaza · 225 West 34th Street · New York, NY 10122

Tel: (917) 339-9300 · Fax: (917) 339-9400

www.mrce.com

Alfred H. Brand
David M. Cacoilo
Peter W. Deming
Roderic A. Ellman, Jr.
Francis J. Arland
Partners

David R. Good
Walter E. Kaeck
Associate Partners

James L. Kaufman
Hugh S. Lacy
Joel Moskowitz
George J. Tamaro
Peter H. Edinger
Elmer A. Richards
Edmund M. Burke
John W. Fowler
Consultants

Thomas R. Wendel
Domenic D'Argenzio
Robert K. Radske
Ketan H. Trivedi
Hiren J. Shah
Alice Arana
Joel L. Volterra
Tony D. Canale
Jan Cermak
Sissy Nikolaou
Anthony DeVito
Frederick C. Rhyner
Sitotaw Y. Fantaye
Senior Associates

Michael J. Chow
Douglas W. Christie
Gregg V. Piazza
Pablo V. Lopez
Steven R. Lowe
Andrew R. Tognon
James M. Tantalla
T.C. Michael Law
Andrew Pontecorvo
Associates

Joseph N. Courtade
**Director of Finance
and Administration**

February 26, 2014

JDS Development Group
104 Fifth Avenue, 9th Floor
New York, NY 10011

Attn: Mr. Simon Koster

Re: Geotechnical Report
111 W57 Street Project
New York, New York
MRCE File P13-401

Dear Simon:

As per your request, Mueser Rutledge Consulting Engineers (MRCE) has completed a supplemental subsurface investigation for the referenced project. This report presents a summary of all subsurface investigations performed at the site, our interpretation of subsurface conditions encountered in borings, and foundation recommendations for the proposed construction.

SITE AND PROJECT DESCRIPTION

A new high-rise tower is planned to be constructed on an open empty lot at 111 West 57th Street, New York City. The new structure will incorporate the existing Steinway Building (see Figure 1). The lot is relatively flat with elevations ranging from Elev. +60 to Elev. +62 with about an eight foot depression in the northeast corner. Adjacent sidewalk elevations on W57th Street range between Elev. +62 and Elev. +64. Sidewalk elevations on W58th Street range between Elev. +58 and Elev. +62. Elevations in this report are in feet and refer to the Borough President of Manhattan Datum, in which Elev. 0.0 is equal to 2.75 feet above Mean Sea Level at Sandy Hook, New Jersey, 1929.

The empty lot was previously occupied by a four-story Ritz Furs building with two cellars. That building was demolished in 2006 and its cellars were filled with fill and demolition debris. The foundation walls were left in place. Borings drilled at the site encountered concrete slabs at a depth of about 20 feet, just above the rock surface.

The Ritz Furs building had a two-level vault extending south under W57th Street. This vault was not demolished or filled in (see Figure 2). The bottom slab of its lower level is at a depth similar to the assumed lowest cellar slab of the demolished Ritz Furs building, with the top of slab (TOS) at approximately Elev. +40.5.

The new high-rise tower will interconnect with the Steinway Building structure which is up to 16 stories high. The southern portion of the Steinway Building facing West 57th Street has one cellar level at Elev. +47.5 and the northern portion facing West 58th Street has two cellar levels with TOS at Elev. +47.5 and +29, respectively. One cellar level will be constructed underneath the new tower. The proposed cellar will be constructed to the same elevation as the single cellar within the southern portion of the Steinway Building, with TOS at Elev. +47.5 as shown on Figure 2.

The TOS elevations of the lowest cellar slab at existing adjacent buildings to the east, 100 West 58th Street, 1409 6th Avenue, and 1401 6th Avenue, are Elev. +28.9, Elev. +45.1, and Elev. +25.3, respectively (see Figure 2).

EXHIBITS

The following exhibits are attached:

<u>Exhibit</u>	<u>Description</u>
Figure 1	Site Location Plan
Figure 2	Cellar Elevations
Drawing No. B-1	Boring Location Plan
Drawing No. GS-R	Geotechnical Reference Standards
Drawing No. RC-1	Rock Classification Criteria
Appendix A	MRCE Boring Logs – 2013 Investigation
Appendix B	2013 MRCE Laboratory Testing Results
Appendix C	April 2012 Geotechnical Study
Appendix D	Boring Logs – 2013 Phase II ESA

SUBSURFACE INVESTIGATIONS

Previous Investigations In August 2006, an initial geotechnical investigation was performed by Langan to define the subsurface conditions at the site and comprised three test borings. The borings penetrated to depths ranging from 33 to 36 ft and cored 10 to 15 feet of bedrock. In March 2012, another geotechnical study that included three borings was performed. We understand that the purpose of these additional borings was to confirm top of rock depths. Groundwater observation wells were not installed in either investigation. The geotechnical report summarizing both investigations is attached as Appendix C.

In addition to the above geotechnical studies, Environmental Site Assessments (ESAs) were performed in 2013. The Phase II ESA included a geophysical survey, completion of three environmental borings, and installation of one groundwater monitoring well. The three borings

drilled included one boring for soil sample collection. Logs for the environmental borings and monitoring well are attached in Appendix D.

Supplemental Investigation Foundation elements for the proposed tower will extend deep into rock, well below the depth of Langan borings discussed above. Therefore, MRCE performed two supplemental borings extending about 50 feet into bedrock in order to define the bedrock at greater depth as needed for design. Boring M-1P and M-2 were drilled by Jersey Boring and Drilling of Newark, New Jersey (JBD) between December 23, 2013 and January 6, 2014 under continuous inspection by our resident engineers, Ms. Alexandra Patrone and Mr. Edward Phelps, who prepared field logs for each boring. Upon completion of the drilling, as-drilled boring locations were tape measured from existing site features by our engineers, and the as-drilled boring locations are shown on Drawing No. B-1.

The supplemental borings were made with a truck mounted drill rig using wash-rotary methods with casing and drilling mud to stabilize the borehole. Soil samples were obtained at intervals not exceeding five feet throughout the borehole. Samples were obtained using a 2-inch O.D. split-spoon sampler driven with an automatic 140-pound hammer falling 30 inches. The number of hammer blows required to advance the split-spoon sampler through each of four six-inch drive intervals was recorded. The Standard Penetration Test (SPT) resistance or N-value, expressed in blows per foot, is an indication of the relative density of the material sampled and is calculated by summing the blows from the second and third six-inch intervals. In some instances where the sampler was unable to penetrate the full 24 inches due to the presence of dense soils, large gravel, cobbles, boulders, or other obstructions, the sampler was driven until 50 to 100 blows were administered and the actual penetration of the sampler was measured and recorded. Recovered soil samples were classified in the field and placed in jars for preservation and transport to our in-house laboratory.

The supplemental borings cored 50 to 52 feet of bedrock. Bedrock was sampled using an NX-size, double-tube core barrel equipped with a diamond bit, recovering a nominal 2-inch diameter core. Percent recovery and Rock Quality Designation (RQD) were determined for each core run. RQD is defined as the sum of the lengths of recovered core pieces greater than four inches in length between natural breaks expressed as a percentage of the total core run. RQD is an indication of the relative frequency of jointing or natural fracturing of the bedrock. Sketches of recovered cores prepared in the field are attached to the boring logs. Rock cores were stored in wooden boxes for shipment to our laboratory.

After completion of the boring program, all soil samples and rock cores were delivered to our soils laboratory for verification of field classification. Individual soil sample and rock core descriptions, and rock core sketches are provided on the typed logs in Appendix A. The terminology used in MRCE soil descriptions is shown on Drawing No. GS-R. Rock core classification terminology and criteria used on the boring logs are shown on Drawing No. RC-1.

A piezometer was installed in the completed borehole of Boring M-1P to monitor groundwater levels. The piezometer consists of a two-inch diameter PVC standpipe extending to a depth of 30 feet. The bottom ten feet of the standpipe is slotted and surrounded by filter sand to allow free water movement without movement of soil particles. A cap flush with the surrounding ground surface was installed at the well for protection and to facilitate future readings. Following installation, water level readings were taken at the beginning and end of each work day.

Piezometer construction details and water level readings are recorded on the piezometer record accompanying the boring log in Appendix A.

SUBSURFACE CONDITIONS

The general subsurface profile in the borings comprises miscellaneous fill over bedrock, locally with a thin layer of decomposed to highly weathered rock atop the bedrock. Our interpretation of the subsurface strata is shown on individual boring logs. General descriptions of the materials encountered are summarized below in order of their occurrence with depth:

Stratum F - Fill (NYC Class 7) The uppermost material encountered in both borings is fill, ranging in thickness from 18 to 23 feet. The fill consists of loose to very compact gray - brown coarse to fine sand, some gravel, trace silt and clay, with various concentrations of debris (brick and concrete), and possibly larger debris. Remnants of old below-grade structures (sub-cellar slab, footings, and foundation walls) are also present within the fill. The SPT N-values range widely from 4 to more than 100 blows per foot (bpf).

Stratum DR and WR - Decomposed and Weathered Rock (NYC Class 3a and 1c) A thin layer of decomposed and weathered rock was encountered in some borings. In Boring M-2, this stratum consisted of brown and pink, coarse to fine sand with some rock fragments and trace silt and mica. In Boring M-1P, no soil was recovered from this layer but the presence of decomposed and weathered rock was inferred from easy drilling, indicative of soft material.

Bedrock (NYC Class 1a and 1b) The 2006 and 2012 subsurface investigations encountered bedrock immediately below the concrete sub-cellar slab of the demolished building, where present. The bedrock generally consisted of gray to black, slightly to moderately weathered and fractured, medium to hard micaceous schist. Rock core recoveries ranged from 68 to 100 percent, and RQD values ranged from 43 to 97 percent.

The bedrock cored during the supplemental borings ranged in recovery from 92 to 100 percent and RQD from 78 to 100 percent. The results between both investigations generally agree, however previous investigations by Langan produced slightly lower Recovery and RQD at shallow depths, as seen in Figure 2, below.

It should also be expected that bedrock near its surface is disturbed by previous excavations and may contain lower quality, disturbed rock.

The top of rock elevations range from Elev. +36.5 to +42, as shown on Drawing No. B-1.

Laboratory testing was performed on rock core samples recovered during the supplemental investigation to obtain strength parameters. Seven samples were tested for unconfined compressive strength (UCS). The test results are attached in Appendix B. A summary of those test results is shown in Table 1 below.

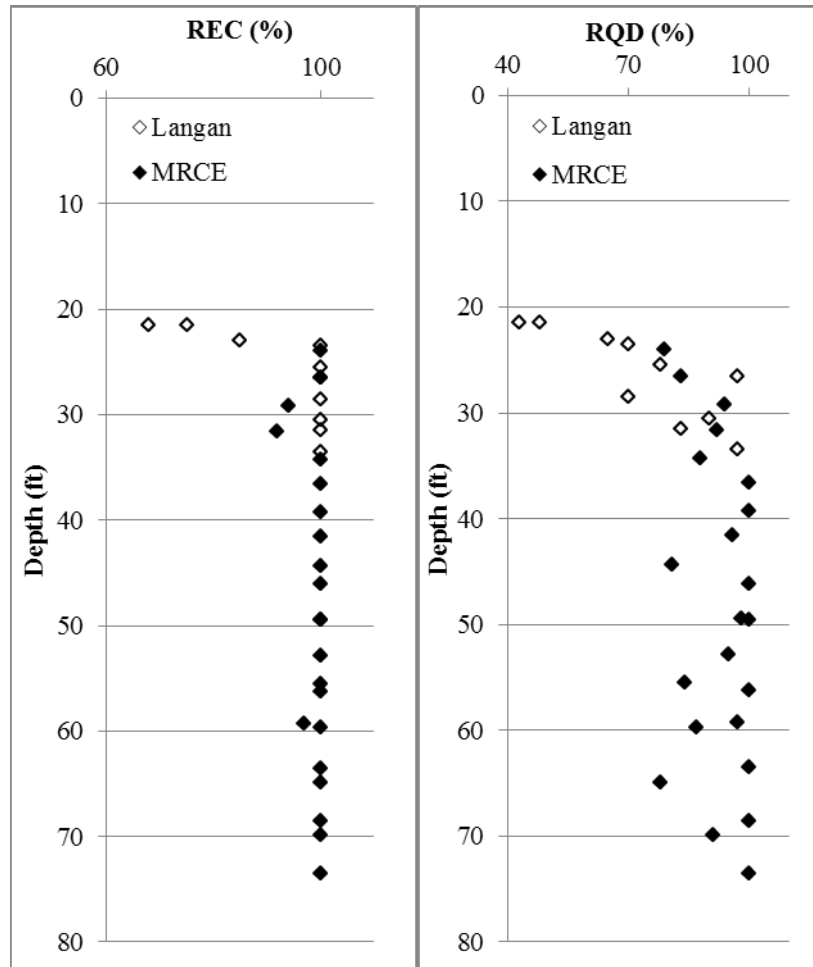


Figure 1: Recovery and RQD with depth, from Langan (2006 and 2012) and present MRCE inspections

Table 1: Summary and Comparison of Rock Strengths

Rock Type	No. of Tests	Unconfined Compressive Strength, psi		
		Minimum	Average	Maximum
Schistose Gneiss	3	10,187	11,093	11,562
Gneissic Schist	4	6,584	7,315	8,317

The rock strength obtained in tests tends to decrease with depth, as shown in Figure 1 below. This is due to the increasing mica content, or schistosity, with depth.

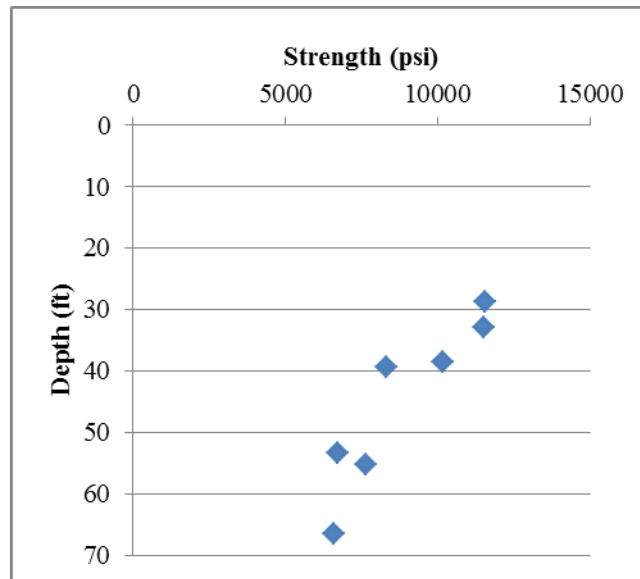


Figure 2: Rock strength with depth

Groundwater Water level readings were taken in piezometers (groundwater monitoring wells) installed in Boring M-1P and in the previously drilled environmental boring, Boring B-1. Groundwater levels measured in the piezometers are considered more indicative of the true water table than measurements in boreholes. Groundwater levels ranged from Elev. +31.5 to Elev. +42.0 during our investigation. In general groundwater likely follows the top of rock surface and maybe locally depressed (such as the lower range of our readings in Boring M-1P) due to adjacent cellar underdrainage systems. The groundwater table is expected to vary seasonally throughout the year depending on precipitation levels and surface water runoff.

FOUNDATION RECOMMENDATIONS

Foundations We understand that the new tower loads will mainly be carried by four large interior columns and two shear walls along the east and west limits of the tower. Other columns, with relatively small loads, will need to be supported outside of the tower footprint. We recommend that two foundation alternatives be considered:

Footings or Piers to Rock with Tiedowns Footings and piers to rock should be used where adequate space for such foundations is available and loads do not need to be transferred too far below adjacent building foundations. Footings or piers to rock maybe feasible for all but the east shear wall foundations. Tiedowns can be used in combination with footings to resist uplift loads. We recommend that the tiedowns, if used, be sized assuming a side friction of 100 psi in tension.

The footings/piers will need to extend to sound rock where lower quality rock is present at rock surface and embedded to provide lateral restraint. A minimum embedment of about 2 feet will likely be required. The footings and piers should be sized for 40 tons per

square foot (tsf) to 60 tsf depending on space constraints and loading conditions. The 60tsf bearing may locally require deeper embedment where lower quality rock is present. Where higher capacity bearing is needed, the foundations can be deepened and their capacity increased to up to 120 tsf according to criteria defined in the Code. Adjacent to the existing buildings, the potential for future deeper excavation at those sites has to be considered.

Deep Foundations Along the east property line, underneath the east shear wall, the new tower loads may need to be transferred to below the adjacent cellars and building foundations. Considering the significant depth of the adjacent cellar spaces (see Figure 2), drilled caissons could be used. The caisson's permanent casing will need to extend to below the adjacent building foundations. The compression and tension capacity of the caissons will be developed within a rock socket below the permanent casing. We recommend that the caisson rock sockets be sized assuming a side friction of 200 psi in compression and 100 psi in tension. The tension capacity check will also need to consider "cone" pullout evaluations and combined effect of the caissons loads (and tiedowns). The pullout cones should not consider rock beyond the property lines as that might be removed during future adjacent development.

We understand that compression load capacities of about 1,500 kips to 3,000 kips per caisson are needed along the east shear wall. Such capacities are typically achieved with caissons constructed using casings with outside diameters ranging from 16 inches to 24 inches (or higher). The 16-inch casing represents the largest diameter threaded casing available and would likely be the most economical. This is due to the smaller size drilling equipment needed and easier installation in restricted headroom conditions. Additionally, the smaller the caisson diameter, the closer it can be installed to the existing walls of adjacent buildings. For instance, the center of the 16-inch caisson would need to be only about 2 feet from the adjacent walls (plus some installation tolerance allowance).

Considering the presently considered depth of the new cellar, lateral forces should be assumed and designed to be resisted by the footings and piers to bedrock. Footings and piers to bedrock will require significantly smaller displacement to mobilize lateral resistance when compared to the caissons.

A compressible layer should be installed below any caisson caps in rock adjacent to an existing cellar to ensure load transfer into the caissons.

Foundation Slab and Walls The cellar walls and slab should be designed as structural elements able to resist both soil and hydrostatic pressures. The long term groundwater should be assumed to be at the highest rock surface elevation of about Elev. +42. The walls and slab should be checked for a short term loading conditions with groundwater at Elev. +50 representing utility leak conditions. At-rest earth pressures should be used for design of foundation walls, assuming a friction angle of 32 degrees and total unit weight of 120 pounds per cubic foot. Seismic earth pressures do not need to be considered.

We recommend that the new cellar spaces be fully protected to grade with sheet waterproofing, such as, Grace products (Preprufe and Bituthene) or approved equals. Hydrophylic waterstops

(Swellseal) should be used. Both material and labor warranties should be obtained for the waterproofing system.

Seismic Design Based on our review of the subsurface profile, the site can be classified as Site Class B, resulting in Seismic Design Category B (assuming the proposed building will be in Use Group II). The seismic parameters including the design acceleration spectrum can be derived directly from the Code. Liquefaction of the existing fill materials does not need to be considered in design.

Foundation Construction Considerations Deep excavation will be required to construct the proposed cellar and new foundations. The general excavation will not extend below cellars of existing adjacent buildings with possible exception along Lot 32 (1049 Avenue of Americas) where minor underpinning might be required. On the south side of the excavation, along W57th Street, the excavation will be shallower than the existing vault which will be reconstructed prior to the excavation.


The excavations will encounter sandy fill, demolition debris, and remnants of old foundations, including thick foundation walls along the buildings lines. Local excavation of rock will be required for construction of footings and foundation piers. In areas of low quality rock, this excavation may be significant to reach bedrock of adequate quality for bearing. Any excavations must be made in a controlled manner to minimize the potential risk of affecting adjacent structures. Foundation subgrade for footings and piers to rock will need to be undisturbed by the excavation, cleaned of all loose materials and inspected by an experienced geotechnical engineer.

Monitoring of Adjacent Buildings A pre-construction condition survey of all adjacent buildings should be performed to document their conditions. Based on the survey results, a monitoring program should be designed to observe potential impact of the construction. This should include vibration monitoring, crack gauges, and displacement monitoring.


Both the NYC Water tunnel and NYCT subway tunnel are too far from the proposed construction to be affected. However, as the subway tunnel is within 200 feet of the site, NYCT will need to review and approve the building design and proposed construction.

Please do not hesitate to call us with any questions.

MUESER RUTLEDGE CONSULTING ENGINEERS


By:  _____
Jan Cermak, P.E.

EXHIBITS

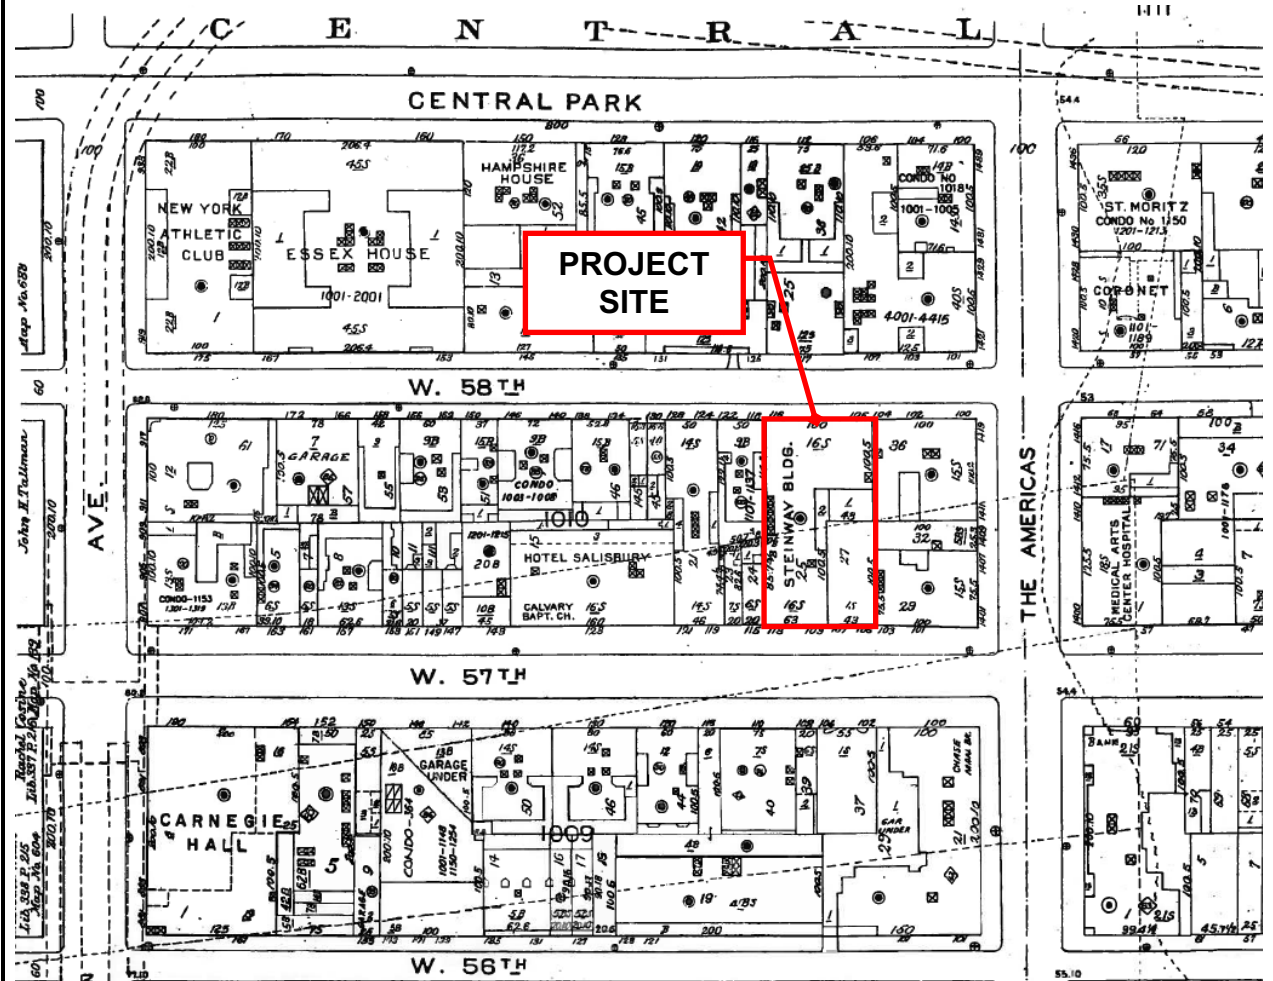

NOTE: BASE PLAN OBTAINED FROM
MANHATTAN LANDBOOK, 2003.

105-111 WEST 57TH STREET	
NEW YORK	NEW YORK
MUESER RUTLEDGE CONSULTING ENGINEERS	
225 WEST 34 TH STREET, NEW YORK NY 10122	
SCALE	MADE BY: JEC DATE: 10-02-13 FILE No.
N/A	CH'KD BY: JC DATE: 10-02-13 12087
SITE LOCATION PLAN	
FIGURE	
1	

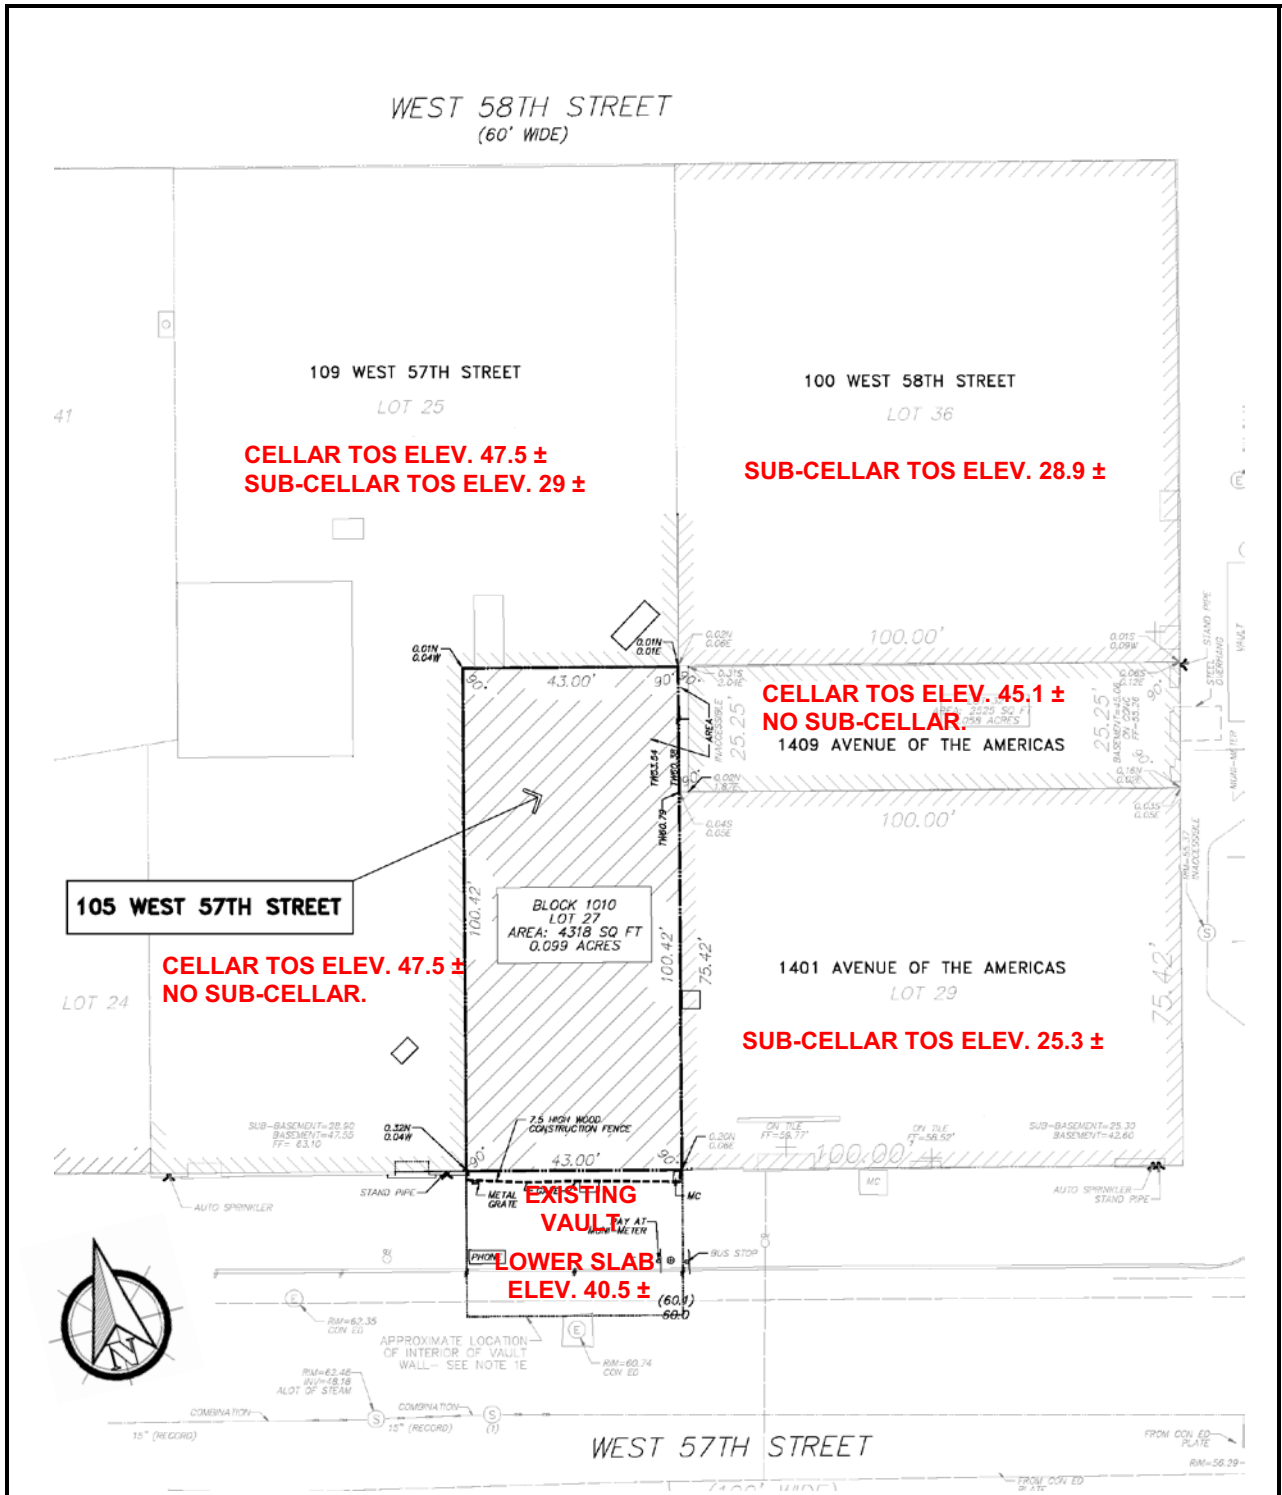

NOTES:

1. BASE PLAN OBTAINED FROM PROPERTY SURVEY PLAN, DWG. X-002, DATED 8/6/12, BY BEPC.

2. ALL SHOWN ELEVATIONS ARE APPROXIMATE AND REFER TO BORO PORESIDENT OF MANHATTAN DATUM.


105-111 WEST 57TH STREET		
NEW YORK		NEW YORK
MUESER RUTLEDGE CONSULTING ENGINEERS		
225 WEST 34 TH STREET, NEW YORK NY 10122		
SCALE	MADE BY: JC	DATE: 10-02-13
N/A	CH'KD BY:	DATE: 10-02-13
CELLAR ELEVATIONS		FILE No. 12087
		FIGURE 2

NOTES:

1. BASE PLAN BY LANGAN, DATED 04-05-2013.
2. AS-DRILLED LOCATIONS FOR BORINGS M-1 AND M-2 WERE OBTAINED BY MICE RESIDENT ENGINEER.
3. BORINGS B-1 THROUGH B-3 WERE MADE BY LANGAN BETWEEN 05-04-2008 AND 05-05-2008; BORINGS B-4 THROUGH B-6 WERE MADE BY LANGAN ON 03-23-2012; BORINGS B-1, SV-1A, SV-2 WERE MADE BY LANGAN ON 03-23-2012.
4. ELEVATIONS ARE IN FEET AND REFERENCED TO BOROUGH PRESIDENT OF MANHATTAN DATUM.

LEGEND:

- M-1 (●) 2013 MICE BORING
- (○) TOP OF ROCK (CLASS 1c OR BETTER) ELEVATION
- B-1 (⊕) 2013 ESA SOIL BORING/MONITORING WELL LOCATION
- SV-1A (⊕) 2013 ESA SOIL VAPOR SAMPLE LOCATION
- B-1 (⊕) 2006 BORING BY OTHERS
- (○) TOP OF ROCK ELEVATION
- B-4 (◇) 2012 BORING BY OTHERS
- — — — — EXISTING GROUND SURFACE CONTOUR

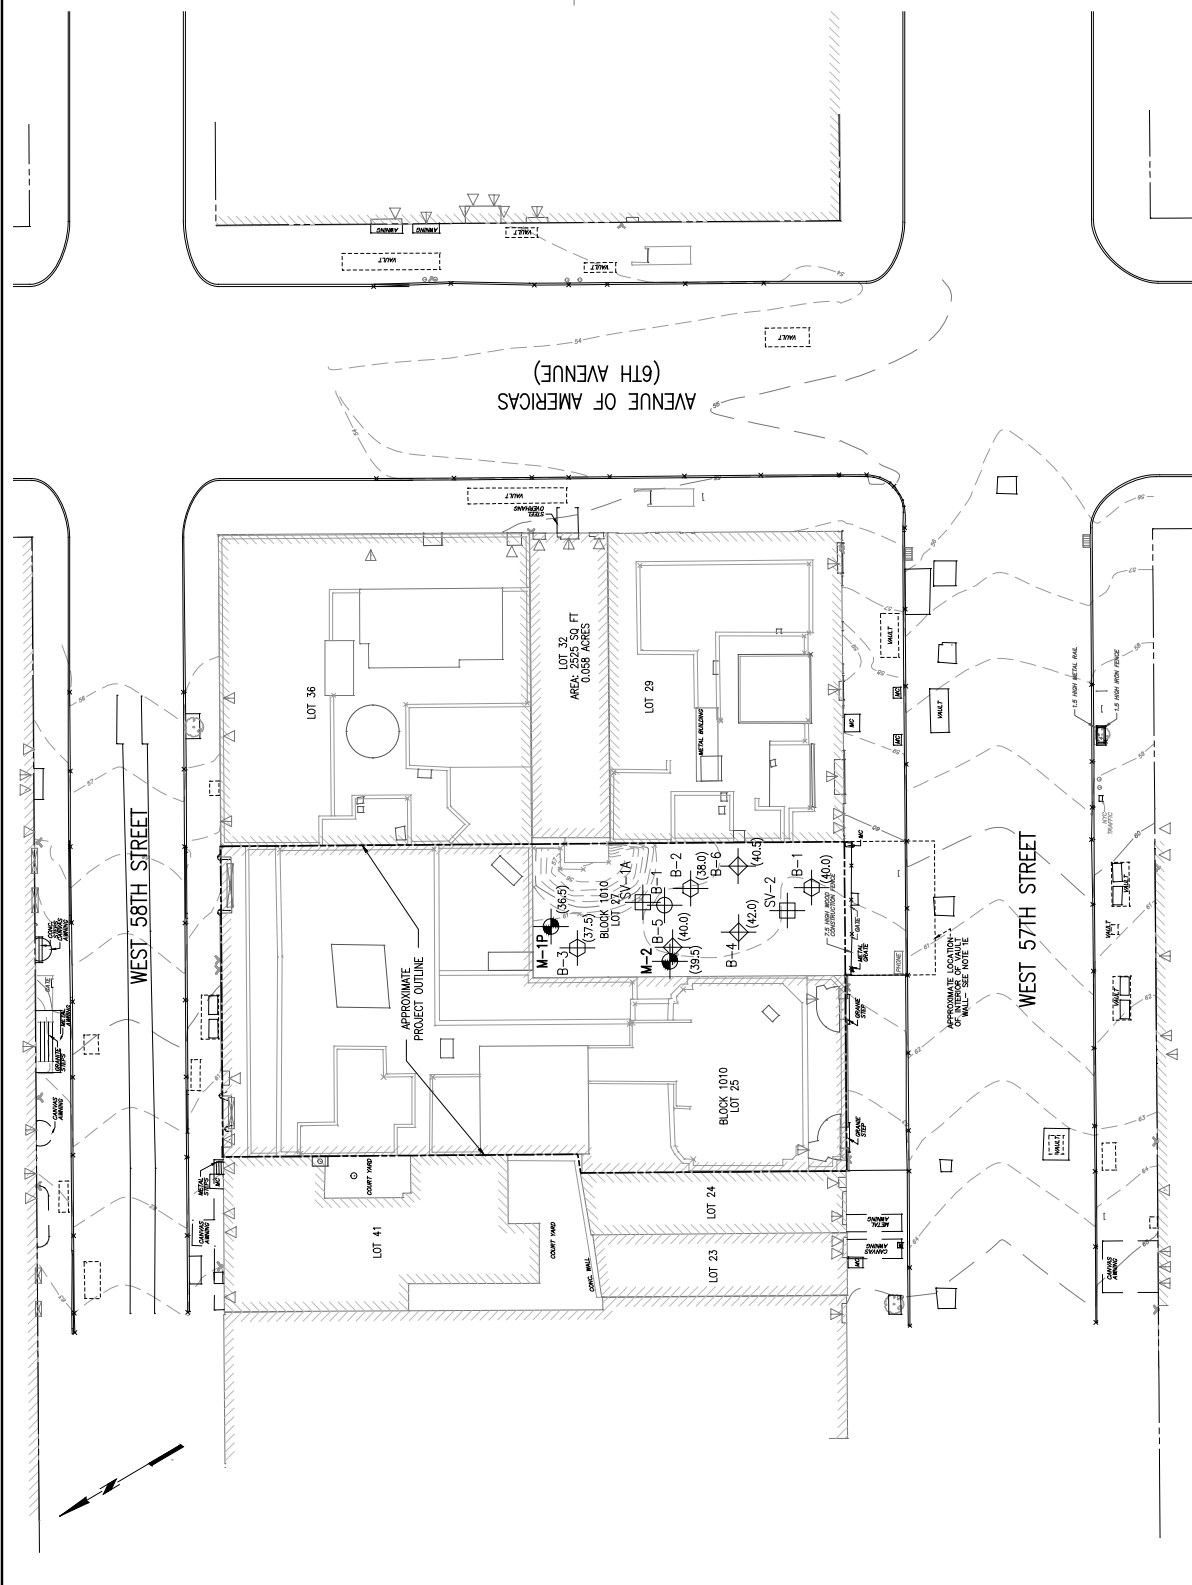

MUESER RUTLEDGE CONSULTING ENGINEERS
 14 PENN PLAZA - 225 W. 34TH STREET, NY, NY 10122
 SCALE: GRAPHIC DATE: 12-30-2013 FILE NUMBER: 12087
 CHECKED BY: ALEP DATE: 12-30-2013 DRAWING NUMBER: B-1

WEST 57 STREET TOWER
 NEW YORK

JDS DEVELOPMENT GROUP
 NEW YORK

BORING LOCATION PLAN

REVISIONS:

REV.	DATE	BY	DESCRIPTION
			WEST 57 STREET TOWER
			NEW YORK
			JDS DEVELOPMENT GROUP
			NEW YORK

PLA N

GRAPHIC SCALE
 20' 0" 20'

APPROXIMATE LOCATION OF WALL - SEE NOTE 1E

APPROXIMATE PROJECT OUTLINE

LOT 36
 LOT 29
 LOT 25
 LOT 24
 LOT 23
 LOT 41

AREA: LOT 32, 0.058 ACRES

LOT 32 (36.5)
 LOT 27 (37.5)
 LOT 25 (39.5)
 LOT 24 (40.0)
 LOT 23 (40.0)

M-1 (36.5)
 B-3 (37.5)
 M-2 (39.5)
 B-5 (40.0)
 B-1 (38.0)
 B-2 (40.0)
 B-4 (42.0)
 B-6 (40.0)
 SV-1A (40.0)
 SV-2 (40.0)


UNIFIED SOIL CLASSIFICATION (INCLUDING IDENTIFICATION AND DESCRIPTION)

MAJOR DIVISIONS	GROUP SYMBOLS	TYPICAL NAMES	FIELD IDENTIFICATION PROCEDURES (EXCLUDING PARTICLES LARGER THAN 3 IN. AND BASING FRACTIONS ON ESTIMATED WEIGHTS)	
			1	2
GRAVELS MORE THAN HALF OF COARSE FRACTION IS LARGER THAN NO. 4 SIEVE SIZE	3	WELL GRADED GRAVELS, GRAVEL-SAND MIXTURES, LITTLE OR NO FINES.	4	5
			GW	WIDE RANGE IN GRAIN SIZES AND SUBSTANTIAL AMOUNTS OF ALL INTERMEDIATE PARTICLE SIZES.
			GP	PREDOMINANTLY ONE SIZE OR A RANGE OF SIZES WITH SOME INTERMEDIATE SIZES MISSING.
			GM	NONPLASTIC FINES OR FINES WITH LOW PLASTICITY (FOR IDENTIFICATION PROCEDURES SEE CL BELOW)
SANDS MORE THAN HALF OF COARSE FRACTION IS SMALLER THAN NO. 4 SIEVE SIZE	4	CLEAN SANDS (LITTLE OR NO FINES)	5	6
			SW	WIDE RANGE IN GRAIN SIZES AND SUBSTANTIAL AMOUNTS OF ALL INTERMEDIATE PARTICLE SIZES.
SANDS MORE THAN HALF OF COARSE FRACTION IS SMALLER THAN NO. 4 SIEVE SIZE	5	SANDS WITH FINES (APPROPRIATE EQUIVALENT TO THE NO. 4 SIEVE SIZE)	6	7
			SP	PREDOMINANTLY ONE SIZE OR A RANGE OF SIZES WITH SOME INTERMEDIATE SIZES MISSING.
FINE-GRAINED SOILS MORE THAN HALF OF MATERIAL IS LARGER THAN NO. 200 SIEVE SIZE IS ABOUT THE SMALLEST PARTICLE VISIBLE TO THE NAKED EYE	6	CLEAN SANDS (LITTLE OR NO FINES)	8	9
			SM	NONPLASTIC FINES OR FINES WITH LOW PLASTICITY (FOR IDENTIFICATION PROCEDURES SEE CL BELOW)
FINE-GRAINED SOILS MORE THAN HALF OF MATERIAL IS SMALLER THAN NO. 200 SIEVE SIZE	7	SANDS WITH FINES (APPROPRIATE EQUIVALENT TO THE NO. 4 SIEVE SIZE)	9	10
			SC	CLAYEY FINES (FOR IDENTIFICATION PROCEDURES SEE CL BELOW)
FINE-GRAINED SOILS MORE THAN HALF OF MATERIAL IS SMALLER THAN NO. 200 SIEVE SIZE	8	SANDS WITH FINES (APPROPRIATE EQUIVALENT TO THE NO. 4 SIEVE SIZE)	11	12
			ML	INORGANIC SILTS, SANDY SILTS, ROCK FLOOR, OR CLAYEY SILTS WITH SLIGHT PLASTICITY.
FINE-GRAINED SOILS MORE THAN HALF OF MATERIAL IS SMALLER THAN NO. 200 SIEVE SIZE	9	SANDS WITH FINES (APPROPRIATE EQUIVALENT TO THE NO. 4 SIEVE SIZE)	13	14
			CL	INORGANIC CLAYS OF LOW TO MEDIUM PLASTICITY, GRAVELLY CLAYS, SANDY CLAYS, SILTY CLAYS, LEAN CLAYS.
FINE-GRAINED SOILS MORE THAN HALF OF MATERIAL IS SMALLER THAN NO. 200 SIEVE SIZE	10	SANDS WITH FINES (APPROPRIATE EQUIVALENT TO THE NO. 4 SIEVE SIZE)	15	16
			OL	ORGANIC SILTS AND ORGANIC SILTY CLAYS OF LOW PLASTICITY.
FINE-GRAINED SOILS MORE THAN HALF OF MATERIAL IS SMALLER THAN NO. 200 SIEVE SIZE	11	SANDS WITH FINES (APPROPRIATE EQUIVALENT TO THE NO. 4 SIEVE SIZE)	17	18
			MH	INORGANIC SILTS, MICAEOUS OR DIATOMACEOUS FINE SANDY OR SILTY SOILS, ELASTIC SILTS.
FINE-GRAINED SOILS MORE THAN HALF OF MATERIAL IS SMALLER THAN NO. 200 SIEVE SIZE	12	SANDS WITH FINES (APPROPRIATE EQUIVALENT TO THE NO. 4 SIEVE SIZE)	19	20
			CH	INORGANIC CLAYS OF HIGH PLASTICITY, FAT CLAYS.
FINE-GRAINED SOILS MORE THAN HALF OF MATERIAL IS SMALLER THAN NO. 200 SIEVE SIZE	13	SANDS WITH FINES (APPROPRIATE EQUIVALENT TO THE NO. 4 SIEVE SIZE)	21	22
			OH	ORGANIC CLAYS OF MEDIUM TO HIGH PLASTICITY, ORGANIC SILTS.
FINE-GRAINED SOILS MORE THAN HALF OF MATERIAL IS SMALLER THAN NO. 200 SIEVE SIZE	14	SANDS WITH FINES (APPROPRIATE EQUIVALENT TO THE NO. 4 SIEVE SIZE)	23	24
			PI	PEAT AND OTHER HIGHLY ORGANIC SOILS.


BOUNDARY CLASSIFICATIONS: SOILS POSSESSING CHARACTERISTICS OF TWO GROUPS ARE DESIGNATED BY COMBINATIONS OF GROUP SYMBOLS, I.E.: SP-SC: POORLY GRADED SAND WITH CLAY BINDER.

DEGREE OF COMPACTION	TERMINOLOGY USED IN URGE SOIL DESCRIPTIONS		IDENTIFICATION CHARACTERISTICS
	DEGREE OF COMPACTION	CONSISTENCY	
LOOSE	SOFT	EASILY REMOULDED WITH SLIGHT FINGER PRESSURE	EASILY REMOULDED WITH SLIGHT FINGER PRESSURE PRESSURE SUBSEQUENTLY DIFFICULT TO REMOLD WITH FINGERS CANNOT BE REMOULDED WITH FINGERS
MEDIUM COMPACT	MEDIUM	1.0 TO 2.0	
COMPACT	STIFF	2.0 TO 4.0	
VERY COMPACT	HARD	GREATER THAN 4.0	
* STANDARD PENETRATION RESISTANCE USING 140 LB. POINTING TAMPOR 30 INCHES TO DRIVE A 2 INCH DIA. TEST SAMPLE.			

LABORATORY CLASSIFICATION CRITERIA

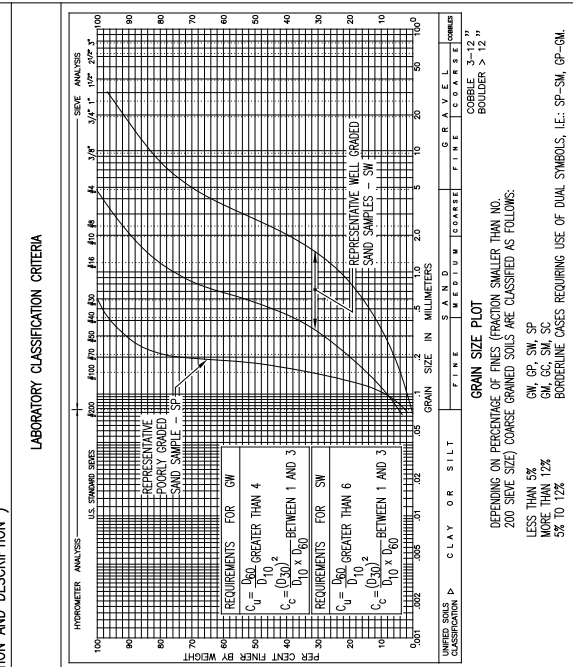

GRAIN SIZE PLOT
 DEPENDENT ON PERCENTAGE OF FINES (FRACTION SMALLER THAN NO. 200 SIEVE SIZE) COARSE GRAINED SOILS ARE CLASSIFIED AS FOLLOWS:
 LESS THAN 5% GW, GP, SW, SP
 MORE THAN 5% GM, GC, SM, SC
 BORDERLINE CASES REQUIRING USE OF DUAL SYMBOLS, I.E.: SP-SM, GP-GM.

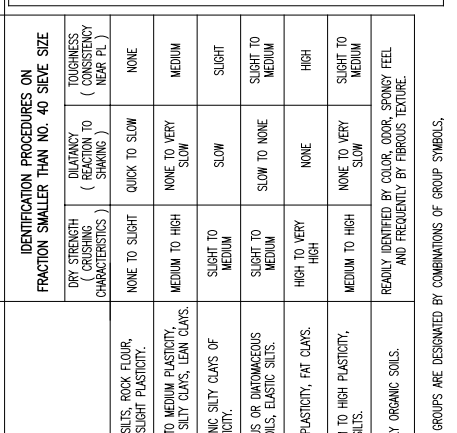


PLASTICITY CHART FOR CLASSIFICATION OF FINE GRAINED SOILS

DESCRIPTION OF CONSTITUENT PARTICLES AS USED IN SOIL SAMPLE CLASSIFICATIONS

1% TO 12% - "TRACE"
 12% TO 30% - "SOME"
 31% TO 45% - "SOME" (FORM OF SOIL GROUP) (EG. SANDY)
 EQUAL AMOUNT - "AND" (EG. SAND AND GRAVEL)

BORING - LEGEND

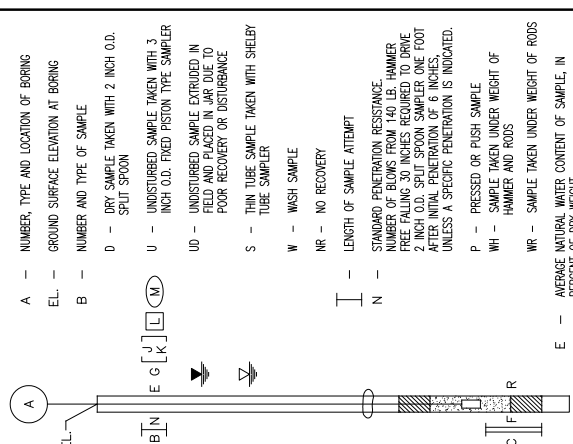

- A - NUMBER, TYPE AND LOCATION OF BORING
- EL. - GROUND SURFACE ELEVATION AT BORING
- B - NUMBER AND TYPE OF SAMPLE
- D - DRY SAMPLE TAKEN WITH 2 INCH O.D. SPLIT SPOON
- U - UNDISTURBED SAMPLE TAKEN WITH 3 INCH O.D. FIXED PISTON TYPE SAMPLER
- UO - UNDISTURBED SAMPLE EXTRUDING IN FIELD AND PLACED IN JAR DUE TO POOR RECOVERY OR DISTURBANCE
- S - THIN TUBE SAMPLE TAKEN WITH SHELBY TUBE SAMPLER
- W - WASH SAMPLE
- NR - NO RECOVERY
- I - LENGTH OF SAMPLE ATTEMPT
- N - STANDARD PENETRATION RESISTANCE
- P - PRESSED OR PUSH SAMPLE
- WH - SAMPLE TAKEN UNDER WEIGHT OF HAMMER AND RODS
- WR - SAMPLE TAKEN UNDER WEIGHT OF RODS
- E - AVERAGE NATURAL WATER CONTENT OF SAMPLE, IN PERCENT OF DRY WEIGHT
- G - UNIFIED SOIL CLASSIFICATION GROUP SYMBOL OF SAMPLE
- [K] - ATTERBERG'S LIQUID LIMIT VALUE
- [L] - ATTERBERG'S PLASTIC LIMIT VALUE
- [M] - COMPRESSIVE STRENGTH IN TSF DETERMINED FROM UNCONFINED COMPRESSION TEST
- * - GROUNDWATER LEVEL OBSERVED IN BORING
- * - MUD LEVEL
- C - ROCK CORE NUMBER
- L - LENGTH OF CORE RUN
- F - LENGTH OF CORE RECOVERED, EXPRESSED AS A PERCENT OF THE LENGTH OF CORE RUN
- R - ROCK QUALITY DESIGNATION - THE SUM OF THE LENGTHS OF PIECES OF RECOVERED CORE WHICH ARE EQUAL TO OR GREATER THAN FOUR INCHES IN LENGTH, EXPRESSED AS A PERCENTAGE OF THE TOTAL LENGTH OF CORE RUN, AND MECHANICAL BREAKS RESULTING FROM CORING ARE IGNORED.
- INFEROUS SEAL
- SAND FILTER SURROUNDING PIEZOMETER INTAKE ELEMENT
- INTAKE ELEMENT
- COBBLE OR BOULDER

TABLE R-1 ROCK CORE CLASSIFICATION CRITERIA

HARDNESS/SOUNDNESS CLASSIFICATION	TYPICAL GEOLOGIC CLASSIFICATION	IDENTIFICATION CHARACTERISTICS	GENERAL MINIMUM CORING CHARACTERISTICS			INTACT SPECIMEN TYPICAL MINIMUM COMPRESSIVE STRENGTH
			1X OR LARGER	BK OR SMALLER	ROD OR SMALLER	
HARD ROCK UNWEATHERED MAY BE JOINTED	-CRYSTALLINE IGNEOUS, OR METAMORPHIC ROCKS -HIGHLY SILICEOUS SEDIMENTARY ROCKS	- UNWEATHERED FABRIC - SHARP AND HARD FRACTURE SURFACE WHEN BROKEN MECHANICALLY - MAY BE JOINTED, BUT JOINTS ARE GENERALLY TIGHT. JOINTS MAY BE IRON STAINED. - DOES NOT DISINTEGRATE UPON EXPOSURE - DOES NOT SLAKE IN WATER	95 OR MORE	85 OR MORE	75 OR MORE	3000
MEDIUM HARD ROCK SLIGHTLY WEATHERED MAY BE CLOSELY JOINTED	AS FOR HARD ROCKS AND: - MODERATELY SILICEOUS SEDIMENTARY ROCKS - CERTAIN CALcareous ROCKS	AS FOR HARD ROCK, EXCEPT: - FABRIC MAY BE IRON STAINED - MAY BE CLOSELY JOINTED, BUT JOINTS ARE GENERALLY TIGHT. JOINTS HAVE SLIGHT WEATHERING OR MAY BE IRON STAINED.	70	50	40	1500
INTERMEDIATE ROCK MODERATELY WEATHERED MAY BE CLOSELY JOINTED	AS FOR MEDIUM HARD ROCKS AND: - MOST SEDIMENTARY ROCKS OTHER THAN CONGLOMERATE SHALES - MOST CALcareous ROCKS WHICH ARE NOT POROUS	AS FOR MEDIUM HARD ROCK, EXCEPT: - MODERATELY WEATHERED FABRIC - WEATHERED JOINTS - THUDS WHEN STRUCK BY BAR - CAN BE INDENTED WITH A STEEL NAIL - BREAKS READILY WITH HAMMER - PIECES OF WEATHERED SURFACE CAN BE BROKEN OFF BY HAND - DOES NOT DISINTEGRATE UPON EXPOSURE - UNWEATHERED PIECES DO NOT SLAKE	50	35	25	500
WEATHERED ROCK HIGHLY WEATHERED MAY BE BROKEN	AS FOR INTERMEDIATE ROCKS AND: - CONGLOMERATE SEDIMENTARIES - CALcareous ROCKS WITH SOIL-FILLED CAVITIES	AS FOR INTERMEDIATE ROCK, EXCEPT: - HIGHLY WEATHERED FABRIC - CAN BE BROKEN EASILY, CRUMBLES WITH DIFFICULTY BY HAND - CAN BE SCRAPED BY KNIFE - MAY SOFTEN UPON EXPOSURE - MAY SLAKE IN WATER - STANDARD PENETRATION RESISTANCE EXCEEDS 50 BLOWS/FOOT	LESS THAN 50	LESS THAN 35	LESS THAN 25	150
DECOMPOSED ROCK (RESIDUAL SOILS)	ALL ROCK TYPES	- ROCK TEXTURE AND STRUCTURE OFTEN PRESERVED - GENERAL CALcareous SOIL-LIKE IN CONSISTENCY - CAN BE CRUMPLED BY SLIGHT HAND PRESSURE - CAN BE FEELED WITH A KNIFE - STANDARD PENETRATION RESISTANCE LESS THAN 50 BLOWS/FOOT	LESS THAN 50	LESS THAN 35	LESS THAN 25	150

NOTES:

- ROCK CORE DESCRIPTIONS REPRESENT ONLY THE MATERIAL RECOVERED IN THE CORING OPERATIONS.
- GENERAL MINIMUM CORING CHARACTERISTICS ASSUME ROCK CORING WITH A DOUBLE TUBE SERIES "M" OR EQUIVALENT CORE BARREL USING GOOD CORING TECHNIQUES AND EQUIPMENT.
- REC - RECOVERY IS THE LENGTH OF CORE RECOVERED, EXPRESSED AS A PERCENTAGE OF THE LENGTH OF CORE RUN.
- ROD - ROCK QUALITY DESIGNATION IS THE SUM OF THE LENGTHS OF CORE PIECES FOUR FEET OR LONGER FROM THE TOP OF THE CORE. LENGTHS OF CORE PIECES SHORTER THAN LENGTHS ARE MEASURED BETWEEN IN-SITU SEPARATIONS. MECHANICAL BREAKS RESULTING FROM CORING AND VERTICAL JOINTS ARE IGNORED.

TABLE R-2 WEATHERING AND JOINTING DEFINITIONS

FABRIC WEATHERING	DEGREE OF FABRIC WEATHERING CHARACTERISTIC	Blky	Intermediate
Unweathered	Unw	Blky	Light
Slightly Weathered	SW	Broken	Lignite
Moderately Weathered	MW	Brown	Limestone
Highly Weathered	HW	Cavities	Jointed
Decomposed	Dec	Chlorite	Joints
		Clay, Clayey	Massive
		Closely jointed	Medium Hard
		Coating on joint surface	Mica, Micaceous
		Crushed	Moderately jointed
		Dark	Moderately weathered
		Decomposed	Pockets
		Ditto	Quartz
		Dolomite, Dolomitic	Recovery
		Iron stained joints	Rock Quality Designation
		Iron stained	Sand
		Feldspar	Sandstone
		Foliation	Schist, Schistose
		Fractured	Shale
		Fragments	Shear zone
		Gneiss, Gneissic	Siliceous
		Gouge	Silt
		Granite, Granitic	Siltstone
		Gray	Slightly weathered
		Hard	Unweathered
		Highly weathered	Weathered
		Hornblende	Weathered joints
		Injected	Vein
		Interbedded	Vertical joints

TABLE R-3 ABBREVIATIONS FOR ROCK CORE CLASSIFICATION

FABRIC WEATHERING	DEGREE OF FABRIC WEATHERING CHARACTERISTIC	Blky	Intermediate
Unweathered	Unw	Blky <td>Light</td>	Light
Slightly Weathered	SW	Broken	Lignite
Moderately Weathered	MW	Brown	Limestone
Highly Weathered	HW	Cavities	Jointed
Decomposed	Dec	Chlorite	Joints
		Clay, Clayey	Massive
		Closely jointed	Medium Hard
		Coating on joint surface	Mica, Micaceous
		Crushed	Moderately jointed
		Dark	Moderately weathered
		Decomposed	Pockets
		Ditto	Quartz
		Dolomite, Dolomitic	Recovery
		Iron stained joints	Rock Quality Designation
		Iron stained	Sand
		Feldspar	Sandstone
		Foliation	Schist, Schistose
		Fractured	Shale
		Fragments	Shear zone
		Gneiss, Gneissic	Siliceous
		Gouge	Silt
		Granite, Granitic	Siltstone
		Gray	Slightly weathered
		Hard	Unweathered
		Highly weathered	Weathered
		Hornblende	Weathered joints
		Injected	Vein
		Interbedded	Vertical joints

TABLE R-4 ROCK CORE SKETCH KEY

SURFACE	JOINT ORIENTATION AND CONDITION	
	CONDITION	CONDITION
Parallel	Curved	Slick
Crossing	Irregular	Smooth
Foliation	Straight	Rough
Stratification		
Unfoliated or Unstratified		
Mechanical Break		

APPENDIX A

MUESER RUTLEDGE CONSULTING ENGINEERS

BORING LOG

PROJECT: 105-113 WEST 57TH STREET TOWER
 LOCATION: NEW YORK, NEW YORK

BORING NO. M-1
 SHEET 1 OF 8
 FILE NO. 12087
 SURFACE ELEV. +60.5±
 RES. ENGR. ALEXANDRA PATRONE

DAILY PROGRESS	SAMPLE			SAMPLE DESCRIPTION	STRATA	DEPTH	CASING BLOWS	REMARKS	
	NO.	DEPTH	BLOWS/6"						
08:30	1D	0.0	2-14	Brown fine to coarse sand, some gravel, trace brick, clay pockets, silt (Fill) (SP-SM)	F		DRILLED	REC=4"	
12-23-13		2.0	12-6				AHEAD		
Monday							4"		
Rain									
60°F									
	2D	5.0	14-7	Brown red fine to coarse sand, some gravel, brick, silt (Fill) (SM)			5		
		7.0	7-5						
							9		
							10		
	3D	10.0	7-7	Gray brown fine to coarse sand, some gravel, silt, trace bricks (Fill) (SM)	F			REC=4" Easy drilling from 23' to 23.2'. Roller bit to 23.5'. Casing refusal at 24'. White return/white gravel in return at 24.5'. *Coring time in minutes per foot.	
		12.0	6-7						
							15		
	4D	15.0	5-7	Dark gray gravelly coarse to fine sand, some silt, trace brick (Fill) (SM)					
		17.0	6-4						
							20		
	5D	20.0	2-2	Gray red coarse to fine sand, some gravel, brick, trace silt (Fill) (GP-GM)					
		22.0	2-4						
						23			
	6NR	23.0	50/0"	No recovery	WR				
	1C	24.0	REC=100%	Top 1.7': Hard unweathered to slightly weathered pink & gray pegmatite, jointed			24.5	8*	
		29.1	RQD=83%	Bot 3.4': Hard unweathered to slightly weathered gray schistose gneiss, moderately jointed to blocky			4*		
							6*		
							7*		
							8*		
	2C	29.1	REC=92%	Hard unweathered to slightly weathered gray schistose gneiss, moderately jointed		30	7*		
		34.1	RQD=92%				7*		
							7*		
							4*		
							8*		
	3C	34.1	REC=100%	Hard unweathered gray schistose gneiss, massive	R	35	6*		
		39.1	RQD=100%					8*	
								7*	
								6*	
								6*	
13:30								6*	
	4C	39.1	REC=100%	Hard slightly weathered gray schistose gneiss, blocky to massive			40	4*	
		44.1	RQD=96%					3*	
								3*	
								3*	
	5C	44.1	REC=100%	Hard unweathered to slightly weathered gray schistose gneiss, massive		45	5*		
		48.1	RQD=100%				5*		
							5*		
							5*		
	6C	48.1	REC=100%	Do 5C			4*		
		50.8	RQD=100%			50	4*		
	7C	50.8	REC=100%	Do 5C			5*		
		54.8	RQD=95%						

MUESER RUTLEDGE CONSULTING ENGINEERS

BORING LOG

PROJECT: 105-113 WEST 57TH STREET TOWER
 LOCATION: NEW YORK, NEW YORK

BORING NO. M-1
 SHEET 2 OF 8
 FILE NO. 12087
 SURFACE ELEV. +60.5±
 RES. ENGR. ALEXANDRA PATRONE

DAILY PROGRESS	SAMPLE			SAMPLE DESCRIPTION	STRATA	DEPTH	CASING BLOWS	REMARKS
	NO.	DEPTH	BLOWS/6"					
Cont'd 12-24-13 Tuesday Overcast 40°F	8C	54.8	REC=100% RQD=100%	Do 5C	R		4*	7C: Core barrel advances 4', recover 2.75', left 1.3' in hole, confirmed with tape. Bottom 1.3' left in hole recover with Run 9C.
		57.6				55	5*	
	9C	57.6	REC=97% RQD=97%	Do 5C			4*	
		60.9				60	4*	
	10C	60.9	REC=100% RQD=100%	Hard unweathered gray gneiss, blocky to massive			4*	
		66.1					65	
	11C	66.1	REC=100% RQD=100%	Do 5C			4*	
		70.9				70	4*	
	12C	70.9	REC=100% RQD=100%	Do 5C			8*	
		76.2				75	5*	
13:15							4*	
						76.2		
					80			
					85			
					90			
					95			
					100			

MUESER RUTLEDGE CONSULTING ENGINEERS

ROCK CORE SKETCH

BORING NO. M-1
 SHEET 3 OF 8
 FILE NO. 12087
 SURFACE ELEVATION +60.5 ±
 RESIDENT ENGINEER A P RONE





PROJECT: W 57th ST
 LOCATION: NEW YORK, NY

Run No.	REC/RQD
3C	100/100

Run No.	REC/RQD
2C	92/92
3C	100/100

Run No.	REC/RQD
1C	100/83
2C	92/92

Run No.	REC/RQD
1C	100/83

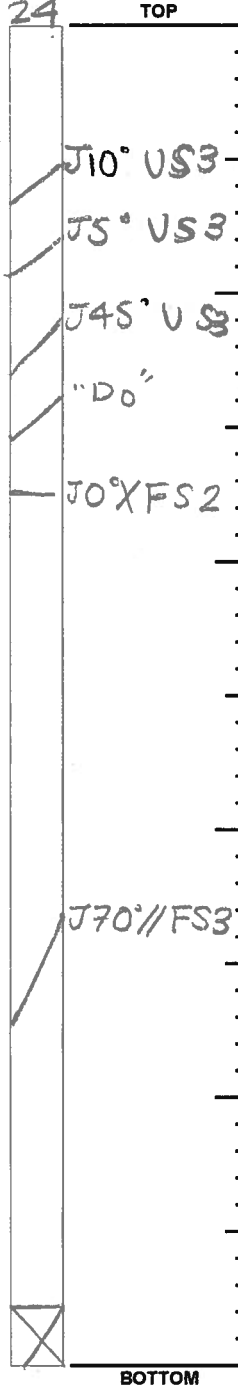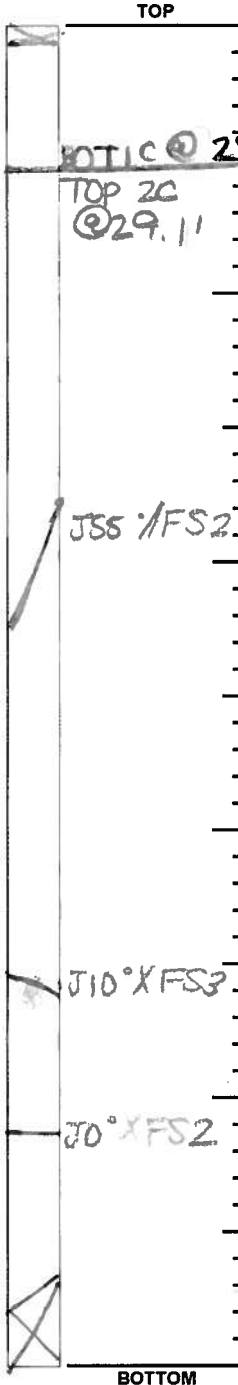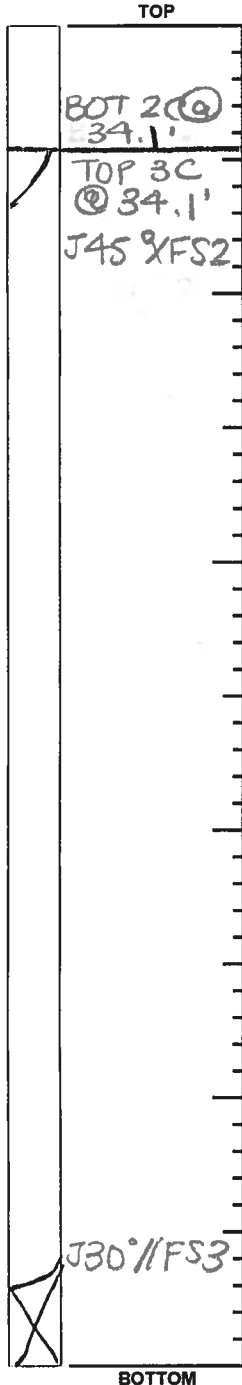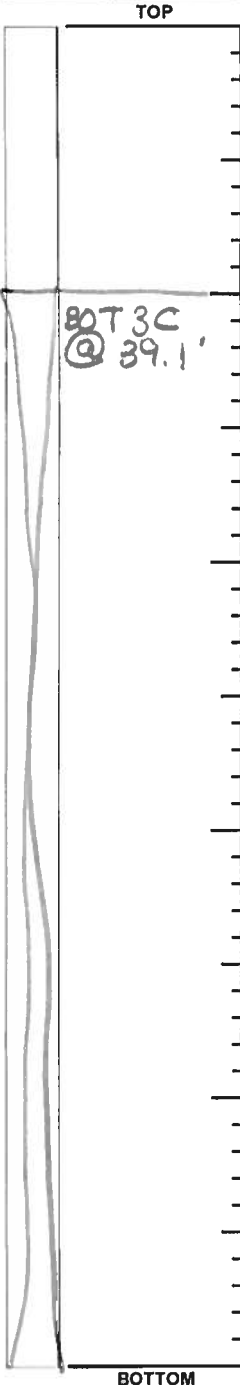

ROCK CORE SKETCH LEGEND

JOINTING

- J - Joint
- MB - Mechanical Break
- ∠ - Angle w/ Horizontal
- // - Parallel
- X - Crossing
- F - Foliation
- S - Stratification
- U - Unfoliated or Unstratified

JOINT SURFACE

- C - Curved
- I - Irregular
- S - Straight

JOINT CONDITION

- 1 - Slick
- 2 - Smooth
- 3 - Rough

SKETCH SYMBOLS

- Joint
- Healed Joint
- Broken
- Part of Core Not Recovered
- Cavities or Vugs in Core
- Clay
- Sand
- Empty Space

SCALE: 1 division = 0.1 feet

NOTES

MUESER RUTLEDGE CONSULTING ENGINEERS

ROCK CORE SKETCH

BORING NO. 14-1
 SHEET 4 OF 8
 FILE NO. 12087
 SURFACE ELEVATION 160.541-
 RESIDENT ENGINEER A. PATRONE





PROJECT: W 57th ST
 LOCATION: NEW YORK, NY

Run No.	REC/RQD
7C	100/95

Run No.	REC/RQD
5C	100/100
6C	100/100

Run No.	REC/RQD
4C	100/96
5C	100/100

Run No.	REC/RQD
4C	100/96

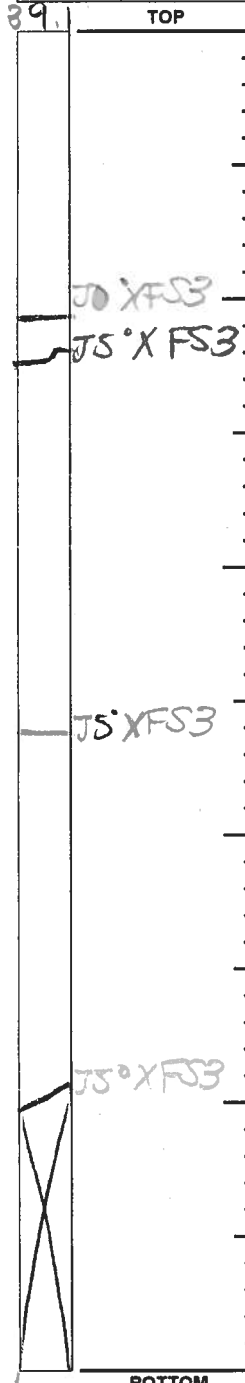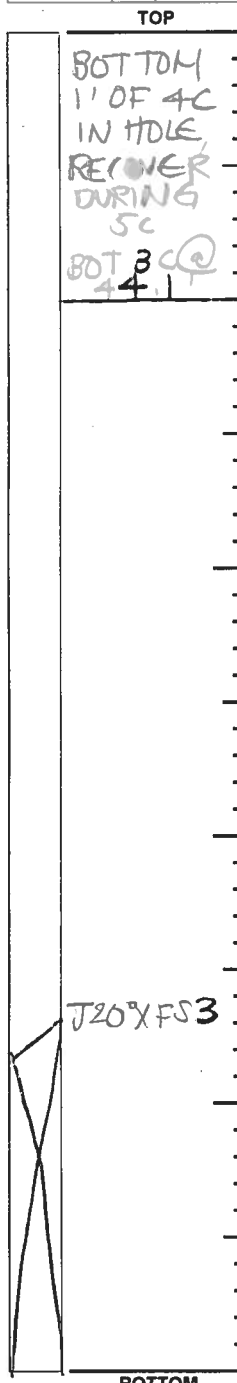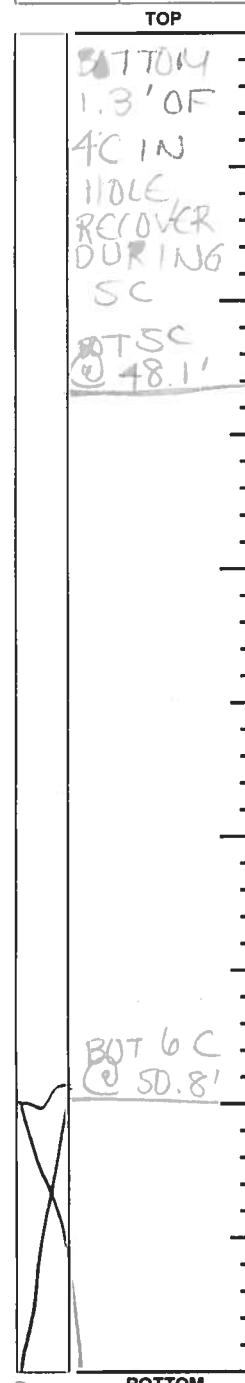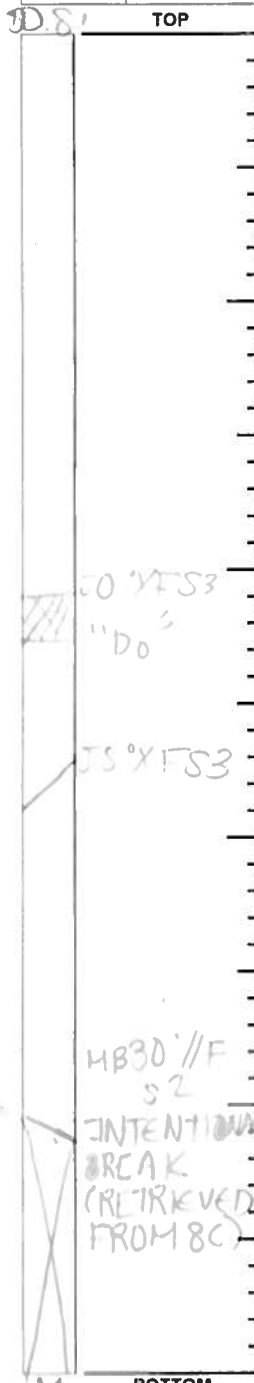

ROCK CORE SKETCH LEGEND

JOINTING

- J - Joint
- MB - Mechanical Break
- ∠ - Angle w/ Horizontal
- // - Parallel
- X - Crossing
- F - Foliation
- S - Stratification
- U - Unfoliated or Unstratified

JOINT SURFACE

- C - Curved
- I - Irregular
- S - Straight

JOINT CONDITION

- Slick
- Smooth
- Rough

SKETCH SYMBOLS

- Joint
- Healed Joint
- Broken
- Part of Core Not Recovered
- Cavities or Vugs in Core
- Clay
- Sand
- Empty Space

51.8' NOTES

50.8'

BOTTOM

BOTTOM

SCALE: 1 division = 0.1 feet

MUESER RUTLEDGE CONSULTING ENGINEERS

ROCK CORE SKETCH

BORING NO. M-1

SHEET 5 OF 8

FILE NO. 12087

SURFACE ELEVATION +60.51-

RESIDENT ENGINEER A PATRONE

PROJECT: W. 57th ST





LOCATION: NEW YORK, NY

Run No.	REC/RQD

Run No.	REC/RQD
10C	100/100

Run No.	REC/RQD
8C	100/100
9C	97/97

Run No.	REC/RQD
8C	100/100

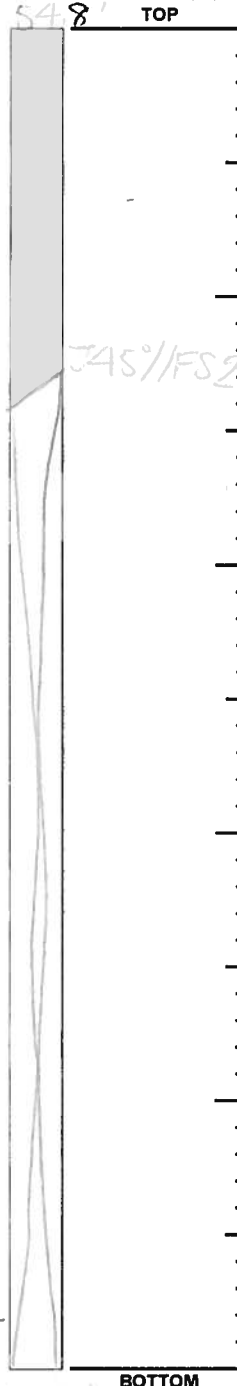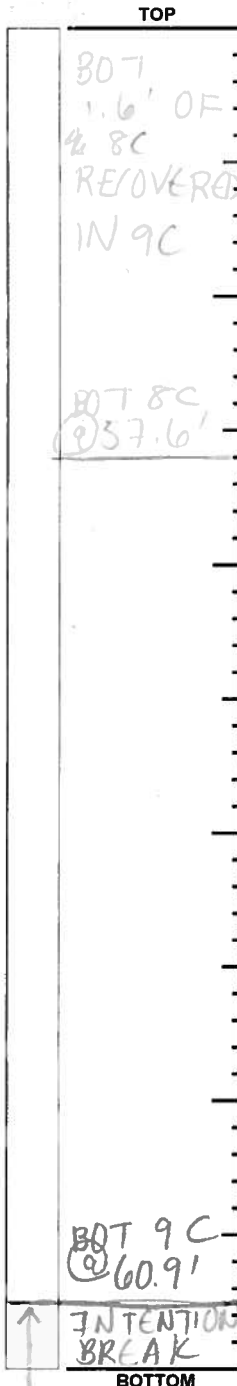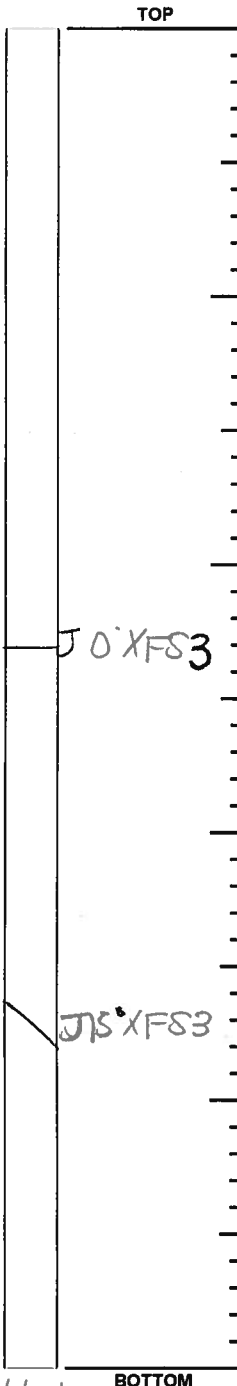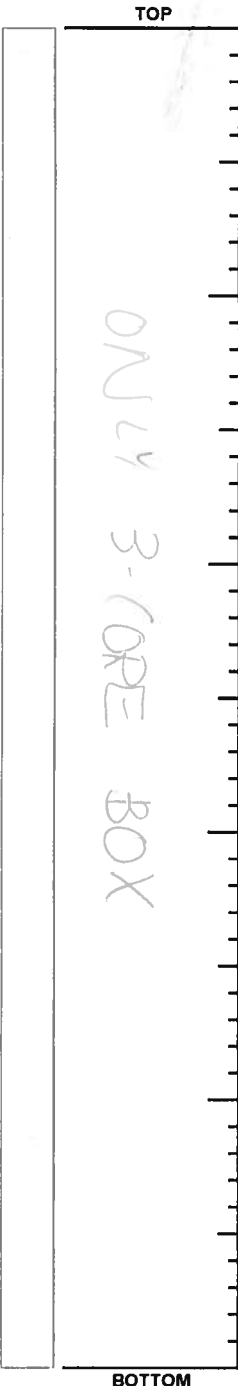

ROCK CORE SKETCH LEGEND

JOINTING

- J - Joint
- MB - Mechanical Break
- ∠ - Angle w/ Horizontal
- // - Parallel
- X - Crossing
- F - Foliation
- S - Stratification
- U - Unfoliated or Unstratified

JOINT SURFACE

- C - Curved
- I - Irregular
- S - Straight

JOINT CONDITION

- 1 - Slick
- 2 - Smooth
- 3 - Rough

SKETCH SYMBOLS

- Joint
- Healed Joint
- Broken
- Part of Core Not Recovered
- Cavities or Vugs in Core
- Clay
- Sand
- Empty Space

SCALE: 1 division = 0.1 feet

NOTES

66.1

OP 10C @ 100.9 - 1.6
(J0°//FS2)

MUESER RUTLEDGE CONSULTING ENGINEERS

ROCK CORE SKETCH

BORING NO. M-1

SHEET 6 OF 8

FILE NO. 12087

SURFACE ELEVATION +60.51-

RESIDENT ENGINEER A. PATRONIK

PROJECT: W. 57th ST.





LOCATION: NEW YORK, NY

Run No.	REC/RQD

Run No.	REC/RQD
12C	$\frac{100}{100}$

Run No.	REC/RQD
12C	$\frac{100}{100}$

Run No.	REC/RQD
11C	$\frac{100}{100}$

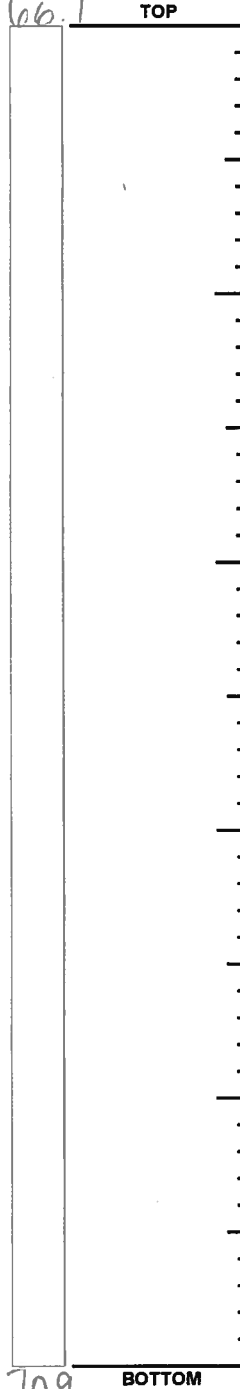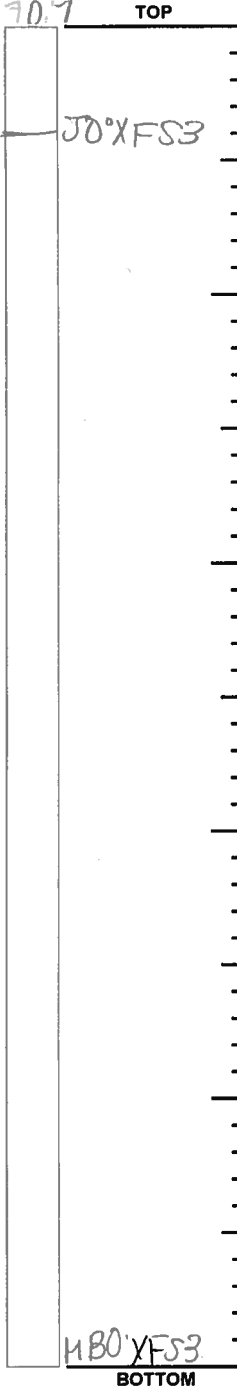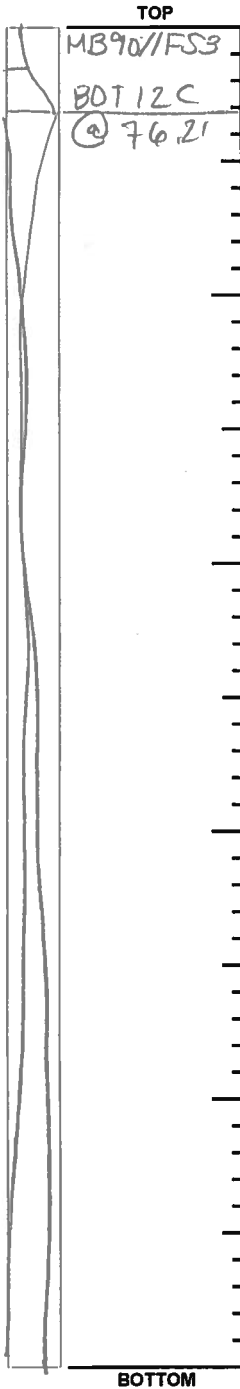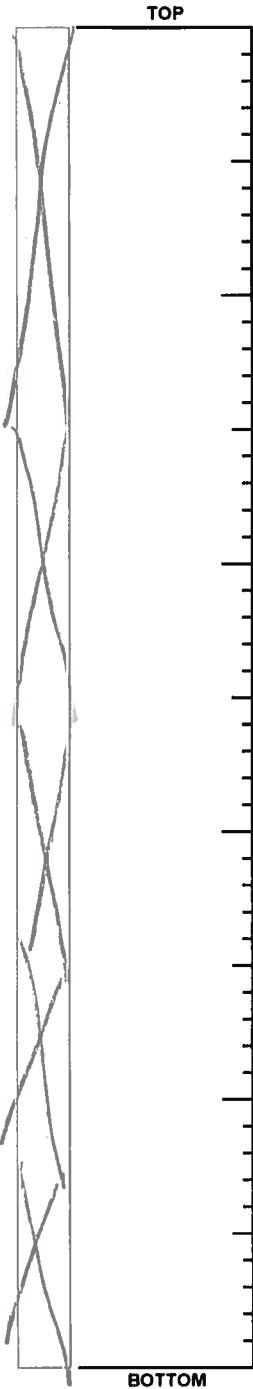

ROCK CORE SKETCH LEGEND

JOINTING

- J - Joint
- MB - Mechanical Break
- ∠ - Angle w/ Horizontal
- // - Parallel
- X - Crossing
- F - Foliation
- S - Stratification
- U - Unfoliated or Unstratified

JOINT SURFACE

- C - Curved
- I - Irregular
- S - Straight

JOINT CONDITION

- 1 - Slick
- 2 - Smooth
- 3 - Rough

SKETCH SYMBOLS

- Joint
- Healed Joint
- Broken
- Part of Core Not Recovered
- Cavities or Vugs in Core
- Clay
- Sand
- Empty Space

SCALE: 1 division = 0.1 feet


NOTES

PIEZOMETER RECORD

PROJECT: W. 54th ST.
 LOCATION: NEW YORK NY
 PIEZOMETER LOCATION: SEE BLP

PIEZOMETER NO. M-1
 DATE OF INSTALLATION 12/30/13
 RESIDENT ENG. E. PHELPS

SEE SKETCH ON BACK

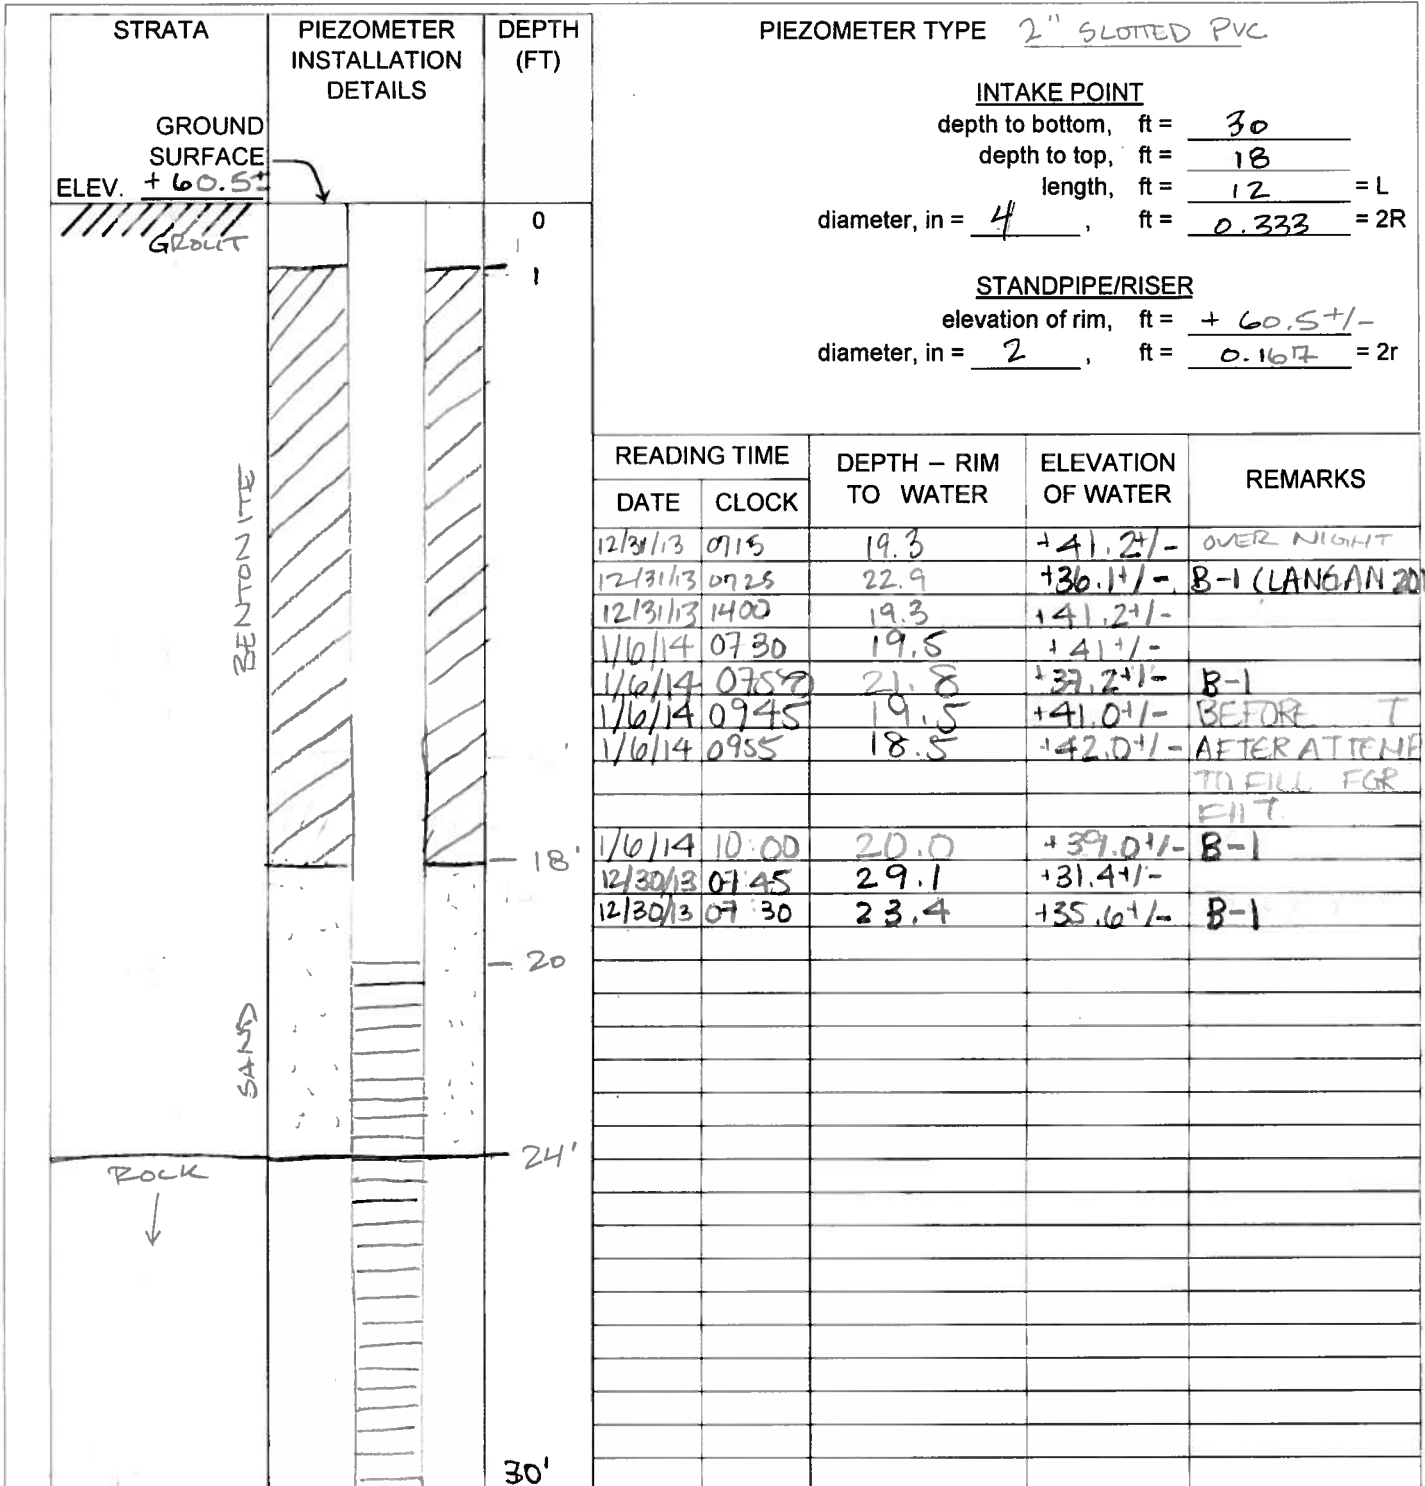

SAND
 GRAVEL
 BENTONITE
 GROUT

GROUND SURFACE ELEV. 00
 PIEZOMETER NO. M 1

MUESER RUTLEDGE CONSULTING ENGINEERS

	BORING NO. <u>M-1</u>
PROJECT <u>105-113 WEST 57TH STREET TOWER</u>	SHEET <u>8</u> OF <u>8</u>
LOCATION <u>NEW YORK, NEW YORK</u>	FILE NO. <u>12087</u>
BORING LOCATION <u>SEE BORING LOCATION PLAN</u>	SURFACE ELEV. <u>+60.5±</u>
	DATUM <u>BPMD</u>

BORING EQUIPMENT AND METHODS OF STABILIZING BOREHOLE

	TYPE OF FEED			
TYPE OF BORING RIG	DURING CORING	CASING USED	<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO
TRUCK <u>X</u>	MECHANICAL	DIA., IN. <u>4</u>	DEPTH, FT. FROM <u>0</u>	TO <u>24.5</u>
SKID	HYDRAULIC <u>X</u>	DIA., IN.	DEPTH, FT. FROM	TO
BARGE	OTHER	DIA., IN.	DEPTH, FT. FROM	TO
OTHER				

TYPE AND SIZE OF:	DRILLING MUD USED
D-SAMPLER <u>2" O. D. SPLIT SPOON</u>	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO
U-SAMPLER	DIAMETER OF ROTARY BIT, IN. <u>2-7/8, 3-7/8</u>
S-SAMPLER	TYPE OF DRILLING MUD
CORE BARREL <u>NX DOUBLE BARREL</u>	AUGER USED
CORE BIT <u>NX DIAMOND BIT</u>	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO
DRILL RODS <u>NWJ</u>	TYPE AND DIAMETER, IN.
	*CASING HAMMER, LBS. <u>140</u> AVERAGE FALL, IN. <u>30</u>
	*SAMPLER HAMMER, LBS. <u>140</u> AVERAGE FALL, IN. <u>30</u>
	*USED AUTOMATIC HAMMER.

WATER LEVEL OBSERVATIONS IN BOREHOLE

DATE	TIME	DEPTH OF HOLE	DEPTH OF CASING	DEPTH TO WATER	CONDITIONS OF OBSERVATION
12-24-13	07:50	39.1	24.5	29.1	OVERNIGHT WATER LEVEL READING.
12-30-13	07:45	76.2	24.5	19.1	OVER WEEKEND, BEFORE PIEZOMETER INSTALLED.
12-31-13	14:00	76.2	24.5	19.3	
01-06-14	07:30	76.2	24.5	19.5	OVER WEEKEND (PIEZOMETER).
01-06-14	09:45	76.2	24.5	19.5	BEFORE FALLING HEAD TEST.
01-06-14	09:55	76.2	24.5	18.5	AFTER ATTEMPTING TO FILL WITH WATER.

PIEZOMETER INSTALLED YES NO **SKETCH SHOWN ON** SEE SHEET NO. 8

STANDPIPE:	TYPE <u>OPEN 2"</u>	ID, IN. <u>1-3/4</u>	LENGTH, FT. <u>20</u>	TOP ELEV. <u>+60.5±</u>
INTAKE ELEMENT:	TYPE <u>2" SLOTTED</u>	OD, IN. <u>2</u>	LENGTH, FT. <u>10</u>	TIP ELEV. <u>+42.5±</u>
FILTER:	MATERIAL <u>SAND</u>	OD, IN. <u>4</u>	LENGTH, FT. <u>12</u>	BOT. ELEV. <u>+30.5±</u>

PAY QUANTITIES

3.5" DIA. DRY SAMPLE BORING	LIN. FT. <u>24</u>	NO. OF 3" SHELBY TUBE SAMPLES	
3.5" DIA. U-SAMPLE BORING	LIN. FT.	NO. OF 3" UNDISTURBED SAMPLES	
CORE DRILLING IN ROCK	LIN. FT. <u>51.7</u>	OTHER:	

BORING CONTRACTOR JERSEY BORING & DRILLING CO., INC.

DRILLER MANUEL CARIRE **HELPERS** MIGUEL TRABAL

REMARKS PIEZOMETER INSTALLED.

RESIDENT ENGINEER ALEXANDRA PATRONE **DATE** 12-31-13

CLASSIFICATION CHECK: FABIAN WEBB **TYPING CHECK:** ALEXANDRA PATRONE

MUESER RUTLEDGE CONSULTING ENGINEERS

BORING LOG

PROJECT: 105-113 WEST 57TH STREET TOWER
 LOCATION: NEW YORK, NEW YORK

BORING NO. M-2
SHEET 1 OF 6
FILE NO. 12087
SURFACE ELEV. +61±
RES. ENGR. E. PHELPS/A. PATRONE

DAILY PROGRESS	SAMPLE			SAMPLE DESCRIPTION	STRATA	DEPTH	CASING BLOWS	REMARKS		
	NO.	DEPTH	BLOWS/6"							
09:50 12-30-13 Monday Overcast 35°F	1D	0.0	26-34	Gray fine to coarse sand, some gravel, trace silt, bricks, concrete (Fill) (SP-SM) Gray brown fine to coarse sand, some gravel, silt, trace bricks (Fill) (SM) Gray coarse to fine sandy gravel, trace bricks, silt (Fill) (GP-GM) Black & gray coarse to fine sandy gravel, trace silt, brick (Fill) (GP-GM) Brn & pink coarse to fine sand, some rock fgmts, tr silt, mica (Decomposed Rock) (SP-SM) Hard slightly weathered pink & gray pegmatite, jointed to closely jointed Hard unweathered to slightly weathered pink & gray pegmatite, blocky Hard unweathered to slightly weathered pink & gray pegmatite, jointed to moderately jointed Top 2.1': Hard unweathered to slightly weathered pink & gray pegmatite, jointed Bot 2.9': Hard unweathered to slightly weathered gray gneiss, jointed Hard slightly weathered gray schistose gneiss, jointed to moderately jointed Hard unweatherd to slightly weathered gray schistose gneiss, moderately jointed	F		DRILLED	*Coring time in minutes per foot. Loss of water & no return from 28' through 31.5'. Difficult coring at 28.5'. Water loss from 27.3' to 34'.		
		2.0	20-14			AHEAD				
	2D	5.0	4-4			4"				
		7.0	5-4			5				
	3D	10.0	8-10							
		12.0	22-10			10				
	4D	15.0	1-1							
		17.0	14-22			15				
	5D	20.0	3-6							
		21.5	29-50/0"			18.5				
	07:00 12-31-13 Tuesday Overcast 25°F	1C	21.5			REC=100%	DR		20	
			26.5			RQD=79%			21.5	10*
2C		26.5	REC=94%	25	6*					
		31.8	RQD=94%	25	7*					
3C		31.8	REC=100%	30	5*					
		36.8	RQD=88%	30	6*					
4C		36.8	REC=100%	35	6*					
		41.8	RQD=100%	35	5*					
5C		41.8	REC=100%	40	4*					
		46.8	RQD=81%	40	7*					
6C		46.8	REC=100%	45	5*					
		52.0	RQD=98%	45	6*					
			50	4*						
			50	4*						
				5*						
				5*						

MUESER RUTLEDGE CONSULTING ENGINEERS

BORING LOG

PROJECT: 105-113 WEST 57TH STREET TOWER
 LOCATION: NEW YORK, NEW YORK

BORING NO. M-2
 SHEET 2 OF 6
 FILE NO. 12087
 SURFACE ELEV. +61±
 RES. ENGR. E. PHELPS/A. PATRONE

DAILY PROGRESS	SAMPLE			SAMPLE DESCRIPTION	STRATA	DEPTH	CASING BLOWS	REMARKS
	NO.	DEPTH	BLOWS/6"					
Cont'd 12-31-13				Hard unweathered to slightly weathered gray schistose gneiss, moderately jointed to CIJtd				
Tuesday Overcast 25°F	7C	52.0	REC=100% RQD=84%					
	8C	57.0	REC=100% RQD=84%	Medium hard to hard gray schistose gneiss, blocky		55		8C-9C: Losing water.
07:30 01-06-14 Monday Rain 50°F		62.4						
				Medium hard to hard gray schistose gneiss, jointed to closely jointed	R		8*	7 Minutes for 1' 3'.
	9C	62.4	REC=100% RQD=78%					
		67.4		Do 9C		60	7*	Top 0.3' of Run 9C recovered in Run 10C.
	10C	67.4	REC=100% RQD=91%				9*	End of Boring at 72'.
		72.4						
09:45							7/13**	
							6*	
							3*	
							65	8*
							8*	
							8*	
							10*	
							3*	
							70	5*
							3*	
							72	5*
							75	
							80	
							85	
							90	
							95	
							100	

MUESER RUTLEDGE CONSULTING ENGINEERS

ROCK CORE SKETCH

BORING NO. M-2

SHEET 3 OF 6

FILE NO. 12087

SURFACE ELEVATION +61 ±

RESIDENT ENGINEER Edoing P. Lopez

PROJECT: West State Street Tower





LOCATION: New York, NY

Run No.	REC/RQD
4C	REC: 100% RQD: 100%

Run No.	REC/RQD
2C	REC: 100% RQD: 88%

Run No.	REC/RQD
2C	REC: 94% RQD: 94%

Run No.	REC/RQD
1C	REC: 100% RQD: 79%

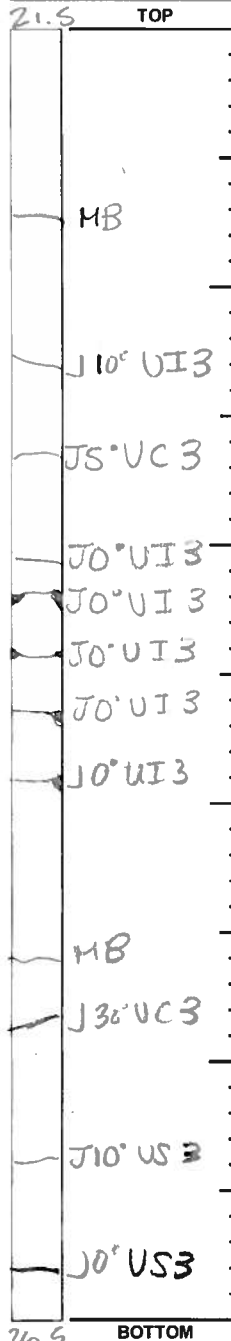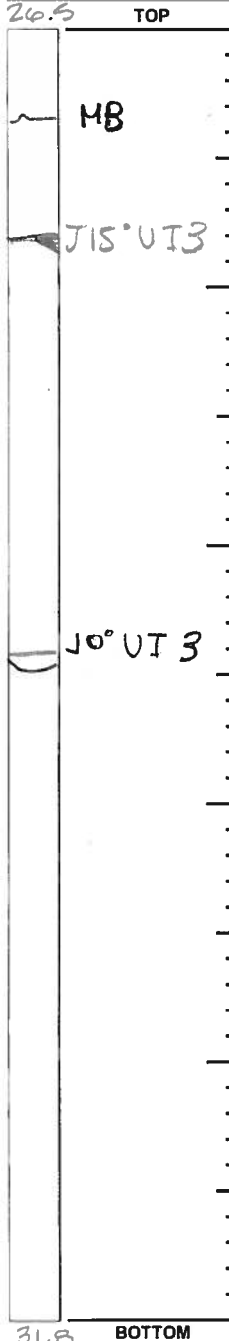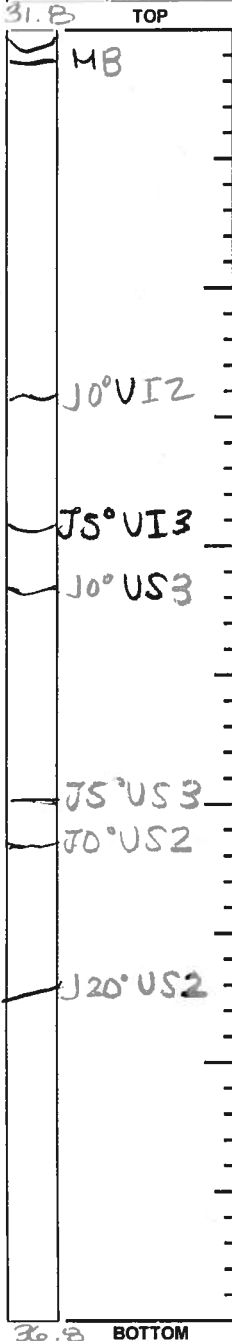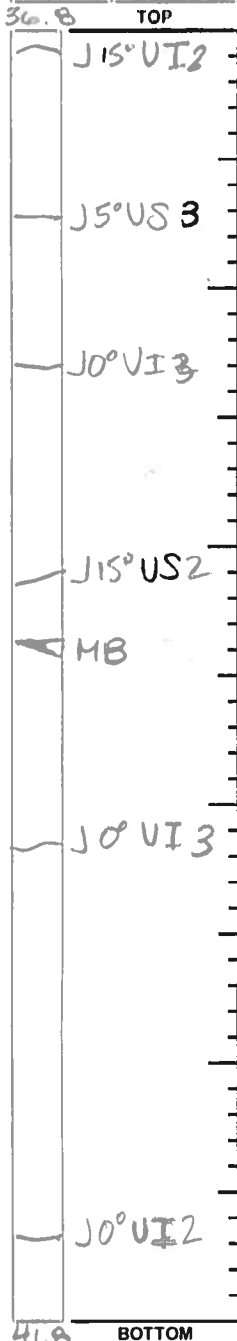

ROCK CORE SKETCH LEGEND

JOINTING

- J - Joint
- MB - Mechanical Break
- ∠ - Angle w/ Horizontal
- // - Parallel
- X - Crossing
- F - Foliation
- S - Stratification
- U - Unfolded or Unstratified

JOINT SURFACE

- C - Curved
- I - Irregular
- S - Straight

JOINT CONDITION

- 1 - Slick
- 2 - Smooth
- 3 - Rough

SKETCH SYMBOLS

- Joint
- Healed Joint
- Broken
- Part of Core Not Recovered
- Cavities or Vugs in Core
- Clay
- Sand
- Empty Space

SCALE: 1 division = 0.1 feet

NOTES Some rock washed away at 2C, 27.3' BGS. Tape shows hole is 31.8' instead of 31.5'.

MUESER RUTLEDGE CONSULTING ENGINEERS

ROCK CORE SKETCH

BORING NO. M-2

SHEET 4 OF 6

FILE NO. 12087

SURFACE ELEVATION +61 +/-

RESIDENT ENGINEER E. PHELPS

PROJECT: W. 57th Street





LOCATION: New York, NY

Run No.	REC/RQD
7C	100/84

Run No.	REC/RQD
6C	100/98
7C	100/84

Run No.	REC/RQD
6C	100%
	98%

Run No.	REC/RQD
5C	100%
	81%

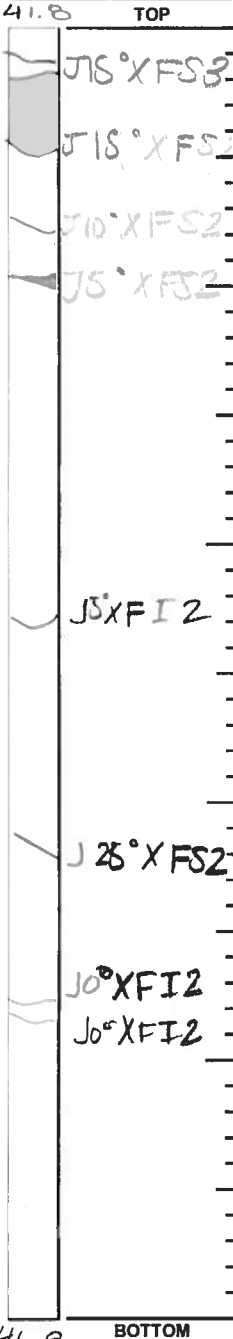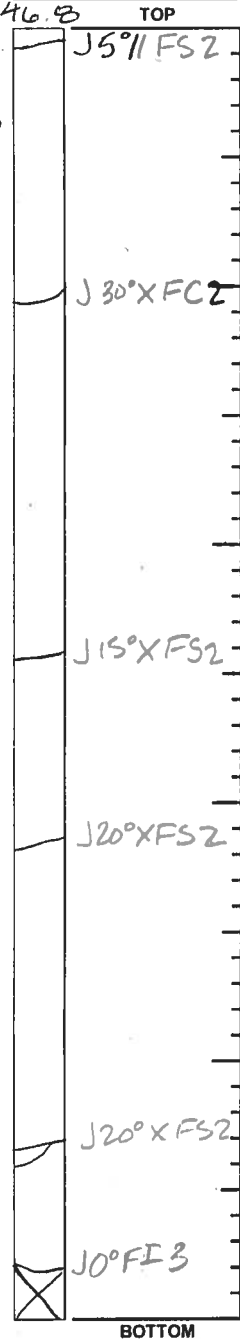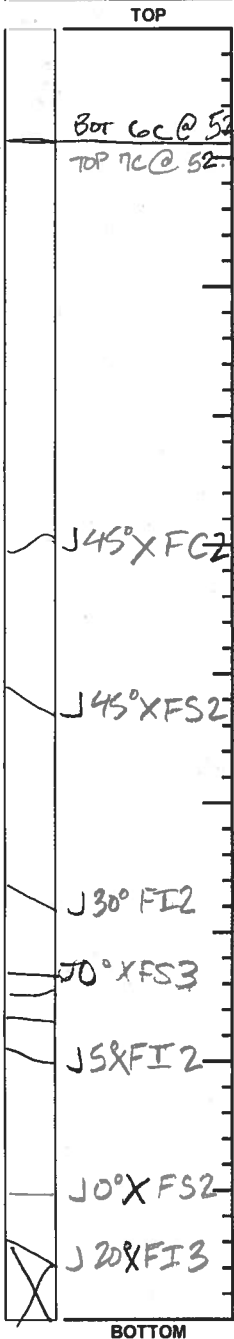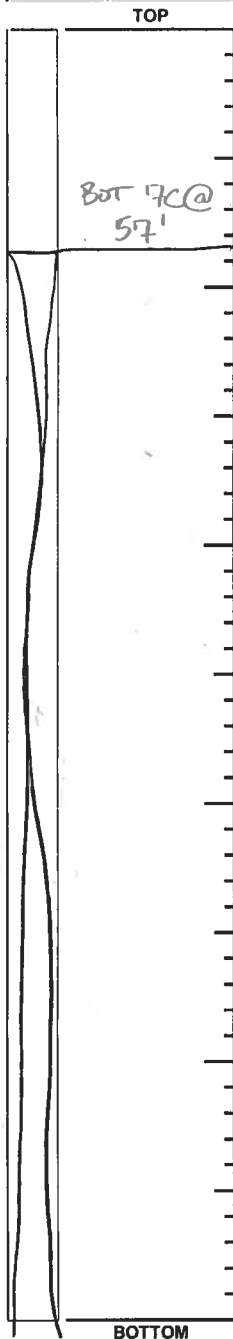

ROCK CORE SKETCH LEGEND

JOINTING

- J - Joint
- MB - Mechanical Break
- ∠ - Angle w/ Horizontal
- // - Parallel
- X - Crossing
- F - Foliation
- S - Stratification
- U - Unfoliated or Unstratified

JOINT SURFACE

- C - Curved
- I - Irregular
- S - Straight

JOINT CONDITION

- 1 - Slick
- 2 - Smooth
- 3 - Rough

SKETCH SYMBOLS

- Joint
- Healed Joint
- Broken
- Part of Core Not Recovered
- Cavities or Vugs in Core
- Clay
- Sand
- Empty Space

NOTES

SCALE: 1 division = 0.1 feet

MUESER RUTLEDGE CONSULTING ENGINEERS

ROCK CORE SKETCH

BORING NO. M-2

SHEET 5 OF 10

FILE NO. 12087

SURFACE ELEVATION +61.1-

RESIDENT ENGINEER A PATRONE





PROJECT W. 57th ST.
 LOCATION NEW YORK, NY

Run No.	REC/RQD
10C	100/91

Run No.	REC/RQD
9C	94/78
10C	100/91

Run No.	REC/RQD
8C	100/84
9C	94/78

Run No.	REC/RQD
8C	100/84

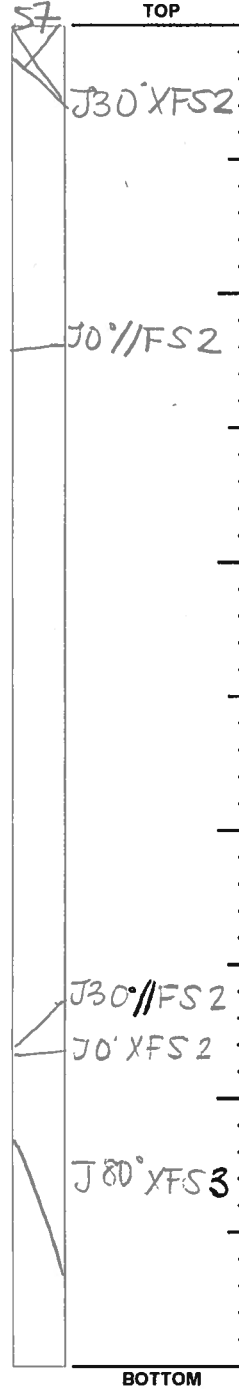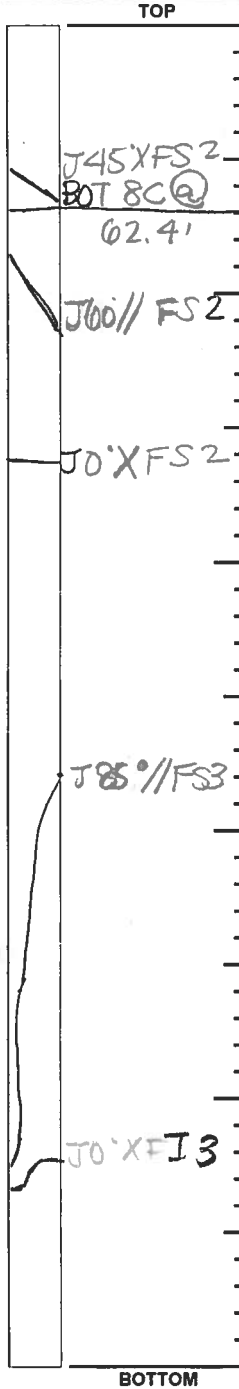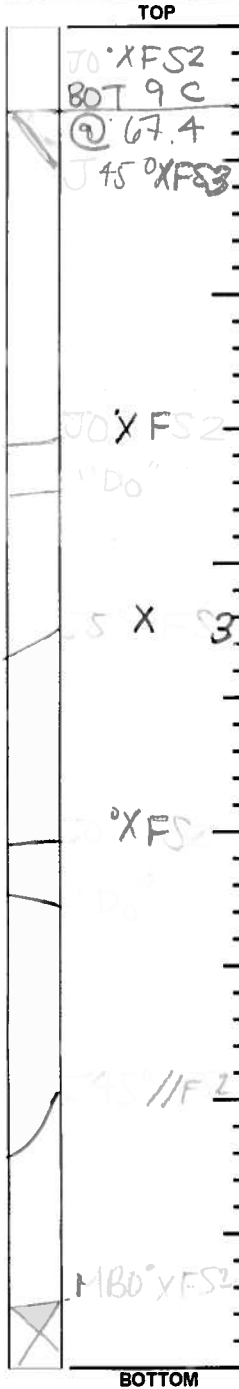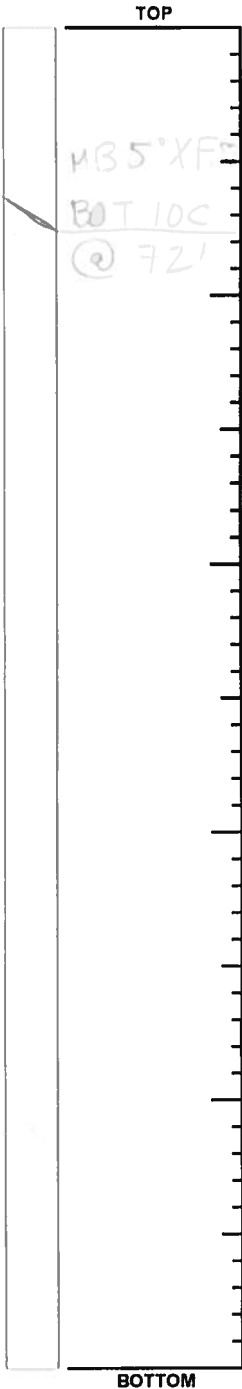

ROCK CORE SKETCH LEGEND

JOINTING

- J - Joint
- MB - Mechanical Break
- Δ - Angle w/ Horizontal
- // - Parallel
- X - Crossing
- F - Foliation
- S - Stratification
- U - Unfoliated or Unstratified

JOINT SURFACE

- C - Curved
- I - Irregular
- S - Straight

JOINT CONDITION

- 1 - Slick
- 2 - Smooth
- 3 - Rough

SKETCH SYMBOLS

- Joint
- Healed Joint
- Broken
- Part of Core Not Recovered
- Cavities or Vugs in Core
- Clay
- Sand
- Empty Space

NOTES

MUESER RUTLEDGE CONSULTING ENGINEERS

PROJECT <u>105-113 WEST 57TH STREET TOWER</u>	BORING NO. <u>M-2</u>
LOCATION <u>NEW YORK, NEW YORK</u>	SHEET <u>6</u> OF <u>6</u>
BORING LOCATION <u>SEE BORING LOCATION PLAN</u>	FILE NO. <u>12087</u>
	SURFACE ELEV. <u>+61±</u>
	DATUM <u>BPMD</u>

BORING EQUIPMENT AND METHODS OF STABILIZING BOREHOLE

TYPE OF BORING RIG	TYPE OF FEED	CASING USED	<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO
TRUCK <u>X</u>	DURING CORING	DIA., IN. <u>4</u>	DEPTH, FT. FROM <u>0</u>	TO <u>21.5</u>
SKID _____	MECHANICAL _____	DIA., IN. _____	DEPTH, FT. FROM _____	TO _____
BARGE _____	HYDRAULIC <u>X</u>	DIA., IN. _____	DEPTH, FT. FROM _____	TO _____
OTHER _____	OTHER _____	DIA., IN. _____	DEPTH, FT. FROM _____	TO _____

TYPE AND SIZE OF:	DRILLING MUD USED <input type="checkbox"/> YES <input checked="" type="checkbox"/> NO
D-SAMPLER <u>2" O. D. SPLIT SPOON</u>	DIAMETER OF ROTARY BIT, IN. <u>3-7/8</u>
U-SAMPLER _____	TYPE OF DRILLING MUD _____
S-SAMPLER _____	
CORE BARREL <u>NX DOUBLE BARREL</u>	AUGER USED <input type="checkbox"/> YES <input checked="" type="checkbox"/> NO
CORE BIT <u>NX DIAMOND BIT</u>	TYPE AND DIAMETER, IN. _____
DRILL RODS <u>NWJ</u>	
	*CASING HAMMER, LBS. <u>140</u> AVERAGE FALL, IN. <u>30</u>
	*SAMPLER HAMMER, LBS. <u>140</u> AVERAGE FALL, IN. <u>30</u>
	*USED AUTOMATIC HAMMER.

WATER LEVEL OBSERVATIONS IN BOREHOLE

DATE	TIME	DEPTH OF HOLE	DEPTH OF CASING	DEPTH TO WATER	CONDITIONS OF OBSERVATION
01-06-14	07:15	57	21.5	22.7	OVER WEEKEND.

PIEZOMETER INSTALLED YES NO **SKETCH SHOWN ON** _____

STANDPIPE:	TYPE _____	ID, IN. _____	LENGTH, FT. _____	TOP ELEV. _____
INTAKE ELEMENT:	TYPE _____	OD, IN. _____	LENGTH, FT. _____	TIP ELEV. _____
FILTER:	MATERIAL _____	OD, IN. _____	LENGTH, FT. _____	BOT. ELEV. _____

PAY QUANTITIES

3.5" DIA. DRY SAMPLE BORING	LIN. FT. <u>21.5</u>	NO. OF 3" SHELBY TUBE SAMPLES _____
3.5" DIA. U-SAMPLE BORING	LIN. FT. _____	NO. OF 3" UNDISTURBED SAMPLES _____
CORE DRILLING IN ROCK	LIN. FT. <u>50.5</u>	OTHER: _____

BORING CONTRACTOR JERSEY BORING & DRILLING CO., INC.

DRILLER MANUEL CARIRE **HELPERS** MIGUEL TRABAL

REMARKS BOREHOLE GROUTED UPON COMPLETION.

RESIDENT ENGINEER EDWARD PHELPS/ALEXANDRA PATRONE **DATE** 12-30-13

CLASSIFICATION CHECK: FABIAN WEBB **TYPING CHECK:** ALEXANDRA PATRONE

APPENDIX B

MUESER RUTLEDGE CONSULTING ENGINEERS

File	12087
Boring No.	M-1
Sample No.	1C
Depth	28.8

COMPRESSIVE STRENGTH (ASTM D7012: METHOD C)

Project Name: 111 W. 57th Street
 Location: NEW YORK, NY

Sample Description: GRAY SCHISTOSE GNEISS

Perf by: ARK Date: 01/08/14
 Calc by: ARK Date: 01/08/14
 Ch'kd by: YO Date: 01/13/14

D (in): 2.05 L (in): 4.29 L/D: 2.09

Sampling Date: 12/23/13

Failure Load (lbf): 38160


Storage Environment: Core Box
 Temperature Condition: Ambient
 Pressure Condition: Unconfined
 Moisture Condition: Air Dry

Failure Type (Structural / Non-Structural): STRUCTURAL

Dimensional Conformance: YES ASTM D4543

Direction of Loading, if Anisotropic: N/A

Uniaxial Compressive Strength 11562 psi 79.7 MPa

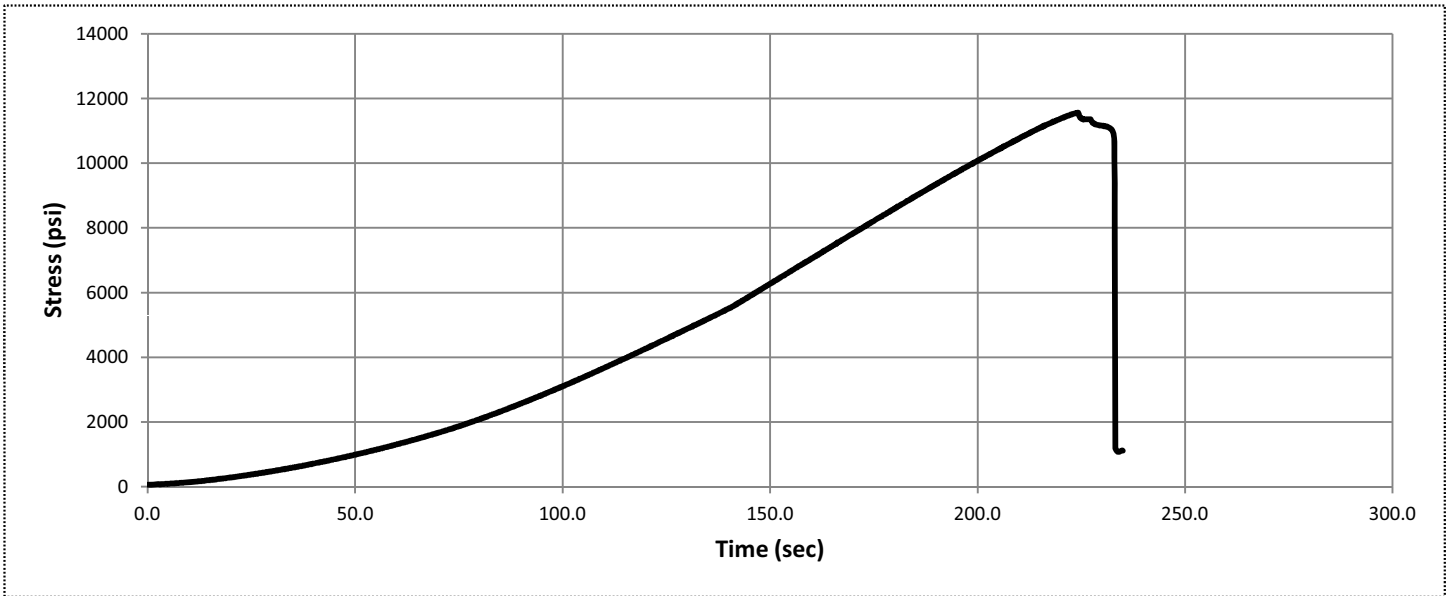

ALL TEST METHODS / RESULTS CONFORM TO ASTM STANDARD D 7012:
 "STANDARD TEST METHOD FOR COMPRESSIVE STRENGTH AND ELASTIC MODULI OF INTACT ROCK CORE
 SPECIMENS UNDER VARYING STATES OF STRESS AND TEMPERATURES."

MUESER RUTLEDGE CONSULTING ENGINEERS

File	12087
Boring No.	M-1
Sample No.	2C
Depth (ft)	33.0

COMPRESSIVE STRENGTH (ASTM D7012: METHOD C)

Project Name: 111 W. 57th Street
 Location: NEW YORK, NY

Sample Description: GRAY SCHISTOSE GNEISS

Perf by: ARK Date: 01/08/14
 Calc by: ARK Date: 01/08/14
 Ch'kd by: YO Date: 01/13/14

D (in): 2.05 L (in): 4.49 L/D: 2.19

Sampling Date: 12/23/13

Failure Load (lbf): 38061


Storage Environment: Core Box
 Temperature Condition: Ambient
 Pressure Condition: Unconfined
 Moisture Condition: Air Dry

Failure Type (Structural / Non-Structural): STRUCTURAL

Dimensional Conformance: NO ASTM D4543

Direction of Loading, if Anisotropic: N/A

Uniaxial Compressive Strength 11531 psi 79.5 MPa

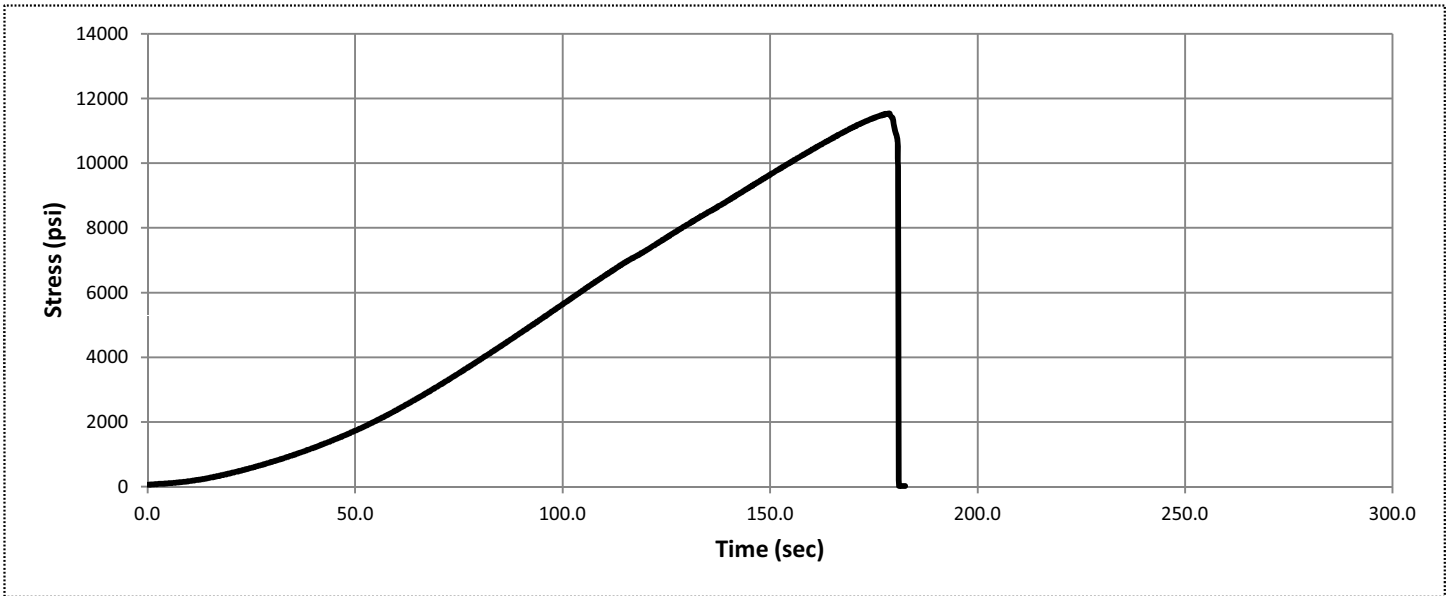

ALL TEST METHODS / RESULTS CONFORM TO ASTM STANDARD D 7012:
 "STANDARD TEST METHOD FOR COMPRESSIVE STRENGTH AND ELASTIC MODULI OF INTACT ROCK CORE
 SPECIMENS UNDER VARYING STATES OF STRESS AND TEMPERATURES."

MUESER RUTLEDGE CONSULTING ENGINEERS

File	12087
Boring No.	M-1
Sample No.	3C
Depth (ft)	38.6

COMPRESSIVE STRENGTH (ASTM D7012: METHOD C)

Project Name: 111 W. 57th Street
 Location: NEW YORK, NY

Sample Description: GRAY SCHISTOSE GNEISS

Perf by: ARK Date: 01/08/14
 Calc by: ARK Date: 01/08/14
 Ch'kd by: YO Date: 01/13/14

D (in): 2.05 L (in): 5.00 L/D: 2.44

Sampling Date: 12/23/13

Failure Load (lbf): 33623



Storage Environment: Core Box
 Temperature Condition: Ambient
 Pressure Condition: Unconfined
 Moisture Condition: Air Dry

Failure Type (Structural / Non-Structural): STRUCTURAL

Dimensional Conformance: NO ASTM D4543

Direction of Loading, if Anisotropic: N/A

Uniaxial Compressive Strength 10187 psi 70.2 MPa

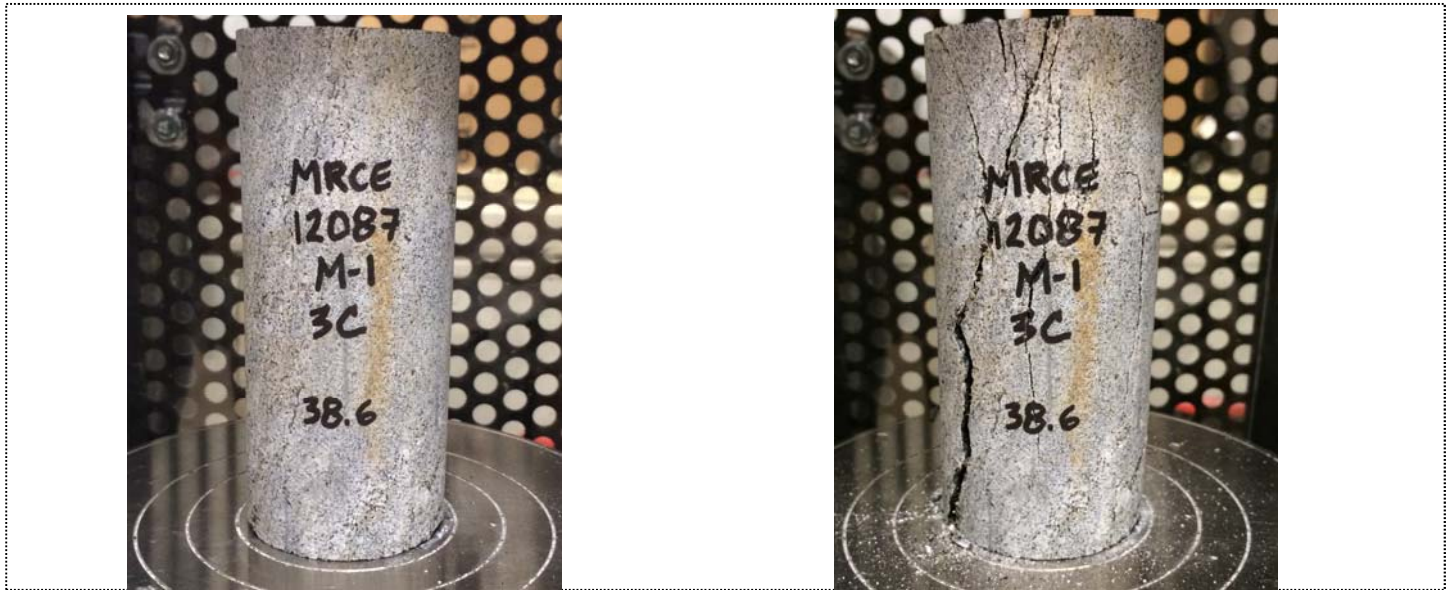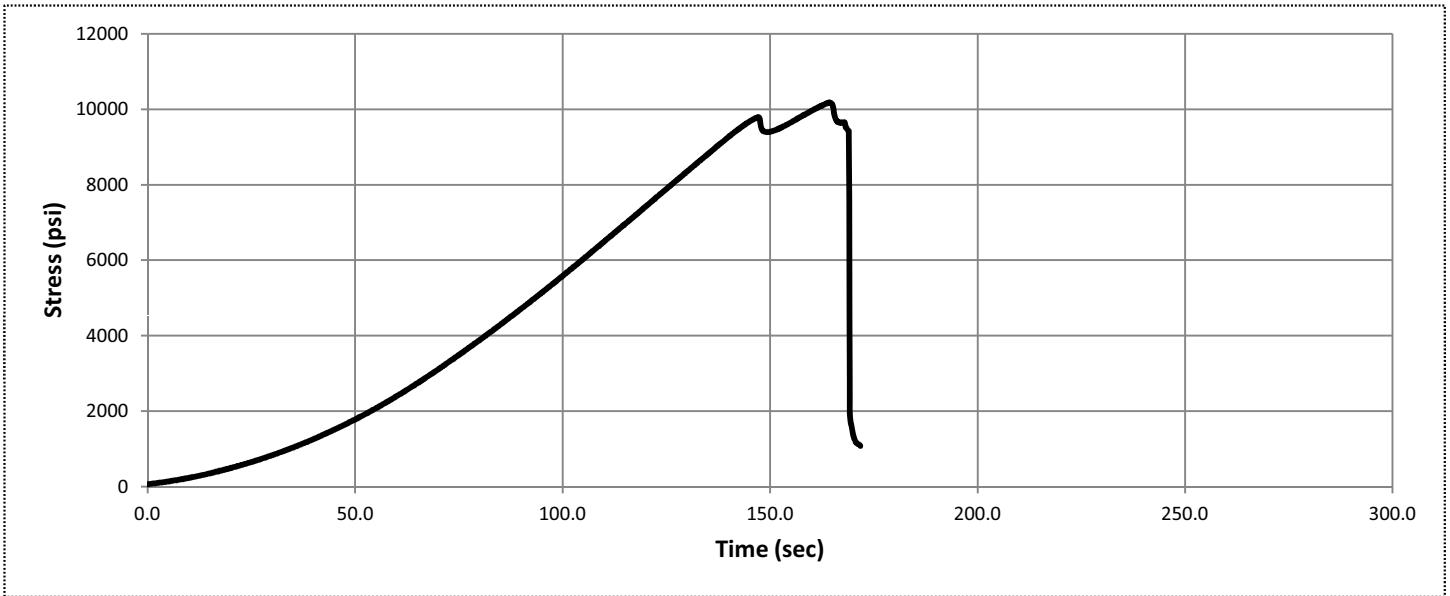

ALL TEST METHODS / RESULTS CONFORM TO ASTM STANDARD D 7012:
 "STANDARD TEST METHOD FOR COMPRESSIVE STRENGTH AND ELASTIC MODULI OF INTACT ROCK CORE
 SPECIMENS UNDER VARYING STATES OF STRESS AND TEMPERATURES."

MUESER RUTLEDGE CONSULTING ENGINEERS

File	12087
Boring No.	M-1
Sample No.	4C
Depth (ft)	39.4

COMPRESSIVE STRENGTH (ASTM D7012: METHOD C)

Project Name: 111 W. 57th Street
 Location: NEW YORK, NY

Sample Description: GRAY GNEISSIC SCHIST

Perf by: ARK Date: 01/08/14
 Calc by: ARK Date: 01/08/14
 Ch'kd by: YO Date: 01/13/14

D (in): 2.05 L (in): 5.02 L/D: 2.45

Sampling Date: 12/24/13

Failure Load (lbf): 27451



Storage Environment: Core Box
 Temperature Condition: Ambient
 Pressure Condition: Unconfined
 Moisture Condition: Air Dry

Failure Type (Structural / Non-Structural): STRUCTURAL

Dimensional Conformance: YES ASTM D4543

Direction of Loading, if Anisotropic: N/A

Uniaxial Compressive Strength 8317 psi 57.3 MPa

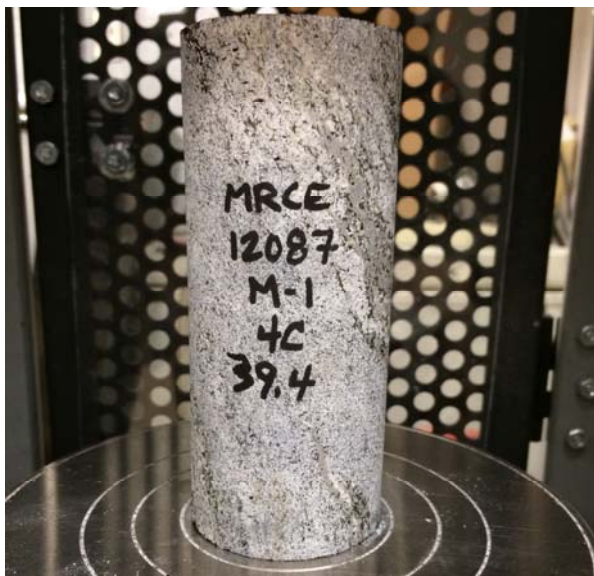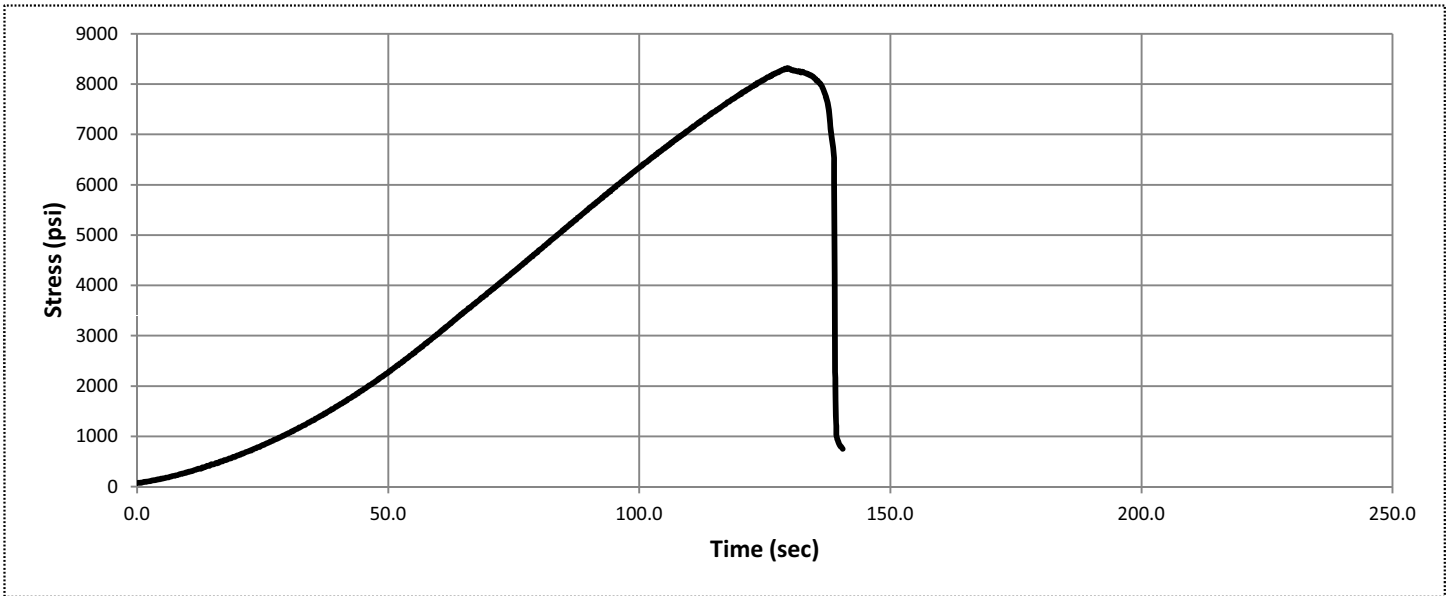

MUESER RUTLEDGE CONSULTING ENGINEERS

File	12087
Boring No.	M-1
Sample No.	7C
Depth (ft)	53.3

COMPRESSIVE STRENGTH (ASTM D7012: METHOD C)

Project Name: 111 W. 57th Street
 Location: NEW YORK, NY

Sample Description: GRAY GNEISSIC SCHIST

Perf by: ARK Date: 01/08/14
 Calc by: ARK Date: 01/08/14
 Ch'kd by: YO Date: 01/13/14

D (in): 2.05 L (in): 4.97 L/D: 2.42

Sampling Date: 12/24/13

Failure Load (lbf): 22195


Storage Environment: Core Box
 Temperature Condition: Ambient
 Pressure Condition: Unconfined
 Moisture Condition: Air Dry

Failure Type (Structural / Non-Structural): STRUCTURAL

Dimensional Conformance: YES ASTM D4543

Direction of Loading, if Anisotropic: N/A

Uniaxial Compressive Strength 6724 psi 46.4 MPa

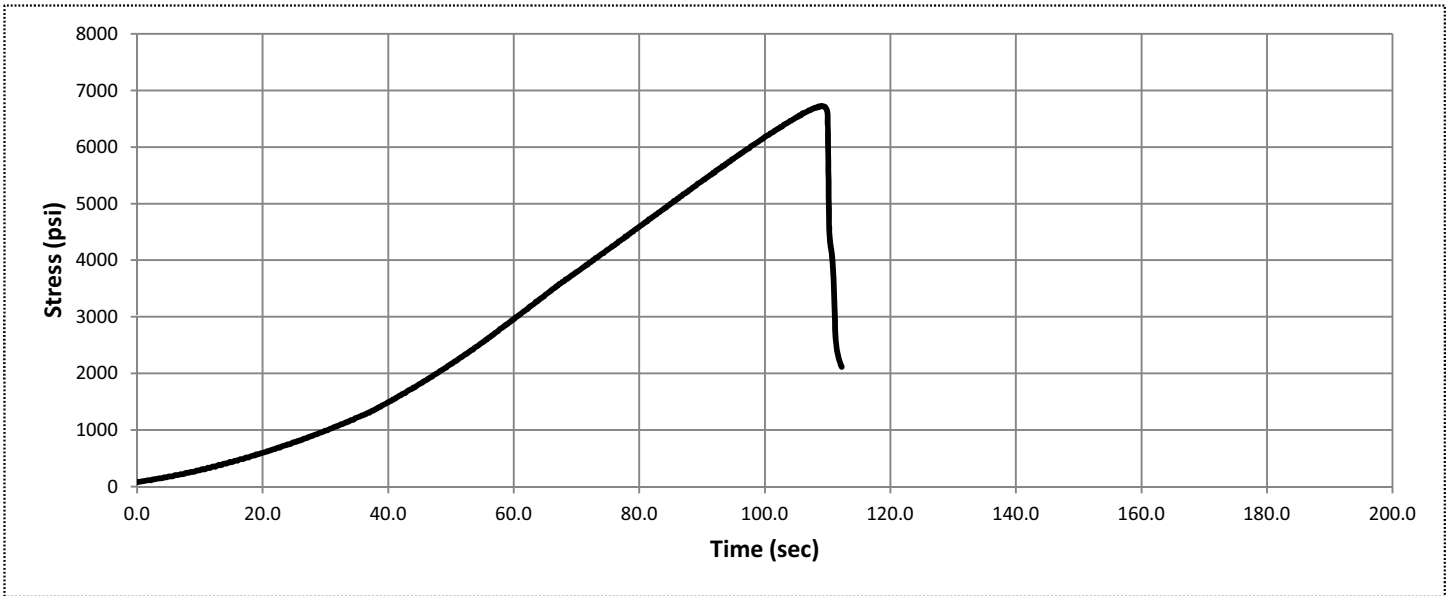

ALL TEST METHODS / RESULTS CONFORM TO ASTM STANDARD D 7012:
 "STANDARD TEST METHOD FOR COMPRESSIVE STRENGTH AND ELASTIC MODULI OF INTACT ROCK CORE
 SPECIMENS UNDER VARYING STATES OF STRESS AND TEMPERATURES."

MUESER RUTLEDGE CONSULTING ENGINEERS

File	12087
Boring No.	M-1
Sample No.	8C
Depth (ft)	55.3

COMPRESSIVE STRENGTH (ASTM D7012: METHOD C)

Project Name: 111 W. 57th Street
 Location: NEW YORK, NY

Sample Description: GRAY GNEISSIC SCHIST

D (in): 2.05 L (in): 5.02 L/D: 2.45

Perf by: ARK Date: 01/08/14
 Calc by: ARK Date: 01/08/14
 Ch'kd by: YO Date: 01/13/14

Sampling Date: 12/24/13

Failure Load (lbf): 25202



Storage Environment: Core Box
 Temperature Condition: Ambient
 Pressure Condition: Unconfined
 Moisture Condition: Air Dry

Failure Type (Structural / Non-Structural): STRUCTURAL

Dimensional Conformance: YES ASTM D4543

Direction of Loading, if Anisotropic: N/A

Uniaxial Compressive Strength 7636 psi 52.6 MPa

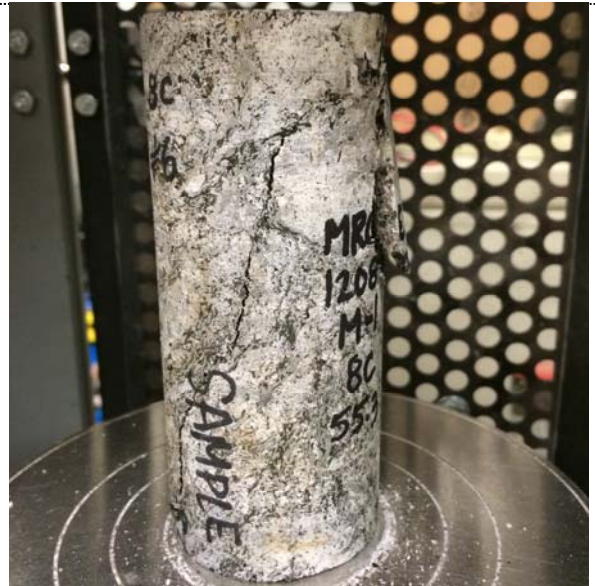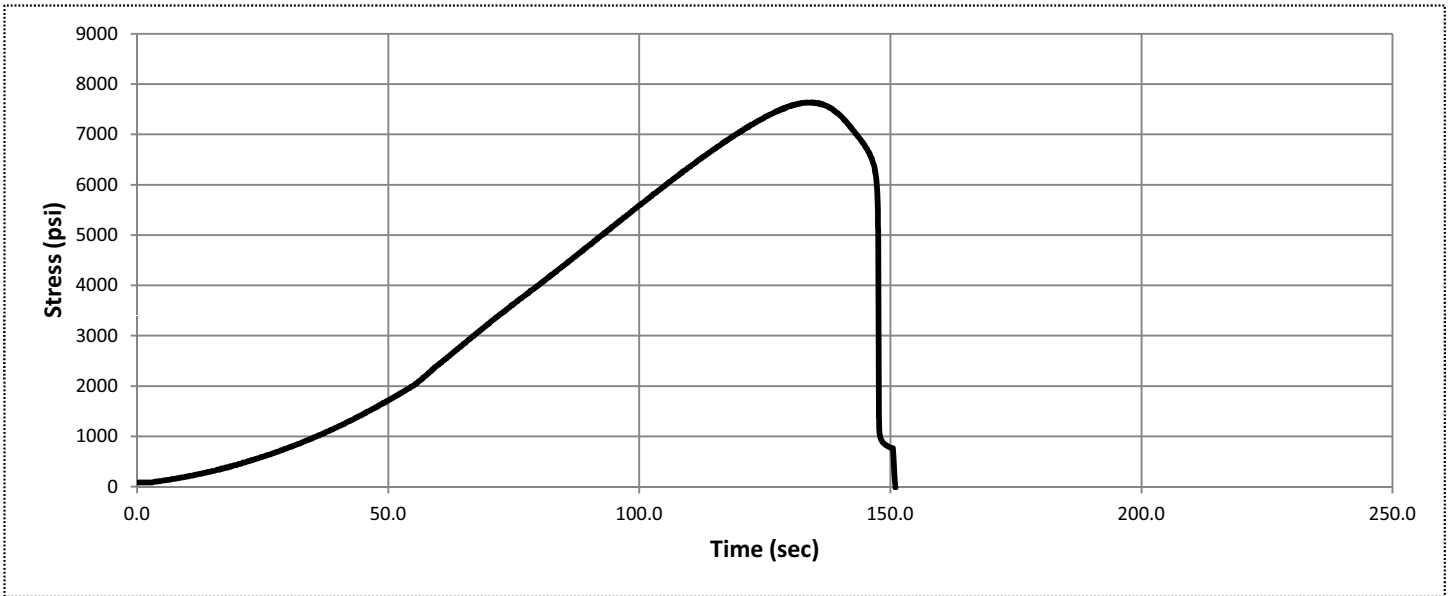

ALL TEST METHODS / RESULTS CONFORM TO ASTM STANDARD D 7012:
 "STANDARD TEST METHOD FOR COMPRESSIVE STRENGTH AND ELASTIC MODULI OF INTACT ROCK CORE
 SPECIMENS UNDER VARYING STATES OF STRESS AND TEMPERATURES."

MUESER RUTLEDGE CONSULTING ENGINEERS

File	12087
Boring No.	M-1
Sample No.	11C
Depth (ft)	66.5

COMPRESSIVE STRENGTH (ASTM D7012: METHOD C)

Project Name: 111 W. 57th Street
 Location: NEW YORK, NY

Sample Description: GRAY GNEISSIC SCHIST

Perf by: ARK Date: 01/08/14
 Calc by: ARK Date: 01/08/14
 Ch'kd by: YO Date: 01/13/14

D (in): 2.05 L (in): 4.99 L/D: 2.43

Sampling Date: 12/24/13

Failure Load (lbf): 21732



Storage Environment: Core Box
 Temperature Condition: Ambient
 Pressure Condition: Unconfined
 Moisture Condition: Air Dry

Failure Type (Structural / Non-Structural): STRUCTURAL

Dimensional Conformance: YES ASTM D4543

Direction of Loading, if Anisotropic: N/A

Uniaxial Compressive Strength 6584 psi 45.4 MPa

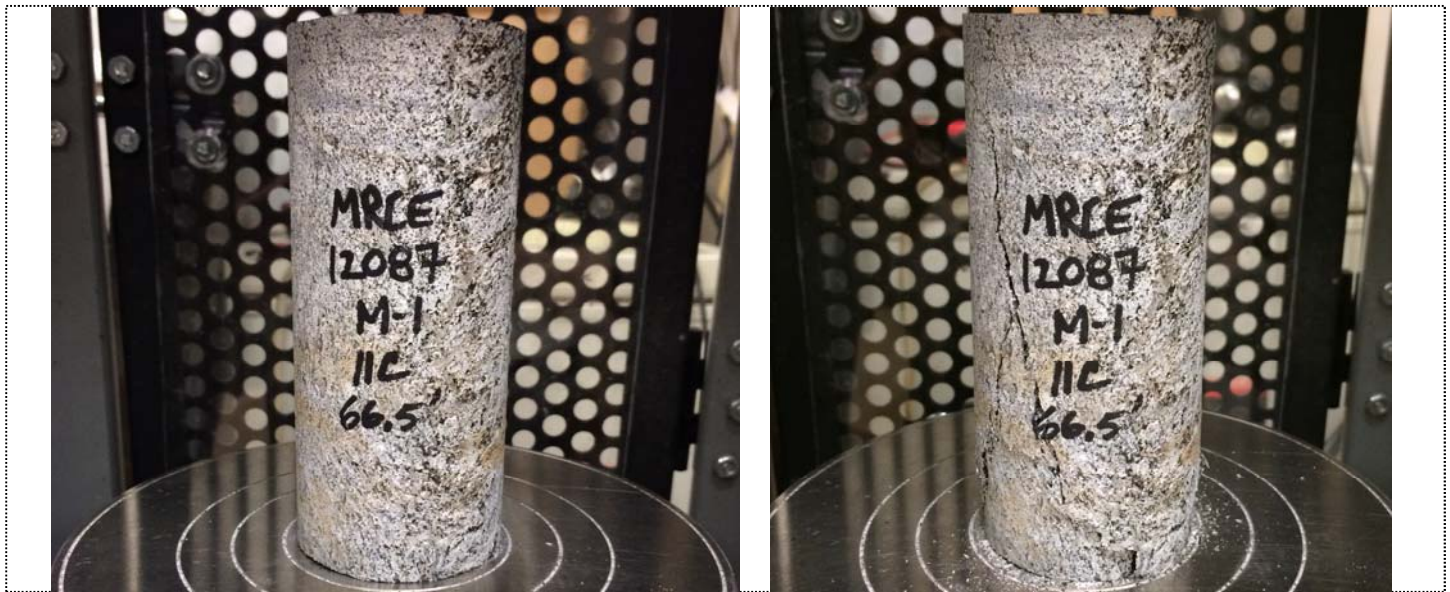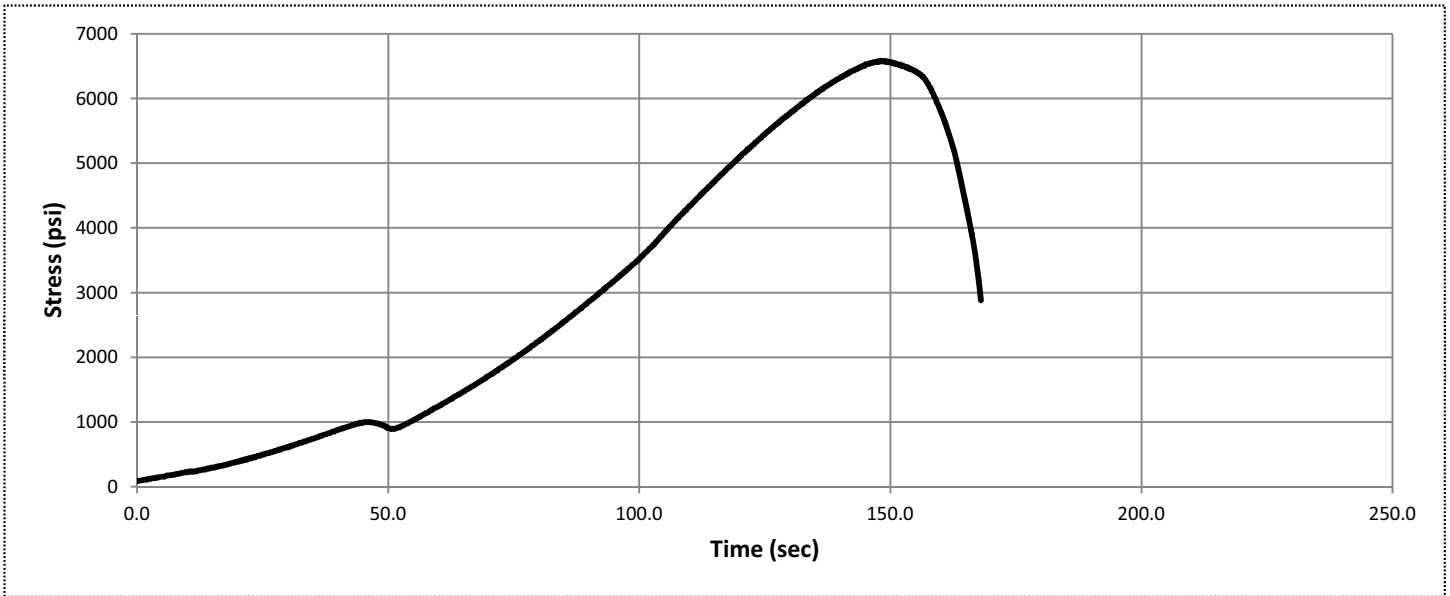

ALL TEST METHODS / RESULTS CONFORM TO ASTM STANDARD D 7012:
 "STANDARD TEST METHOD FOR COMPRESSIVE STRENGTH AND ELASTIC MODULI OF INTACT ROCK CORE
 SPECIMENS UNDER VARYING STATES OF STRESS AND TEMPERATURES."

APPENDIX C

Geotechnical Engineering Study

for

**105 West 57th Street
New York, New York**

Prepared For:

**JDS Development Group
5 East 17th Street, 2nd Floor
New York, New York 10003**

Prepared By:

**Langan Engineering & Environmental Services, Inc., P.C.
21 Penn Plaza
360 West 31st Street, 8th Floor
New York, New York 10001**

**5 April 2012
170173001**



Geotechnical Engineering Study

for

**105 West 57th Street
New York, New York**

Prepared For:

**JDS Development Group
5 East 17th Street, 2nd Floor
New York, New York 10003**

Prepared By:

**Langan Engineering & Environmental Services, Inc., P.C.
21 Penn Plaza
360 West 31st Street, 8th Floor
New York, New York 10001**



Clayton Patterson, P.E.



Marc J. Gallagher, P.E., LEED AP

**5 April 2012
170173001**



INTRODUCTION	1
PROJECT DESCRIPTION	2
Site Description.....	2
Proposed Construction	2
SUBSURFACE INVESTIGATION.....	3
Review of Available Information.....	3
Subsurface Exploration	3
SUBSURFACE CONDITIONS	4
Bedrock [Class 1b].....	5
Groundwater	5
SEISMIC EVALUATION.....	5
Mapped Spectral Accelerations	5
Site Class	5
Design Spectral Response Accelerations and Seismic Design Category	6
Peak Ground Acceleration.....	6
Liquefaction Potential.....	6
FOUNDATION RECOMMENDATIONS	6
Foundation System.....	6
Deep Foundations	7
Shallow Foundations	9
Slab Support	9
Permanent Below-grade Walls.....	10
CONSTRUCTION RECOMMENDATIONS.....	10
Excavation	10
Underpinning	11
Monitoring of Adjacent Structures	12
Special Inspection	13
LIMITATIONS.....	13

FIGURES

Figure 1 – Site Location Plan

Figure 2 – Viele Map

Figure 3 – Bedrock Map

Figure 4 – Boring Location Plan

Figure 5 – Subsurface Profiles A-A' and B-B'

Figure 6 – Subsurface Profile C-C'

Figure 7 – Langan Standards

APPENDICES

Appendix A – Test Boring Logs

INTRODUCTION

We are pleased to submit this geotechnical engineering study for the proposed development located at 105 West 57th Street, New York, New York. The purpose of this study was to explore the subsurface conditions underlying the site and provide geotechnical design recommendations for foundations and other geotechnical aspects of design and construction. A summary of our exploration, findings, and recommendations are provided herein.

Recommendations have been prepared based on input and coordination with WSP Cantor Seinuk (Cantor, Project Structural Engineer) and Cetra/Ruddy, Inc. (Cetra/Ruddy, Project Architect).

Our geotechnical study included the following:

- 1) A review of available information including: geologic mapping, aerial photographs, topographic surveys, and subsurface information from previous investigations at nearby sites.
- 2) A field exploration which included three test borings completed in 2006 and three additional borings completed in 2012. The borings were performed in accordance with the requirements of the 2008 New York City Building Code (Building Code).
- 3) An evaluation of the interpreted subsurface conditions with respect to feasible foundation systems.
- 4) Preparation of this report documenting the subsurface conditions and providing geotechnical recommendations for design.

All elevations referred to in this report are with respect to the Borough President of Manhattan Datum (BPMD)¹.

All work was performed in general accordance with our proposal dated 19 August 2011.

¹ BPMD is 2.75 ft above the U.S. Coast and Geodetic Survey Datum mean sea level at Sandy Hook, New Jersey, 1929, (NGVD). BPMD=NGVD – 2.75 ft.

PROJECT DESCRIPTION

Site Description

The project site has a 43-foot frontage on the northern side of West 57th Street, between Avenue of the Americas and Seventh Avenue, with an estimated site footprint of about 4,300 sq. ft. The site is presently a vacant lot. There is an 18-story building and a 4-story building adjacent to the east, a 17-story building adjacent to the northeast, a 15-story building adjacent to the northwest and west, and West 57th Street to the south. The site location is shown as Figure 1.

The 18-story building to the east has basement and sub-basement levels at about el 42.6 and el 25.3, respectively. The 4-story building to the east has a single basement level at about el 45.1. The 15-story building to the northwest and west has basement and sub-basement levels at about el 47.6 and el 28.9, respectively. Both adjacent sub-basements levels are below the bedrock level at the site.

The building to the northwest and west (the Manhattan Life Building, 109 W 57th Street) is a landmark structure as designated by the New York City Landmark Preservation Commission (NYCLPC). Additionally, water tunnel No. 1 and NYCT subway tunnels currently lie beneath Sixth Avenue, about 100 feet to the east.

The site was formerly occupied by a four-story brick masonry building (the "Ritz Furs Building"). The building contained two basement levels extending to a depth of about 20 ft below existing grade. In addition, a vault is present below the sidewalk extending south roughly to the curb-line at West 57th Street. The vault is reportedly present at both the basement and sub-basement levels, but cannot currently be verified as the building was recently demolished and the basement levels were backfilled with soil and demolition debris.

Proposed Construction

The development plans have not been finalized; however, the current concept consists of a 40-story tower with one basement level. The estimated footprint of the building is about 4,300 square feet. A preliminary foundation layout has been developed by Cantor. The preliminary foundations consist of load bearing shear walls at the perimeter, and a structural core located near the center of the building. The service wall loads (live plus dead) provided by Cantor range from about 135 kips per linear foot (kpf) to 255 kpf. The uplift loads were provided as 360 kip point loads spaced evenly at about 6 to 8 feet along the east and west perimeter walls. The lateral loads included a total base shear of about 700 to 1700 kips for the design seismic and

wind events, respectively. Our geotechnical recommendations are based on the preliminary structural and architectural information provided by Cantor and Cetra/Ruddy.

SUBSURFACE INVESTIGATION

Review of Available Information

We reviewed available information including published geologic and topographic maps, aerial photography, and subsurface soils data obtained during previous investigations in the general vicinity of the project site.

According to the historic Viele map of Manhattan from 1865, a stream ran beneath Sixth Avenue in the vicinity of the site. The Viele map is shown as Figure 2.

The USGS "Bedrock and Engineering Geologic Maps of Bronx County and Parts of New York and Queens Counties, New York" indicates that the bedrock underlying the site consists of Manhattan Schist, part of the Hartland Formation. The bedrock elevations vary from about el. 40 ft to el. 60 ft (less than 20 ft below-grade) in the vicinity of the site, typically decreasing from west to east. The referenced bedrock geology map is shown as Figure 3.

The previous building appears to be founded directly on bedrock based on field observations from our subsurface exploration.

Subsurface Exploration

The geotechnical exploration included drilling six test borings. Three borings, designated as B-1 to B-3, were drilled between 2006, and an additional three borings, designated as B-4 to B-6, were drilled in 2012. The location of the borings is shown on the attached boring location plan, Figure 4. The borings were located in the field by our inspecting engineer by measuring from existing site features.

The test borings B-1, B-2, and B-3 were drilled on 4 and 5 May 2006 by Craig Test Boring, Inc. of Mays Landing, New Jersey. The test borings were advanced to depths of about 33 ft to 36 ft below existing grade using a CME-55 track-mounted drill rig.

The test borings B-4, B-5, and B-6 were drilled on 23 March 2012 by Warren George, Inc. of Jersey City, New Jersey. The test borings were advanced to depths of about 24 ft to 25 ft below existing grade using a Mobile B53 truck-mounted drill rig. The purpose of these borings was to confirm the top of rock elevation.

The borings were drilled using mud rotary drilling techniques with a tri-cone roller bit. A combination of drilling fluid and steel casing were used to stabilize the boreholes during drilling. Soil sampling was not performed within the demolition debris. Rock samples were cored in all of the borings using a Type NX Rock Core Barrel. Percent recovery (REC)² and Rock Quality Designation (RQD)³ values were measured based on the length and quality of the rock core retrieved from each core run.

All borings were performed under the full-time inspection of a Langan engineer.

Additional details are provided on the attached boring logs as Appendix A.

SUBSURFACE CONDITIONS

The general subsurface stratigraphy consists of a layer of miscellaneous fill material overlying the existing concrete sub-basement floor slab which in turn bears directly on bedrock. Based on our observations during drilling, the existing concrete slab may not be continuous within the site as two of the borings did not encounter concrete. Portions of the slab may have been removed or broken up during demolition. We estimate that the concrete sub-basement floor slab is about 12 to 18 inches thick. The following presents more information on each layer encountered.

Fill [Class 7]

The fill was encountered throughout the site and was recently placed within the former basement during demolition. This fill was placed within the basement levels during building demolition to provide temporary stabilization of the site. The borings were advanced through obstructions, fill material, and in some locations the former sub-basement concrete floor slab. The fill generally consists of coarse to fine sand and gravel with variable concentrations of wood, bricks, and concrete fragments. The fill likely contains large debris including former foundation elements, concrete slabs, etc.

The fill layer is classified as Building Code Class 7 – Uncontrolled Fill.

² The percent recovery is the ratio of the length of rock recovered over the total rock core length, expressed as a percentage.

³ The RQD is defined as the ratio of the summation of each rock piece greater than 4 inches over the total core length, expressed as a percentage.

Bedrock [Class 1c to 1b]

Bedrock was encountered immediately below the concrete floor slab, where present, and was cored 5 to 15 ft. The recovered rock cores were visually examined and classified in the field in accordance with the Building Code. Bedrock was encountered in each of the six borings performed. The bedrock generally consists of gray to black, slightly to moderately weathered, slightly to moderately fractured, medium to hard, micaceous schist.

Rock core recoveries ranged from 68% to 100%. Rock Quality Designation (RQD) values were determined from the recovered rock cores and vary from about 43% to 98%.

The bedrock generally classifies as Building Code Class 1c - Medium Rock to Class 1a - Very Hard Rock.

Subsurface profiles beneath the site are shown as Figures 5 and 6.

Groundwater

Groundwater elevations could not be determined at the completion of drilling due to the introduction of drilling fluids. However, we expect that groundwater will generally be located at or above the bedrock contact. Zones of perched water may also be present at higher elevations in areas containing soils adjacent to the site.

SEISMIC EVALUATION

This section presents the results of our seismic evaluation for the site relative to the provisions outlined in the Building Code. Then following subsections provide recommended parameters for use in the seismic design of the proposed structure.

Mapped Spectral Accelerations

Per Section 1615.1 of the Building Code, the mapped spectral accelerations for the short period S_s and 1-second period S_1 are 0.365g and 0.071g, respectively.

Site Class

The Building Code requires assignment of a Site Class in accordance with the procedures outlined in Section 1615.1.1. The Site Class is estimated based on the type, thickness, and engineering properties of all soils and bedrock to a depth of 100 feet below the ground surface. In accordance with FEMA 450 – NEHRP Recommended Provisions and Commentary for Seismic Regulations for New Buildings and Other Structures (2003), the site class should

reflect the soil conditions which affect the ground motion input to the structure. Therefore, because this site is founded on bedrock and will not be significantly influenced by the surrounding soils, the site class is based on the condition of the bedrock beneath the foundation. This site classifies as Site Class B – “Rock.”

Design Spectral Response Accelerations and Seismic Design Category

Design spectral accelerations were determined in accordance with Section 1615.1.3 of the Building Code. The design spectral acceleration at short period S_{DS} is 0.243g and 1-second period S_{D1} is 0.047g.

Based on the above design spectral accelerations and the assumed use group/occupancy category of the structure (Use Group II), the corresponding seismic design category is identified as SDC B, in accordance with Section 1616.3 of the Building Code.

The assumed structural occupancy category should be confirmed by the Architect and Structural Engineer.

Peak Ground Acceleration

The peak ground acceleration (PGA) for use in design is 0.097g (i.e. $S_{DS}/2.5$) as recommended in Section 1802.2.3 of the Building Code.

Liquefaction Potential

The Building Code requires an evaluation of the liquefaction potential of non-cohesive soils below the groundwater table and up to 50 feet below the ground surface. The building will bear directly on bedrock; therefore, liquefaction does not need to be considered for design.

FOUNDATION RECOMMENDATIONS

The following sections provide our geotechnical recommendations for foundation design and constructability issues.

Foundation System

The preliminary structural design transfers the majority of the loads to the perimeter shear walls along the east and west foundation walls. Therefore, we recommend a combination of both shallow and deep foundations for the proposed building. Specific recommendations for each foundation type (e.g. location, capacity, etc.) are discussed in detail in the following sections.

The building loads should be transferred below the adjacent building foundations to prevent any increase in load on the adjacent buildings.

Deep Foundations

The majority of the gravity, uplift, and lateral building loads will be transferred to the perimeter walls located adjacent to the existing buildings. We recommend using caissons socketed in rock to transfer the perimeter loads to the bedrock below the adjacent building foundations. Caissons are also capable of supporting the required uplift and lateral loads.

Caissons consist of an upper (cased) grouted portion encased in steel, and a lower (socket) portion grouted to bond with the rock. The casing will extend to about the foundation level of the adjacent building. The cased portion allows the loads to transfer directly to the socket, without adding load to the adjacent building. Caissons develop the majority of their capacity from the socket via friction between the rock and the grout. Typically the bearing capacity at the bottom of the caisson is neglected because relatively large deflections, compared to friction, are required to fully mobilize the bearing capacity.

Based on preliminary structural loads, we developed a preliminary caisson design capable of supporting about 1,600 kips in compression, 360 kips in tension, and 70 kips laterally. The following sections summarize the design requirements for the caissons. Table 1 includes a summary of a feasible caisson design for the loads described above.

Axial Capacity

Axial capacity of the caissons includes both compressive and tensile loads. The caisson should transfer the gravity loads below the adjacent buildings. To limit loads on the foundations and the rock mass beneath the adjacent buildings, the cased portion should extend a minimum of five (5) feet below the adjacent building foundations.

The total axial compression under the 1600-kip compressive load is estimated to be less than about ½ inch. The total elongation under the 360-kip tensile is estimated to be less than about ½ inch.

The caisson caps must be placed over a minimum 4-inch-thick rigid Styrofoam filler to prevent load transfer to the rock surface.

The preliminary caisson design is summarized in Table 1.

Table 1. Preliminary Caisson Design for Perimeter Foundation Walls

Preliminary Caisson Design: 24-inch, 1600 kips (Compression), 360 kips (Tension), 72 kips (Lateral)						
Casing Diameter (in)	Wall Thickness (in)	Casing Yield Stress (ksi)	Reinforcing Bars	Bar Yield Stress (ksi)	Grout Compressive Strength (ksi)	Min. Required Rock Socket Length (ft)
24	0.75	45	8 - #20	75	8	16

Lateral capacity

The governing lateral loads for the foundation elements are a result of wind loads. The caissons must be designed to prevent overstressing the caisson and the rock (particularly next to adjacent buildings). During the design wind loading, the structure will distribute the lateral loads to certain areas of the foundation. As the top of the caissons are loaded, the load is transferred to the rock mass. To limit loading the rock mass adjacent to the existing buildings, the socket should be drilled at a larger diameter than the casing to provide an annulus of about 1-inch around the casing. This annulus will allow the caisson to deflect laterally up to ½ inch without loading the rock mass. The annulus must be sealed at the top of the rock surface prior to backfilling to prevent intrusion of surficial debris and construction materials.

Because of the relatively high lateral loads estimated at the top of the caissons, the caissons should be designed for a “fixed-head” condition (zero rotation during loading at the top of the caisson). Table 2 provides the results of our lateral load analysis for the base shear associated with the design wind event. These results are based on the assumption that a “fixed-head” condition is imposed and that the caisson shaft provides a 1-inch annulus in the top 15 ft of bedrock.

Table 2. Preliminary Lateral Capacity Analysis of 24-inch Caisson

Lateral Capacity Results: 24-inch, 1600 kips (Compression), 360 kips (Tension), 72 kips (Lateral)						
Fixity	Shear Force at Pile Head (kips)	Displacement at Pile Head (in)	Maximum Bending Moment (kip-ft)	Maximum Shear (kips)	Depth to Maximum Bending Moment (ft)	Depth to Maximum Shear (ft)
100%	72	< 0.5	790	82.0	0.0	19.0

Shallow Foundations

The proposed foundation layout includes several interior columns and a structural core at the center of the building. These areas can be supported by spread footings and grade beams bearing on Building Code Class 1b bedrock. Footings should be limited to areas greater than 10 feet from the adjacent buildings to prevent loading the existing foundations. Shallow foundations (e.g. spread footings, grade beams, etc.) should be sized for an allowable bearing capacity of 40 tons per square foot (tsf). Additionally, we recommend embedding all interior shallow foundations a minimum of two (2) feet into Building Code Class 1b Rock or better.

Slab Support

We reviewed two options for the basement slab: (1) a structural pressure slab above a drainage layer bearing directly on bedrock, and (2) a concrete slab on grade with an underdrain system. Based on our review, we recommend the use of a structural pressure slab bearing on a minimum 6-inch gravel layer above Building Code Class 1b bedrock or better.

The structural slab should be designed to resist a design groundwater level at el 42.5 (about five (5) feet above the bedrock elevation). Additionally, the structural slab should provide a rigid connection to the foundation walls to provide additional foundation support.

Permanent Groundwater Control

The foundation should be waterproofed using a continuous membrane such as those manufactured by Grace Construction Products (Preprufe, Bituthene, etc.). The use of bentonite waterproofing or negative side crystalline waterproofing is not recommended. Waterproofing should also be installed along all foundation walls up to sidewalk grades along the perimeter of the buildings.

For all waterproofing applications, diligent inspection of waterproofing materials is critical, especially during placement of reinforcement for the floor slabs and foundation walls. Holes or rips should be repaired in accordance with the manufacturer's recommendations. The vertical waterproofing should be protected with a rigid barrier or drainage composite to prevent damage during backfilling operations. Horizontal waterproofing for below-grade floors, pile caps, etc. can be installed on a lean concrete mud mat or compacted crushed stone.

We recommend that a warrantee be obtained from the manufacturer and installer to cover materials and workmanship; only certified installers should be used to perform the work. Detailed daily inspections should be performed to document any damage resulting from the contractor's activities. Repairs should be made as soon as possible and should be made per the manufacturer's recommendations.

Permanent Below-grade Walls

Permanent below-grade walls should be designed to resist static earth pressures, surcharge loads, and hydrostatic pressures. Additional recommendations on support of below-grade walls may be required by the structural engineer.

Static Earth Pressures

Lateral pressures from earth, surcharge loads, and hydrostatic pressures should be considered. The recommended design lateral earth-pressure diagram has a triangular distribution using an equivalent fluid weight of 55 psf per foot of depth of soil. We recommend that a vertical surcharge load of 600 psf be considered for all below-grade perimeter walls. Lateral pressures from surcharge should have a uniform distribution based on a pressure equal to 50 percent of the vertical pressure acting against the full height of the wall. Hydrostatic pressures should be considered below the design groundwater elevation (el 42.5).

Dynamic Earth Pressures

In accordance with Section 1802.2 of the Building Code, dynamic earth pressures need not be considered in design for structures assigned to SDC B.

CONSTRUCTION ISSUES AND RECOMMENDATIONS

The following sections discuss typical geotechnical related construction issues including excavation, excavation support, and underpinning.

Excavation

Construction of the proposed below-grade levels will require about 20 ft to 25 ft of excavation through the demolition debris and removal of the previous slab to reach bedrock. Large obstructions and demolition debris should be anticipated. Site excavation within the fill can likely be performed using conventional earth-moving equipment (e.g. backhoes, excavators, etc.). However, large debris and former foundation elements may require heavier excavation equipment.

Excavation in rock may be required to achieve satisfactory bearing conditions. Excavation of rock will likely require rock excavation equipment (e.g. chipping guns, hammers, etc.). Rock blasting is not recommended at this site.

All excavation operations should be performed in accordance with the Occupational Safety and Health Administration (OSHA) requirements, including but not limited to, use of temporary shoring, trench boxes, and proper benching.

Rock Subgrade Preparation and Protection

Subgrades for pressure slabs, bearing walls, and spread footings should be prepared by removing materials loosened by machine excavation and cleaning rock of all soil and material not satisfying the bearing capacity criteria. Subgrade preparation should be performed under the observation and direction of the geotechnical engineer. Subgrades should be protected until concrete is cast. Remedial work should be performed as directed by the geotechnical engineer.

The caisson caps must be placed over a minimum 4-inch-thick rigid Styrofoam filler to prevent load transfer to the rock surface.

Subgrade preparation is subject to special inspection by a Professional Engineer licensed in the State of New York in accordance with the Building Code requirements.

Excavation Support

We anticipate that earth support will be required at the south side of the site in the event that the existing vault is to be removed or replaced. The existing vault and/or foundation walls may be suitable for temporary earth support where required. The applicability of using the existing walls and the necessity for internal shoring and bracing should be determined by the Contractor's Engineer prior to construction.

All excavation support systems should be designed by a Professional Engineer licensed in the State of New York

Fill Materials, Placement, and Compaction

Structural Fill is defined as any compacted fill placed for the support of a structure such as footings, slabs, walls, or pavements. We do not recommend using the existing demolition debris as fill.

Structural fill placed as backfill behind walls should consist of a well-graded durable granular material having no more than 10 percent fines passing the No. 200 sieve. All fill materials should be free of trash, debris, roots, vegetation, peat, or other deleterious materials, have a particle size no greater than 4-inches, and should be approved by the Geotechnical Engineer prior to placement. Lean concrete or controlled low strength material (CLSM) are

considered a suitable substitution for structural fill. Free draining gravel or crushed stone for use below floor slabs and for foundation drainage should conform to the requirements of AASHTO #57, or equivalent.

Grain size distributions, maximum dry density and optimum water content determinations should be made on representative samples of proposed structural fill materials prior to construction activities to determine suitability for use as structural fill.

Fill should be placed in uniform loose lifts not exceeding 8-inches in open areas and 4-inches in confined areas. All fill should be compacted to at least 92% of its maximum dry density as determined by ASTM D1557. Compaction within 5-ft of foundation walls should be performed using hand operated equipment. The water content at the time of compaction should be within a two percent of the optimum value determined by ASTM D 1557.

No fill should be placed on areas where free water is standing, on frozen subsoil areas, or on surfaces which have not been approved by the project engineer. Fill materials and compacted fill should be protected from the effects of frost, freezing, construction traffic, groundwater and surface water runoff. Care should be taken to protect the foundations, walls and waterproofing during placement and compaction of fill.

Backfill operations are subject to controlled inspection by a Professional Engineer licensed in the State of New York in accordance with the Building Code requirements.

Underpinning

Underpinning may be required along the northeast corner of the site if the adjacent 4-story structure's foundation level is higher than the proposed foundations. The purpose of underpinning is to transfer the foundation loads of the adjacent structure to at least the subgrade level of the proposed development or bedrock, whichever is deeper. Underpinning piers should bear on Building Code Class 1b rock or better. Undermining of any structure adjacent to the proposed excavation must be avoided.

Underpinning design must be performed by the Contractor's Professional Engineer licensed in the State of New York.

Monitoring of Adjacent Structures

Landmark structures, as designated by the New York City Landmark Preservation Commission (NYCLPC), must be monitored in accordance with Technical Policies and Procedure Notice

(TPPN) 10/88. Monitoring requirements include optical survey monitoring, vibration monitoring, and crack monitoring via crack gages within the building.

We recommend that a preconstruction conditions documentation of the neighboring buildings be performed prior to construction. The purpose of a preconstruction conditions documentation is to document the conditions of the neighboring structures prior to construction. These documents can be effective in mitigating damage claims arising from construction activities. On the basis of this survey, an observational and instrumentation program should be designed for monitoring the performance of adjacent structures and evaluating construction procedures.

Additionally, NYCT subway tunnels currently lie beneath Sixth Avenue, less than 200 feet to the east. All foundation plans should be submitted to the NYCT for approval prior to construction. Additional monitoring requirements may be required by NYCT.

Special Inspection

Excavations and foundation construction are subject to various controlled engineering inspections as per the Building Code. Construction activities that require quality control inspections include excavation, sheeting and shoring, underpinning, waterproofing, backfilling and compaction, and foundation bearing surfaces.


LIMITATIONS

The conclusions and recommendations given in this report are based on subsurface conditions inferred from a limited number of test borings, information provided to us, and a generic building layout. Additional investigation and analyses are warranted prior to final design. Environmental aspects of the project have not been considered in this study and will be addressed under separate cover as a Phase 1 Environmental Assessment.

This report has been prepared to assist the Owner in the evaluation of the site. It is intended for use with regard to the given information and any changes in structures or locations should be brought to our attention so that we may determine how such changes may affect our recommendations.


This report has been prepared expressly for the proposed redevelopment of 105 West 57th Street in Manhattan, New York. Langan cannot assume responsibility for its use at any other site.

FIGURES

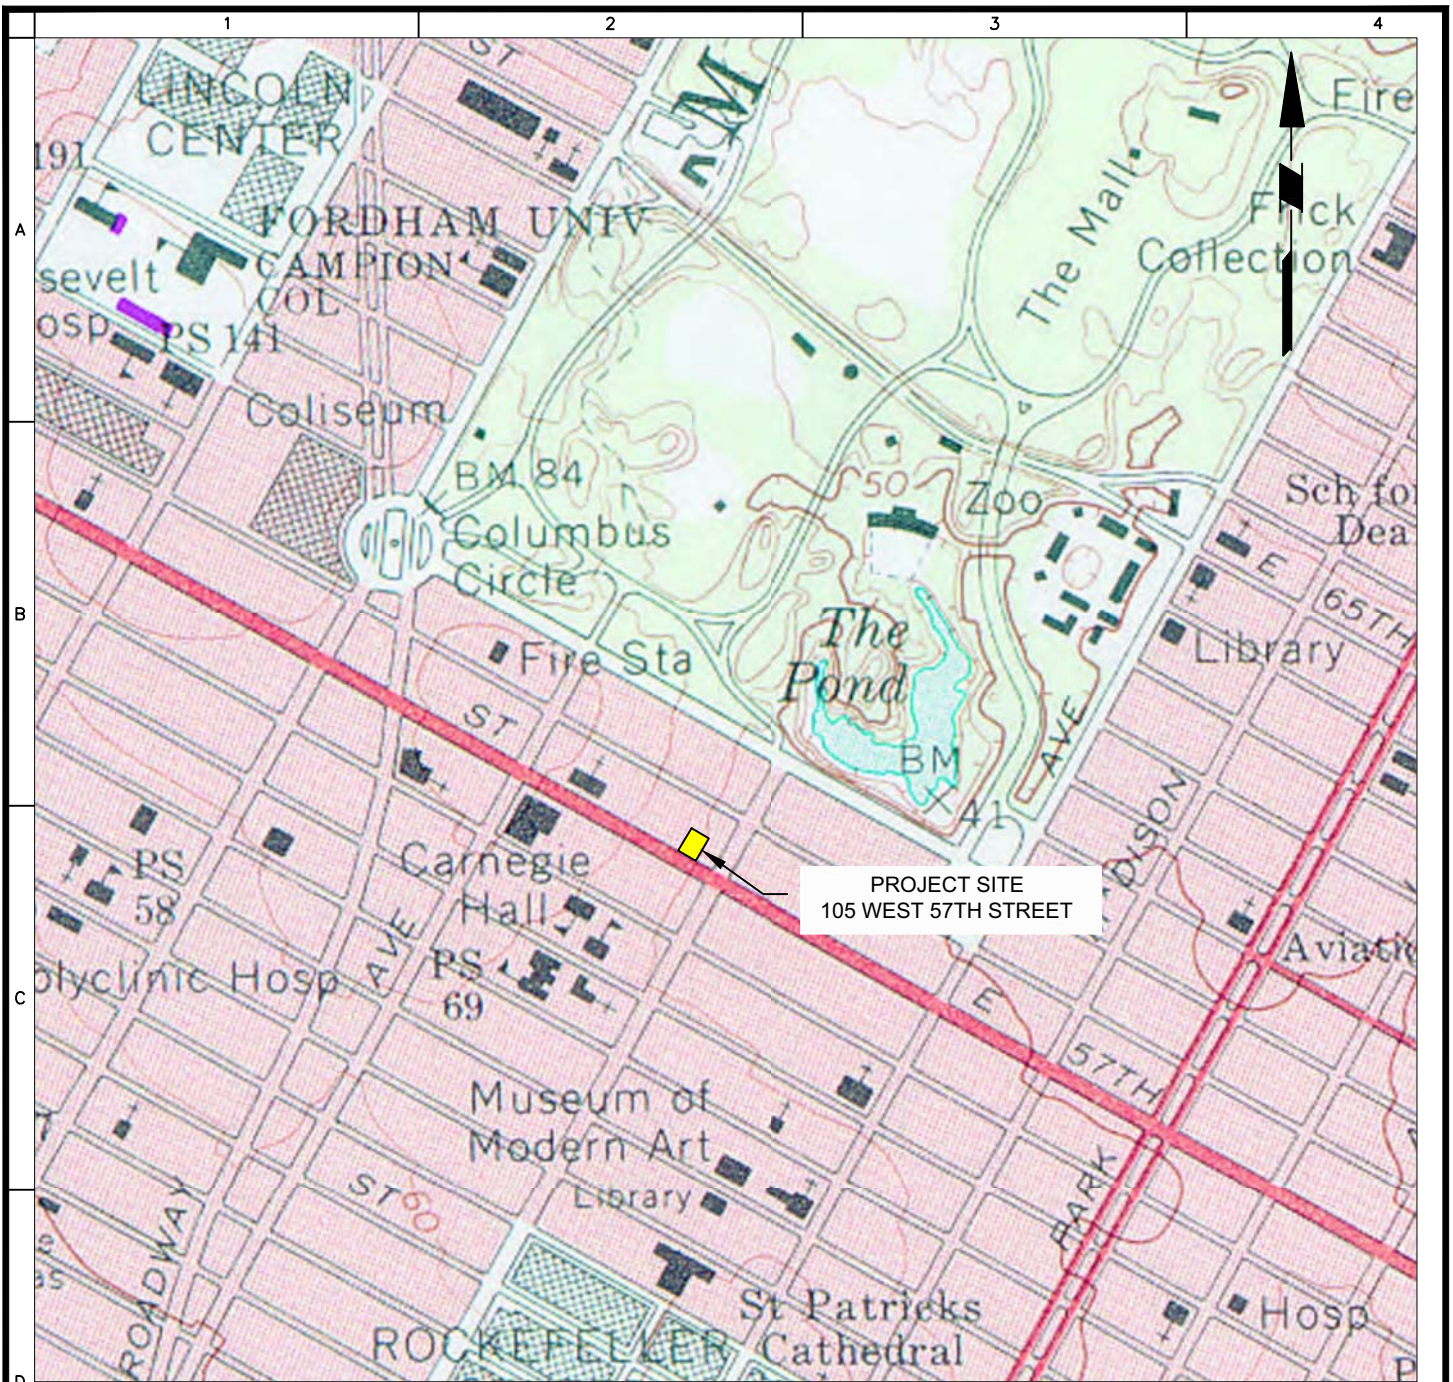

REFERENCE: USGS QUADRANGLE MAP, CENTRAL PARK QUADRANGLE (1966, REV. 1979)

 21 Penn Plaza 360 West 31st Street, 8th Floor New York, NY 10001-2727 P: 212.479.5400 F: 212.479.5444 www.langan.com NEW JERSEY PENNSYLVANIA NEW YORK CONNECTICUT FLORIDA VIRGINIA CALIFORNIA ABU DHABI DUBAI ATHENS DOHA ISTANBUL	Project	Drawing Title	Project No.	Drawing No.
	105 WEST 57TH STREET SITE LOCATION PLAN MANHATTAN NY	170173001 04/05/2012 NTS SKM 04/05/2012	1 Sheet 1 of 7	
				Scale
				Drawn By
				Submission Date

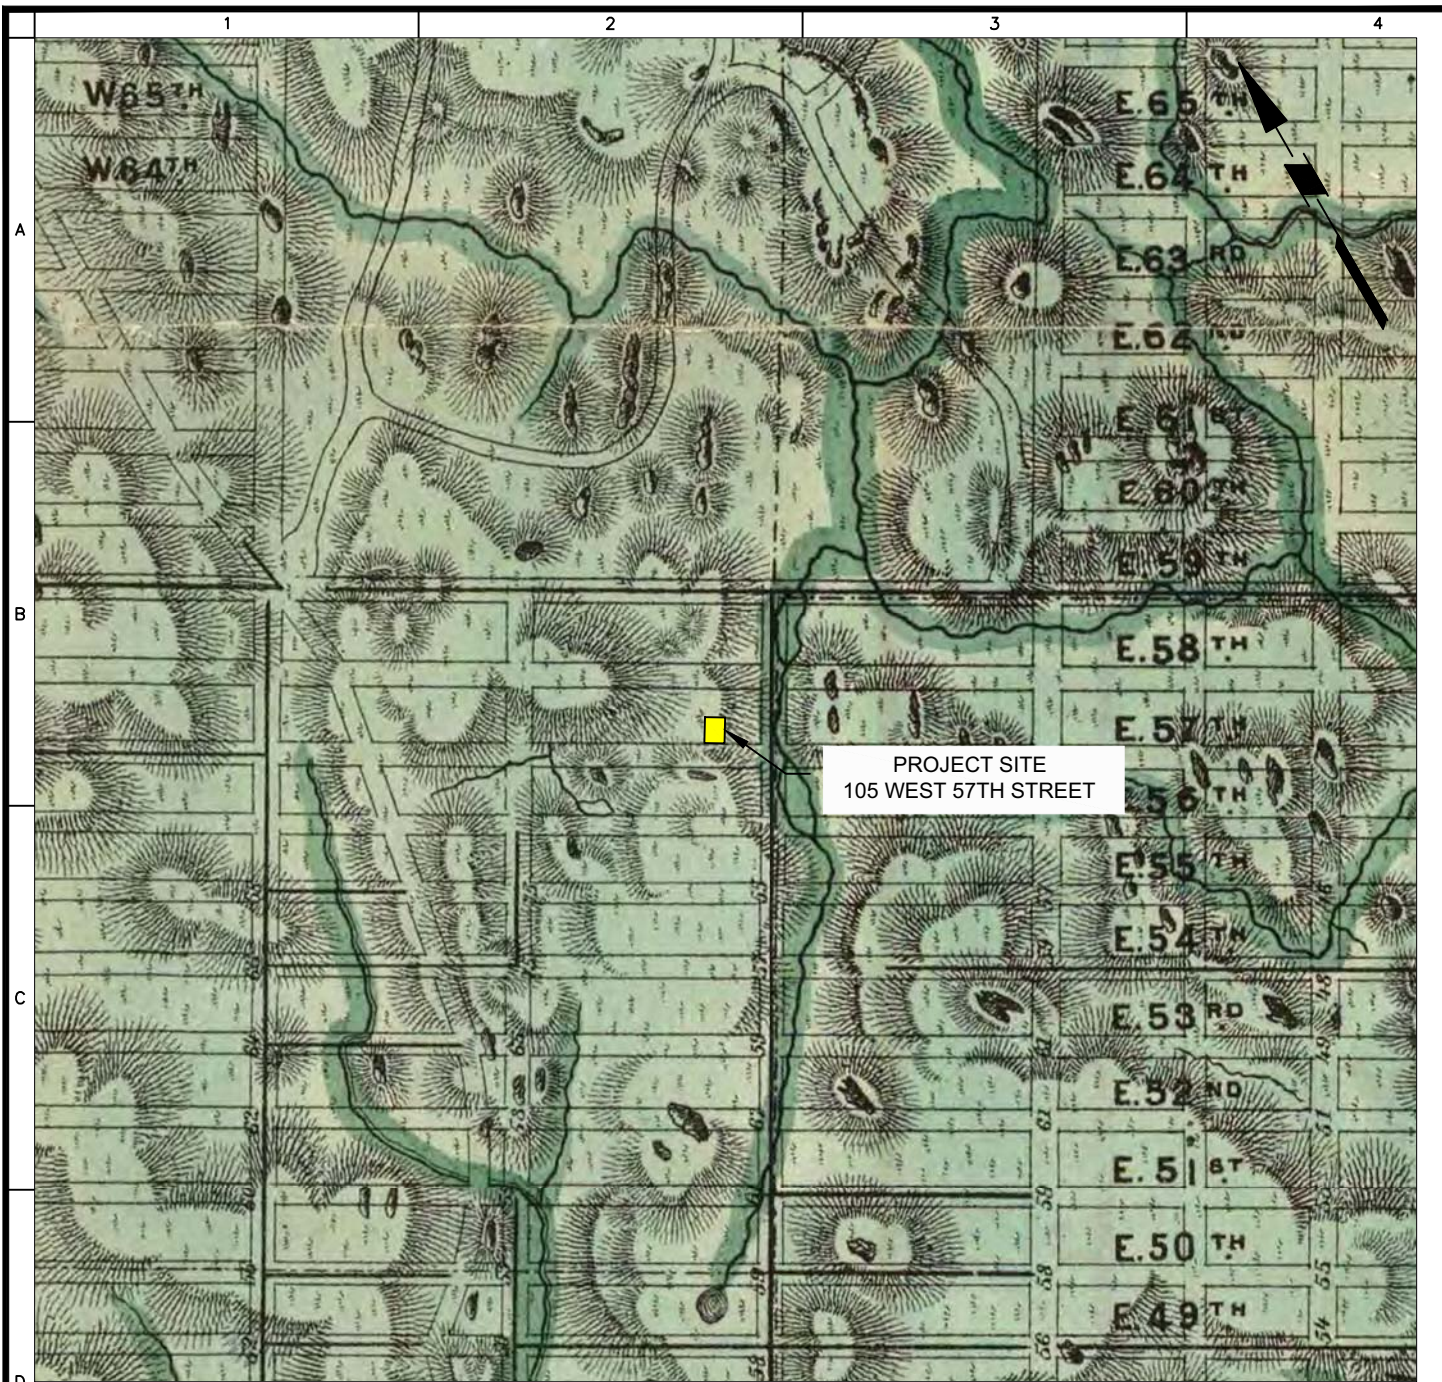


PROJECT SITE
105 WEST 57TH STREET

REFERENCE: PORTION OF SANITARY AND TOPOGRAPHY MAP OF THE CITY AND ISLAND OF NEW YORK, DATED 1865, BY EGBERT L. VIELE.

<p>LANGAN ENGINEERING & ENVIRONMENTAL SERVICES 21 Penn Plaza 360 West 31st Street, 8th Floor New York, NY 10001-2727 P: 212.479.5400 F: 212.479.5444 www.langan.com</p> <p>NEW JERSEY PENNSYLVANIA NEW YORK CONNECTICUT FLORIDA VIRGINIA CALIFORNIA ABU DHABI DUBAI ATHENS DOHA ISTANBUL</p>	Project	Drawing Title	Project No. 170173001	Drawing No.
	<p>105 WEST 57TH STREET</p> <p>MANHATTAN NY</p>	<p>VIELE MAP</p>	Date 04/05/2012	<p>2</p>
			Scale NTS	
			Drawn By SKM	
			Submission Date 04/05/2012	


© 2011 Langan Engineering and Environmental Services Inc., P.C.

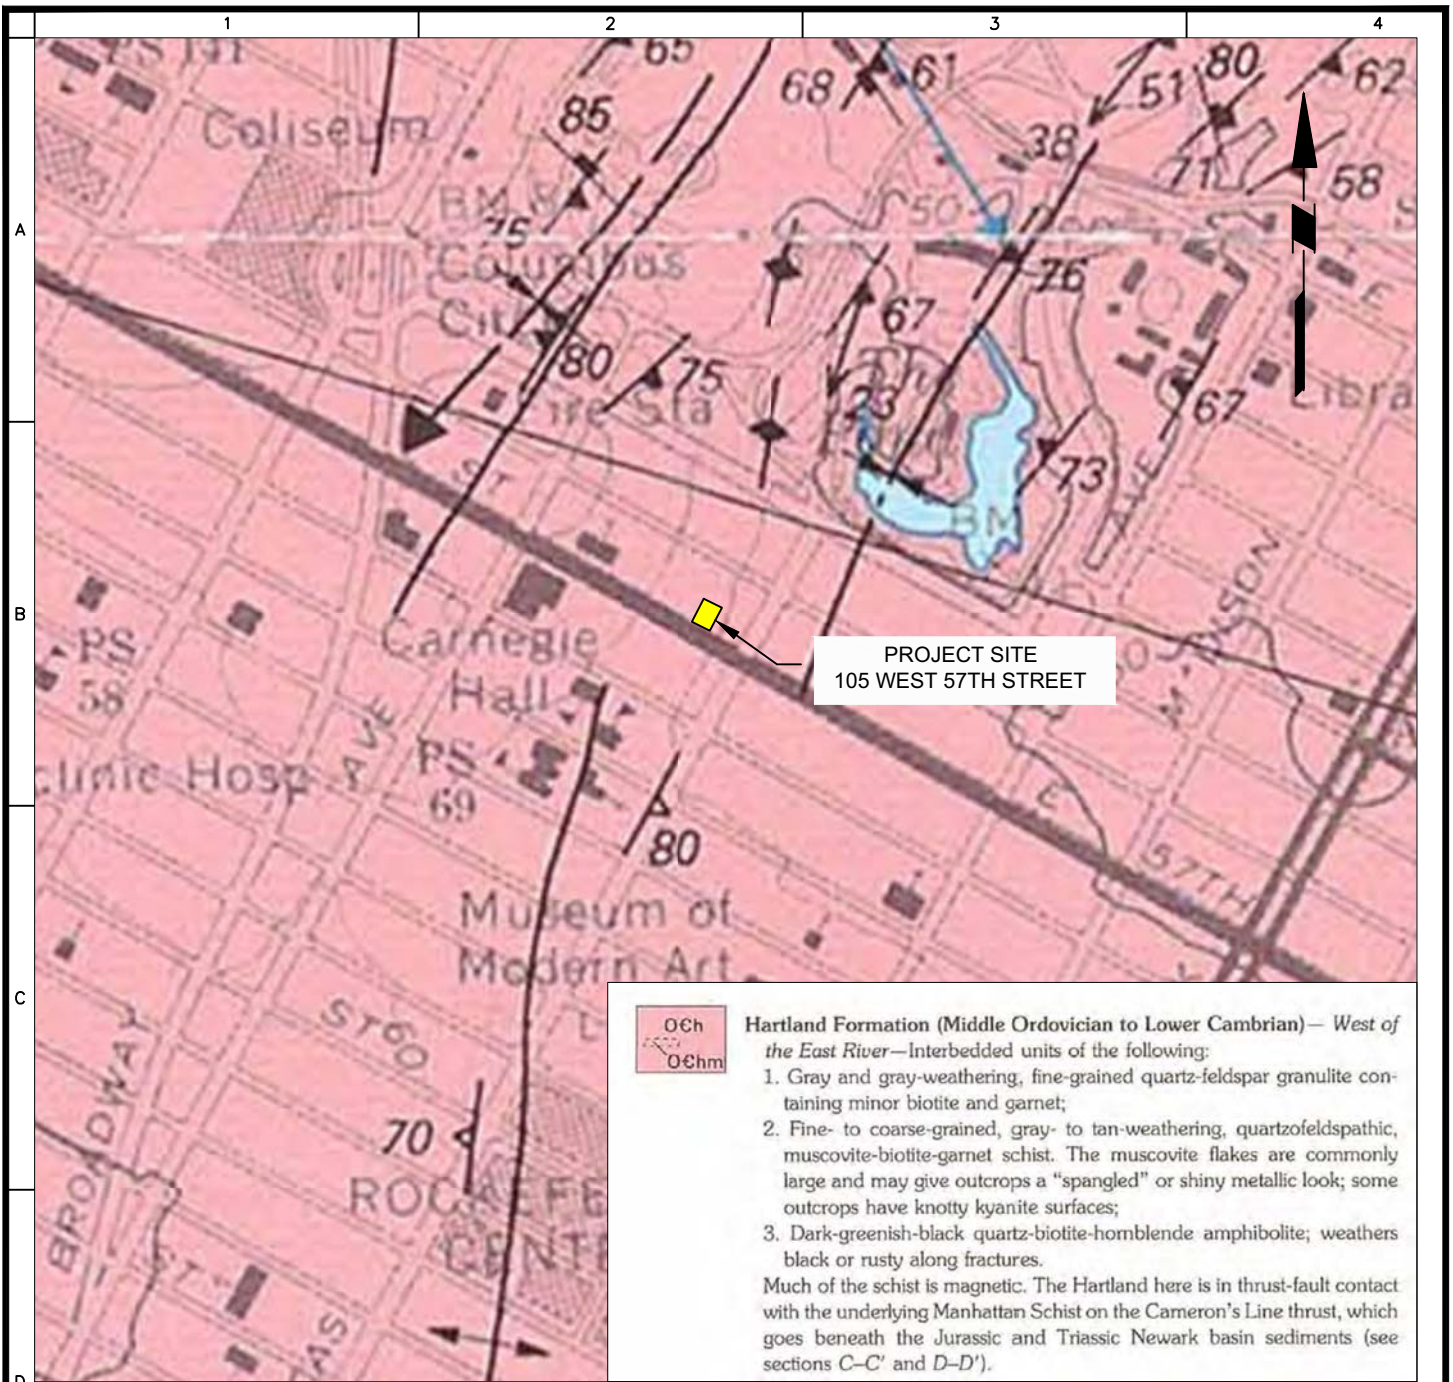

REFERENCE: BEDROCK AND ENGINEERING GEOLOGIC MAPS OF NEW YORK COUNTY AND PARTS OF KINGS AND QUEENS COUNTIES, NEW YORK, AND PARTS OF BERGEN AND HUDSON COUNTIES, NEW JERSEY (1994).

<p>LANGAN ENGINEERING & ENVIRONMENTAL SERVICES</p> <p>21 Penn Plaza 360 West 31st Street, 8th Floor New York, NY 10001-2727 P: 212.479.5400 F: 212.479.5444 www.langan.com</p> <p>NEW JERSEY PENNSYLVANIA NEW YORK CONNECTICUT FLORIDA VIRGINIA CALIFORNIA ABU DHABI DUBAI ATHENS DOHA ISTANBUL</p>	Project	Drawing Title	Project No. 170173001	Drawing No. 3
	105 WEST 57TH STREET MANHATTAN NY	BEDROCK MAP	Date 04/05/2012	
			Scale NTS	
			Drawn By SKM	
				Submission Date 04/05/2012

© 2011 Langan Engineering and Environmental Services Inc., P.C.

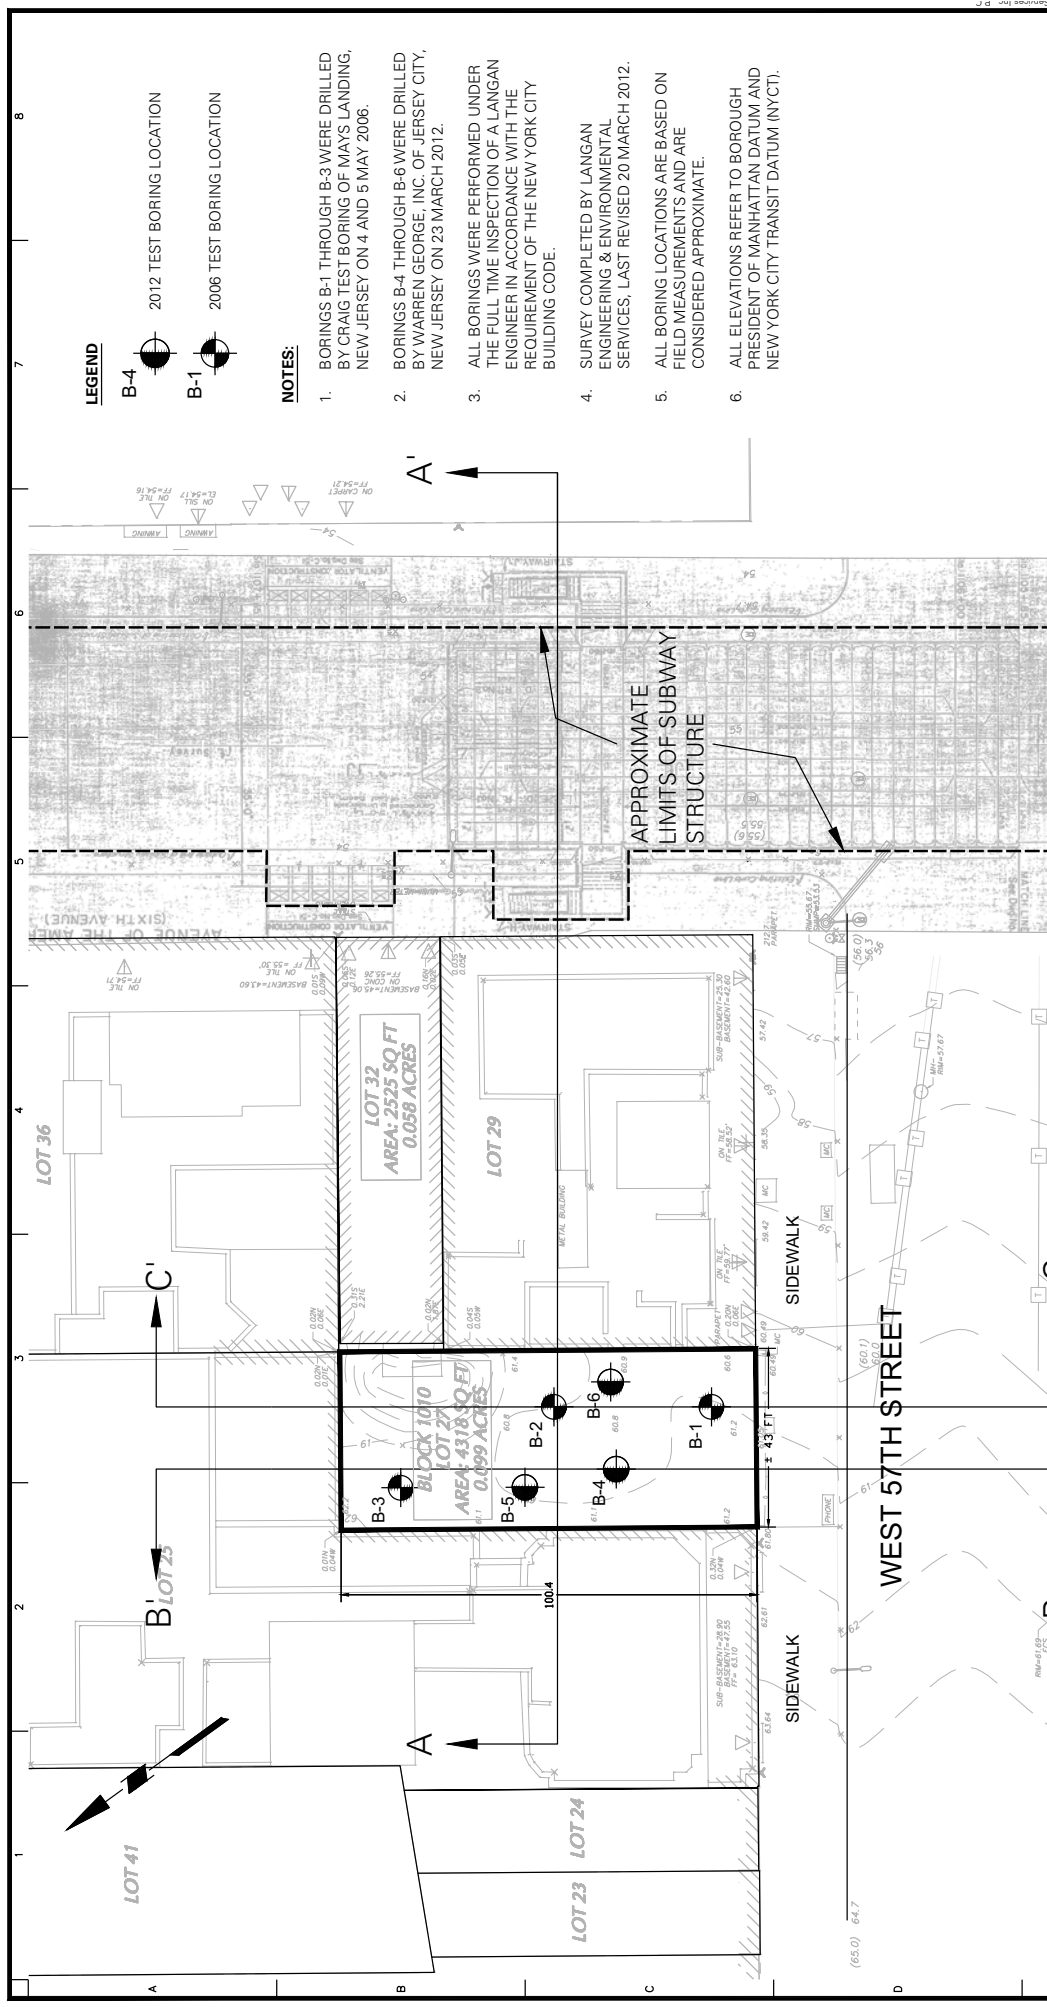


LEGEND


B-4 2012 TEST BORING LOCATION


B-1 2006 TEST BORING LOCATION

- NOTES:**
- BORINGS B-1 THROUGH B-3 WERE DRILLED BY CRAIG TEST BORING OF MAYS LANDING, NEW JERSEY ON 4 AND 5 MAY 2006.
 - BORINGS B-4 THROUGH B-6 WERE DRILLED BY WARREN GEORGE, INC. OF JERSEY CITY, NEW JERSEY ON 23 MARCH 2012.
 - ALL BORINGS WERE PERFORMED UNDER THE FULL TIME INSPECTION OF A LANGAN ENGINEER IN ACCORDANCE WITH THE REQUIREMENT OF THE NEW YORK CITY BUILDING CODE.
 - SURVEY COMPLETED BY LANGAN ENGINEERING & ENVIRONMENTAL SERVICES, LAST REVISED 20 MARCH 2012.
 - ALL BORING LOCATIONS ARE BASED ON FIELD MEASUREMENTS AND ARE CONSIDERED APPROXIMATE.
 - ALL ELEVATIONS REFER TO BOROUGH PRESIDENT OF MANHATTAN DATUM AND NEW YORK CITY TRANSIT DATUM (NYCT).

<p>LANGAN</p> <p>ENGINEERING & ENVIRONMENTAL SERVICES</p> <p>311 West 31st Street, 8th Floor New York, NY 10001-2727 P: 212.479.5400 F: 212.479.5444</p> <p>WWW.LANGAN.COM</p> <p>NEW JERSEY FLORIDA VIRGINIA CALIFORNIA CONNECTICUT ARLUND DENVER ATLANTA DALLAS INDIANAPOLIS</p>	<p>Project</p> <p>105 WEST 57TH STREET</p> <p>MANHATTAN NY</p>	<p>Drawing Title</p> <p>BORING LOCATION PLAN</p>	<p>Project No.</p> <p>170173001</p>	<p>Drawing No.</p> <p>4</p>	
	<p>Date</p> <p>04/05/2012</p>	<p>Scale</p> <p>1" = 30'</p>	<p>Drawn By</p> <p>SKM</p>	<p>Submission Date</p> <p>04/05/2012</p>	
	<p>File Name:</p> <p>\\langan.com\data\NY\170173001\Cadd Data - 170173001.dwg</p>	<p>Geotech Report Figures</p> <p>Figure 5 - BLP.dwg</p>	<p>User:</p> <p>smartin</p>	<p>Time:</p> <p>14:39</p>	<p>Layout:</p> <p>FIGURE 4 - BLP</p>
	<p>Sheet</p> <p>4 of 7</p>				



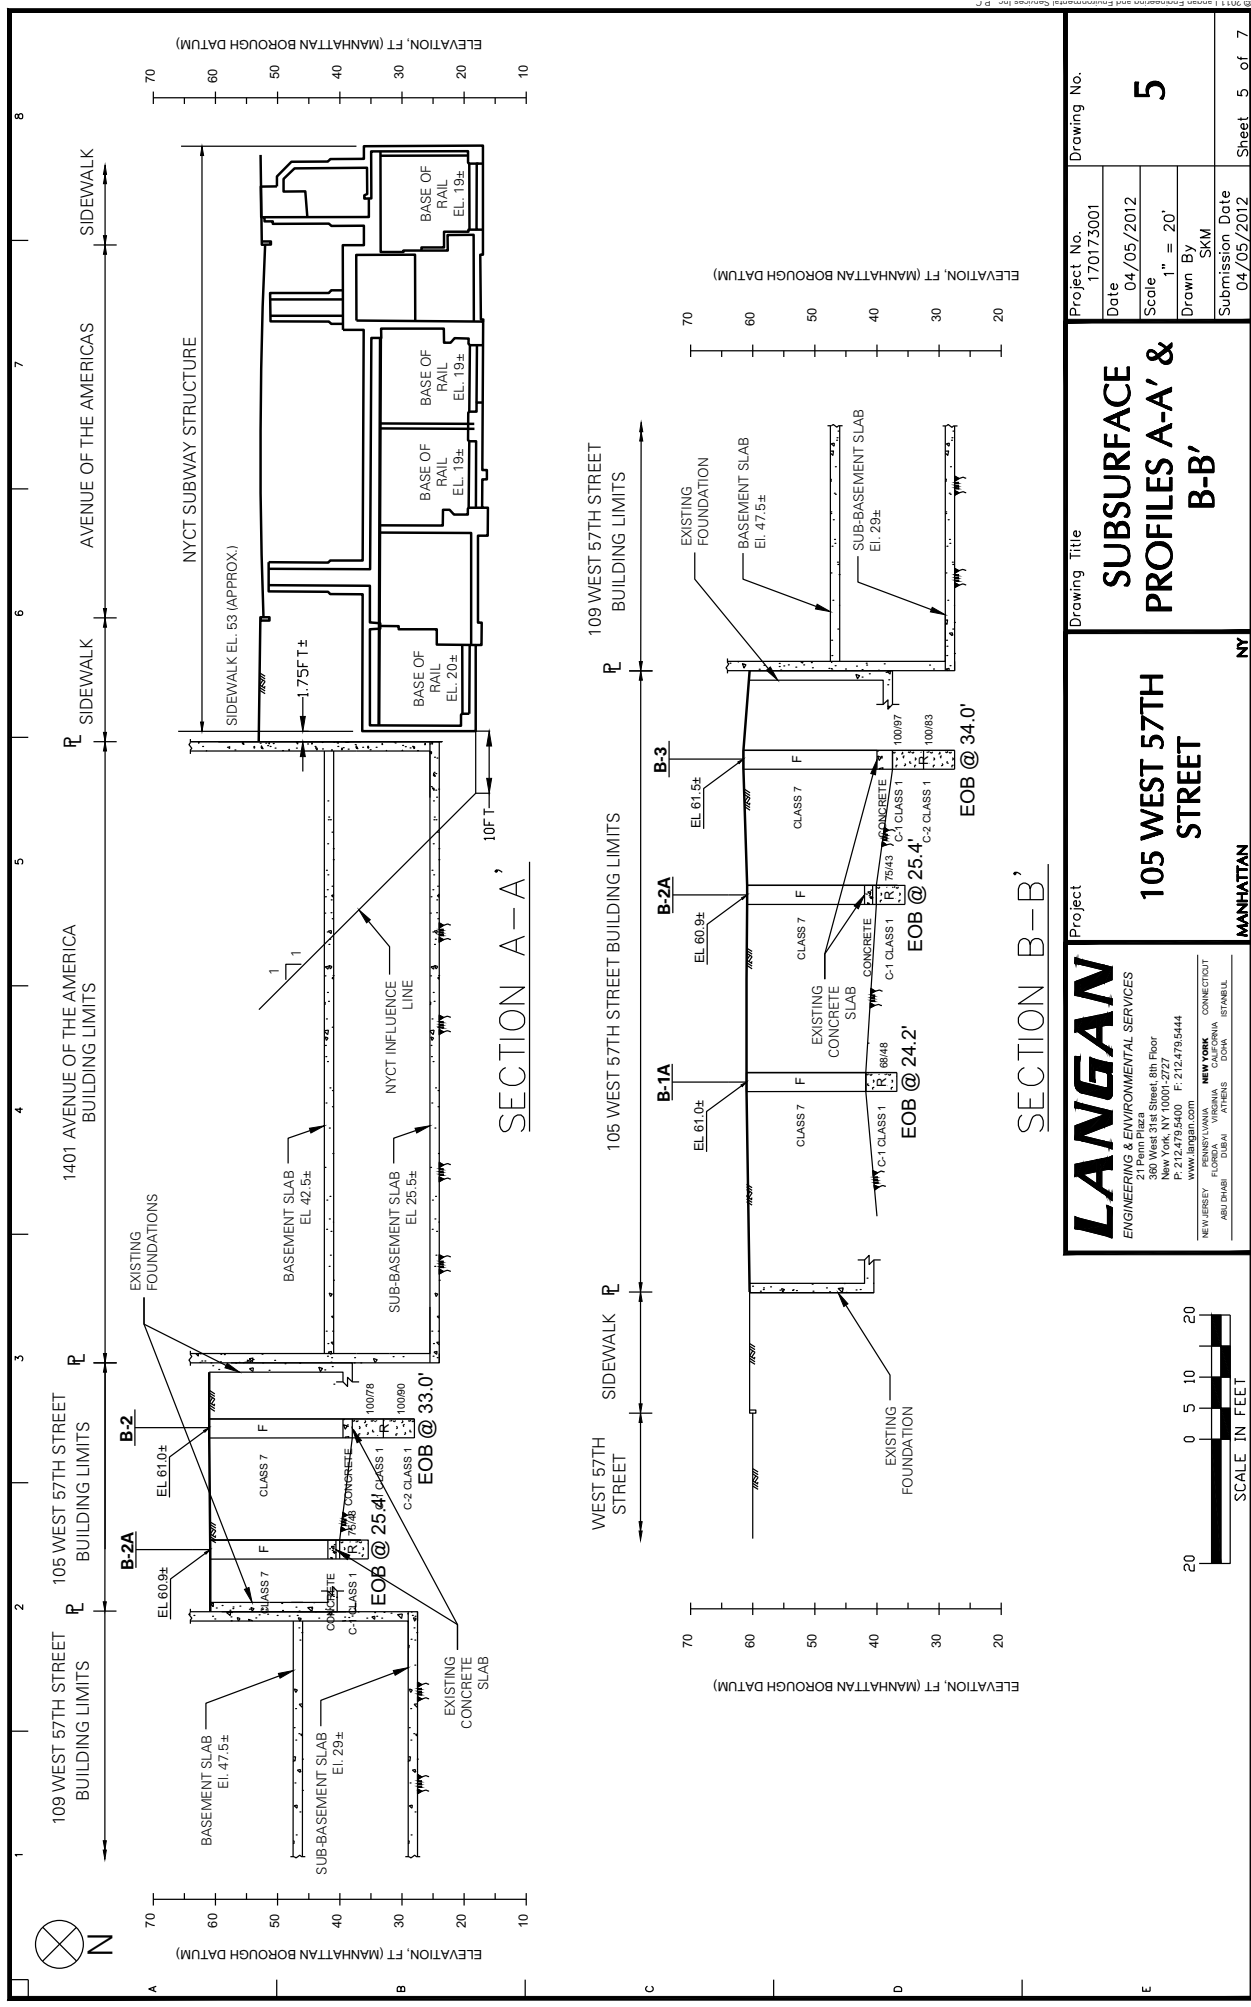

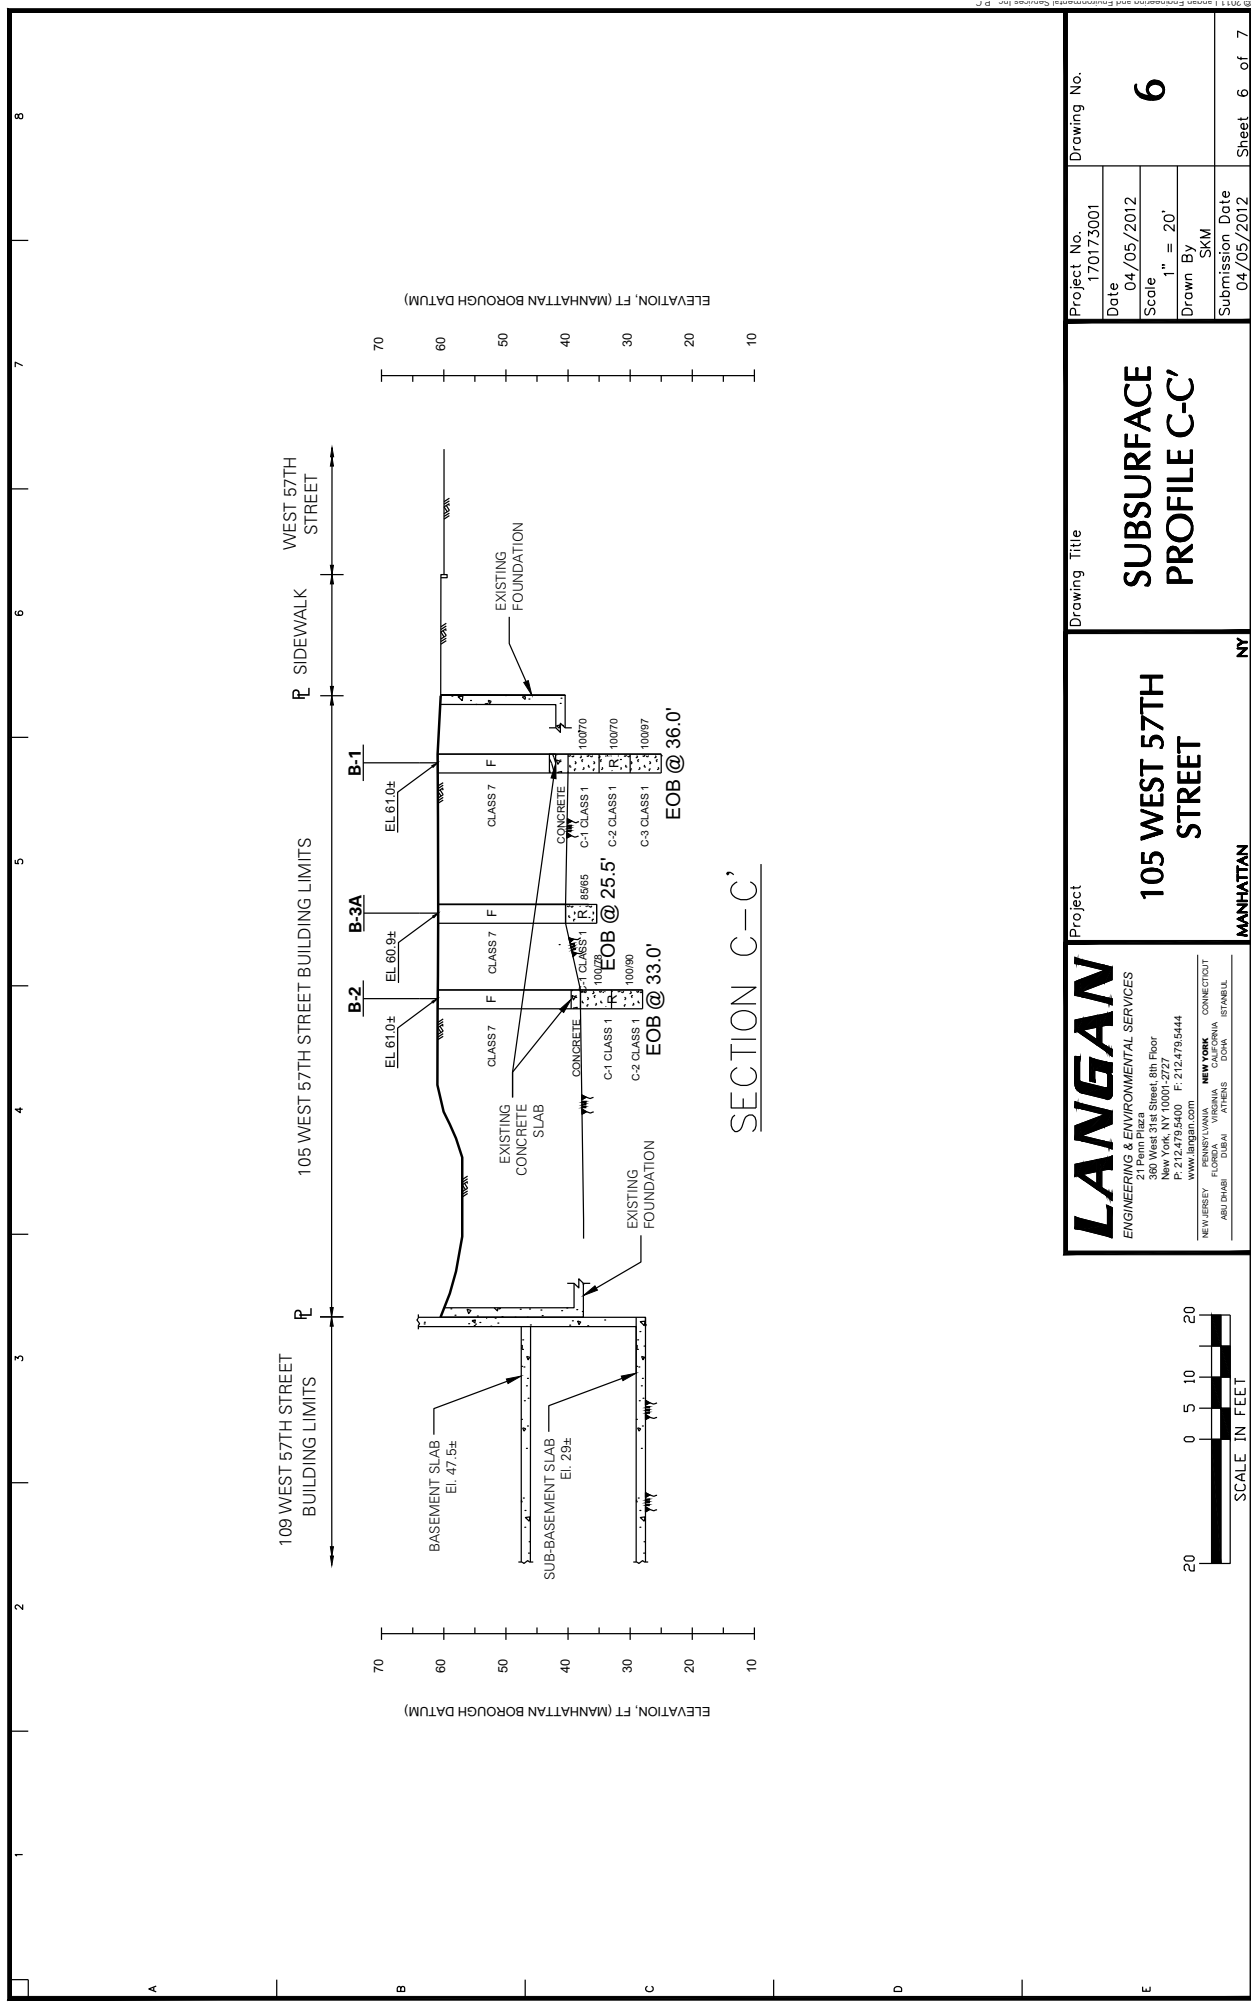

LANGAN
ENGINEERING & ENVIRONMENTAL SERVICES
211 E. 9th Street, 8th Floor
New York, NY 10001-2727
P: 212.479.5400 F: 212.479.5444
WWW.LANGAN.COM

NEW JERSEY FLORIDA VIRGINIA CALIFORNIA CONNECTICUT
ARIZONA ILLINOIS TEXAS NORTH CAROLINA


Project
105 WEST 57TH STREET
MANHATTAN NY

Drawing Title
SUBSURFACE PROFILE C-C'

Project No.	170173001	Drawing No.	6
Date	04/05/2012		
Scale	1" = 20'		
Drawn By	SKM		
Submission Date	04/05/2012	Sheet	6 of 7



BORING KEY

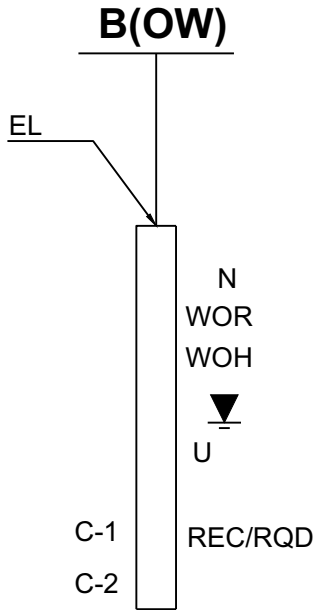

- B BORING IDENTIFICATION
- EL GROUND SURFACE ELEVATION AT TIME OF BORING
- N STANDARD PENETRATION RESISTANCE; NUMBER OF BLOWS OF A 140 LB. HAMMER FREE FALLING 30 IN. TO DRIVE A 2 IN O.D. SPLIT SPOON SAMPLER 12 IN. AFTER 6 INCHES OF INITIAL PENETRATION.
- REC (LENGTH OF ROCK RETRIEVED)/ (LENGTH OF ROCK CORED) * 100 %
- RQD ROCK QUALITY DESIGNATION (LENGTH OF ROCK PIECES 4 INCHES OR LONGER)/ (LENGTH OF ROCK CORED) * 100 %
- (OW) GROUNDWATER OBSERVATION WELL
- ▼ MEASURED GROUNDWATER LEVEL
- C1 ROCK CORE RUN IDENTIFICATION
- WOR 2 FT PENETRATION OF THE SPLIT SPOON SAMPLER UNDER THE OWN WEIGHT OF RODS
- WOH 2 FT PENETRATION OF THE SPLIT SPOON SAMPLER UNDER THE STATIC WEIGHT OF THE DRIVING HAMMER
- U UNDISTURBED SAMPLE

MATERIAL SYMBOLS



CONCRETE



FILL



TIMBER



BEDROCK

LANGAN

ENGINEERING & ENVIRONMENTAL SERVICES

21 Penn Plaza
360 West 31st Street, 8th Floor
New York, NY 10001-2727
P: 212.479.5400 F: 212.479.5444
www.langan.com

NEW JERSEY PENNSYLVANIA NEW YORK CONNECTICUT
FLORIDA VIRGINIA CALIFORNIA
ABU DHABI DUBAI ATHENS DOHA ISTANBUL

Project

**105 WEST 57TH
STREET**

MANHATTAN

NY

Drawing Title

**LANGAN
STANDARDS**

Project No.

170173001

Date

04/05/2012

Scale

NTS

Drawn By

SKM

Submission Date

04/05/2012

Drawing No.

7

Sheet 7 of 7

APPENDIX A

TEST BORING LOGS

Project		Project No.											
105 West 57th Street		170173001											
Location		Elevation and Datum											
New York, NY		Approx. EL. 61 BPMD											
MATERIAL SYMBOL	Elev. (ft)	Sample Description	Coring (min)	Depth Scale	Sample Data				Remarks (Drilling Fluid, Depth of Casing, Fluid Loss, Drilling Resistance, etc.)				
					Number	Type	Recov. (in)	Penetr. resist. BL/6in		N-Value (Blows/ft)			
									10	20	30	40	
	+40.0	gray mica SCHIST, slightly weathered BC: Class 1	5	20									Roller bit to 20 ft Hammer down 4-in O.D. casing (1 section @ 3 ft) Start core run C-1 at 1:20 pm
			5	21									
			4	22	C-1	NX CORE BARREL							
			5	23			REC=60"/60" =100%	RQD=42"/60" =70%					
			4	24									
	+36.0	gray mica SCHIST, weathered BC: Class 1	5	25									
			4	26									End core run C-1 at 1:44 pm Start core run C-2 at 1:52 pm
			6	27									
			4	28	C-2	NX CORE BARREL	REC=60"/60" =100%	RQD=42"/60" =70%					
			4	29									
	+30.0	gray mica SCHIST BC: Class 1	4	30									
			6	31									End core run C-2 at 2:14 pm Start core run C-3 at 2:26 pm
			6	32									
			5	33	C-3	NX CORE BARREL	REC=60"/60" =100%	RQD=58"/60" =97%					
			6	34									
			5	35									
	+25.0	End of boring at 36 ft	5	36									End core run C-3 at 3:05 pm End of boring at 36 ft
				37									
				38									
				39									
				40									
				41									
				42									
				43									
				44									
				45									

I:\LANGAN.COM\DATA\170173001\ENGINEERING DATA\GEO\TECHNICAL\GINTLOGS\170173001 BORING LOGS.GPJ ... 4/4/2012 12:47:41 PM ... Report: Log - LANGAN ... Template TEMPLATE.GDT

I:\LANGAN.COM\DATA\170173001\ENGINEERING DATA\GEO\TECHNICAL\GINTLOGS\170173001 BORING LOGS.GPJ ... 4/4/2012 12:47:44 PM ... Report: Log - LANGAN ... Template TEMPLATE.GDT

Project 105 West 57th Street				Project No. 170173001				
Location New York, NY				Elevation and Datum Approx. EL. 61 BPMD				
Drilling Company Craig Test Boring, Inc.				Date Started 5/5/06		Date Finished 5/5/06		
Drilling Equipment CME-55 Track Rig				Completion Depth 33 ft		Rock Depth 23 ft		
Size and Type of Bit 3 7/8" tricone roller bit				Number of Samples		Disturbed 0	Undisturbed 0	Core 2
Casing Diameter (in) 4-in O.D. Steel Pipe		Casing Depth (ft) 23'		Water Level (ft.)		First ▽	Completion ▽	24 HR. ▽
Casing Hammer Auto	Weight (lbs) 140 lb	Drop (in) 30 "		Drilling Foreman Rob Dollar				
Sampler N/A				Inspecting Engineer Claudia Castro				
Sampler Hammer N/A	Weight (lbs) N/A	Drop (in) N/A						

MATERIAL SYMBOL	Elev. (ft) +61.0	Sample Description	Coring (min)	Depth Scale	Sample Data						Remarks (Drilling Fluid, Depth of Casing, Fluid Loss, Drilling Resistance, etc.)	
					Number	Type	Recov. (in)	Penetr. resist	BL/ft	N-Value (Blows/ft) 10 20 30 40		
		NO SAMPLES TAKEN BC: Class 7		0								Start drilling at 8:35 am Roller bit to 5 ft Smooth drilling
		c-m SAND, gravel and concrete fragments, red brick fragments [FILL] (Class 7)		1								
				2								
				3								
				4								
				5								Hammer down 4-in O.D. casing (1 section @ 5 ft)
				6								
				7								
				8								
				9								Roller bit to 10 ft
				10								
				11								Hammer down 4-in O.D. casing (1 section @ 5 ft)
				12								
				13								
				14								Roller bit to 15 ft
				15								
				16								Hammer down 4-in O.D. casing (1 section @ 5 ft)
				17								
				18								
				19								
				20								Roller bit to 20 ft

Project		Project No.											
105 West 57th Street		170173001											
Location		Elevation and Datum											
New York, NY		Approx. EL. 61 BPMD											
MATERIAL SYMBOL	Elev. (ft)	Sample Description	Coring (min)	Depth Scale	Sample Data				Remarks (Drilling Fluid, Depth of Casing, Fluid Loss, Drilling Resistance, etc.)				
					Number	Type	Recov. (in)	Penetr. resist. BL/6in		N-Value (Blows/ft)			
									10	20	30	40	
				20									Hammer down 4-in O.D. casing (1 section @ 5 ft)
	+39.5	Concrete Slab		21									
	+38.0	gray mica SCHIST BC: Class 1		22									
			6	23									Hammer down 4-in O.D. casing (1 section @ 3 ft)
			4	24	C-1	NX CORE BARREL	REC=60"/60" =100%	RQD=47"/60" =78%					Start core run C-1 at 10:38 am
			4	25									
			5	26									
			5	27									
			5	28									End core run C-1 at 10:56 am
			3	29									Start core run C-2 at 11:05 am
			4	30	C-2	NX CORE BARREL	REC=60"/60" =100%	RQD=54"/60" =90%					
			4	31									
			4	32									
	+28.0	End of boring at 33 ft	4	33									End core run C-2 at 11:25 am
				34									End of boring at 33 ft
				35									
				36									
				37									
				38									
				39									
				40									
				41									
				42									
				43									
				44									
				45									

I:\LANGAN.COM\DATA\170173001\ENGINEERING DATA\GEO\TECHNICAL\GINTLOGS\170173001 BORING LOGS.GPJ ... 4/4/2012 12:47:45 PM ... Report: Log - LANGAN ... Template TEMPLATE.GDT

Project		Project No.											
105 West 57th Street		170173001											
Location		Elevation and Datum											
New York, NY		Approx. EL. 61.5 BPMD											
MATERIAL SYMBOL	Elev. (ft)	Sample Description	Coring (min)	Depth Scale	Sample Data				Remarks (Drilling Fluid, Depth of Casing, Fluid Loss, Drilling Resistance, etc.)				
					Number	Type	Recov. (in)	Penetr. resist. BL/6in		N-Value (Blows/ft)			
									10	20	30	40	
	+40.0	Concrete Slab		20									Roller bit to 20 ft Hammer down 4-in O.D. casing (1 section @ 5 ft) Refusal at 21.5 ft Concrete slab at 21.5 ft
	+37.5	gray mica SCHIST BC: Class 1		21									Roller bit to 25 ft
			7	22									Rig chatters Drive in core drill Start core run C-1 at 2:48 pm
			4	23									
			5	24	C-1								
			4	25									
			6	26									
			4	27									
			6	28									
			6	29									End core run C-1 at 3:30 pm 5/5/06
			5	30									Start core run C-2 at 7:15 am
			5	31	C-2								
			5	32									
			5	33									
	+27.5	End of boring at 34 ft	5	34									End core run C-2 at 7:55 am End of boring at 34 ft
				35									
				36									
				37									
				38									
				39									
				40									
				41									
				42									
				43									
				44									
				45									

I:\LANGAN.COM\DATA\170173001\ENGINEERING DATA\GEO\TECHNICAL\GINTLOGS\170173001 BORING LOGS.GPJ ... 4/4/2012 12:47:48 PM ... Report: Log - LANGAN ... Template TEMPLATE.GDT

I:\LANGAN.COM\DATA\ANY\DATA\0170173001\ENGINEERING DATA\GEO\TECHNICAL\GINTLOGS\170173001 BORING LOGS.GPJ ... 4/4/2012 12:47:50 PM ... Report: Log - LANGAN ... Template TEMPLATE.GDT

Project 105 West 57th Street				Project No. 170173001				
Location New York, NY				Elevation and Datum Approx. EL. 61 BPMD				
Drilling Company Warren George Inc.				Date Started 3/23/12		Date Finished 3/23/12		
Drilling Equipment Mobile B53 Truck Rig				Completion Depth 24.2 ft		Rock Depth 19.2 ft		
Size and Type of Bit 3 7/8" tricone roller bit				Number of Samples		Disturbed 0	Undisturbed 0	Core 1
Casing Diameter (in) 4-in O.D. Steel Pipe		Casing Depth (ft) 20'		Water Level (ft.)		First ▽	Completion ▽ 8	24 HR. ▽ -
Casing Hammer N/A	Weight (lbs) N/A	Drop (in) N/A	Drilling Foreman Edwin Feliciano					
Sampler N/A			Inspecting Engineer Seth Martin					
Sampler Hammer N/A	Weight (lbs) N/A	Drop (in) N/A						

MATERIAL SYMBOL	Elev. (ft) +61.0	Sample Description	Coring (min)	Depth Scale	Sample Data							Remarks <small>(Drilling Fluid, Depth of Casing, Fluid Loss, Drilling Resistance, etc.)</small>		
					Number	Type	Recov. (in)	Penetr. resist	BL/ft	N-Value (Blows/ft)				
										10	20	30	40	
		NO SAMPLES TAKEN BC: Class 7		0										Spin casing to 15 ft (3 sections at 5 ft)
				1										Smooth advance, no major obstructions
				2										Clean out casing with roller bit to 15 ft
				3										Intermittent, slight to moderate rig chatter to 15 ft
				4										
				5										
				6										
				7										
				8										
				9										
				10										
				11										
				12										
				13										
				14										
				15										Little to no wash return from 15 to 19 ft
				16										Roller bit to 19 ft
				17										Apparent top of slab or rock at approximately 19 ft
				18										
				19										Spin casing to 19.2 ft
				20										Clean out casing to 19.2 ft

Project		Project No.									
105 West 57th Street		170173001									
Location		Elevation and Datum									
New York, NY		Approx. EL. 61 BPMD									
MATERIAL SYMBOL	Elev. (ft)	Sample Description	Coring (min)	Depth Scale	Sample Data				Remarks (Drilling Fluid, Depth of Casing, Fluid Loss, Drilling Resistance, etc.)		
					Number	Type	Recov. (in)	Penetr. resist. BL/6in		N-Value (Blows/ft)	
									10 20 30 40		
	+36.8	weathered, slight to moderately fractured, medium hard BC: Class 1	20	20	C-1	NX CORE BARREL	REC=41"/60" =68%	RQD=29"/60" =48%			Slight to moderate rig chatter No wash return Start core run C-1 at 1:40 pm Barrel jammed at approximately 20.2 ft Clean out casing with roller bit to 20.2 ft Re-insert core barrel and continue core C-1 to 24.2 ft End core run C-1 at 2:20 pm End of boring at 24.2 ft
			10	21							
			6.5	22							
			4	23							
			5	24							
		End of boring at 24.2 ft		24							
				25							
				26							
				27							
				28							
				29							
				30							
				31							
				32							
				33							
				34							
				35							
				36							
				37							
				38							
				39							
				40							
				41							
				42							
				43							
				44							
				45							

I:\LANGAN.COM\DATA\170173001\ENGINEERING DATA\GEOTECHNICAL\GINTLOGS\170173001 BORING LOGS.GPJ ... 4/4/2012 12:47:50 PM ... Report: Log - LANGAN ... Template TEMPLATE.GDT


Project		Project No.											
105 West 57th Street		170173001											
Location		Elevation and Datum											
New York, NY		Approx. EL. 60.9 BPMD											
MATERIAL SYMBOL	Elev. (ft)	Sample Description	Coring (min)	Depth Scale	Sample Data				Remarks (Drilling Fluid, Depth of Casing, Fluid Loss, Drilling Resistance, etc.)				
					Number	Type	Recov. (in)	Penetr. resist. BL/6in		N-Value (Blows/ft)			
	+40.7	~6" Void Below Slab	1.5	20					10	20	30	40	<p>Clean out casing with roller bit to 19 ft</p> <p>Apparent top of concrete slab at 19 ft, concrete fragments in wash</p> <p>Begin core C-1 at 10:50 am</p> <p>Loss of water at about 20 ft</p> <p>Core barrel dropped approximately 6 to 12 inches at about 20 ft, potential void below concrete slab</p> <p>Intermittent loss of water from 19 to 22 ft</p> <p>No wash return from 22 ft to end of boring at 25.4 ft</p> <p>REC=0"/18" =0%</p> <p>RQD=0"/18" =0%</p> <p>Finished core C-1 at 11:18 am</p> <p>No recovery. Cored additional 1.5 feet to recover core left in hole.</p> <p>End of Boring at 25.4 ft</p>
	+40.1	~1.5 ft gray white pink black quartz mica PEGMATITE, fresh, slightly fractured, medium hard to hard BC: Class 1	5	21	C-1		REC=45"/60" =75%	RQD=26"/60" =43%					
			5.5	22									
		~1 ft gray to black quartz mica SCHIST, fresh to slightly weathered, slightly fractured, medium hard	9	23									
			7	24	C-2		0%	0%					
	+35.5		5	25									
				26									
				27									
				28									
				29									
				30									
				31									
				32									
				33									
				34									
				35									
				36									
				37									
				38									
				39									
				40									
				41									
				42									
				43									
				44									
				45									

I:\LANGAN.COM\DATA\170173001\ENGINEERING DATA\GEOTECHNICAL\GINTLOGS\170173001 BORING LOGS.GPJ ... 4/4/2012 12:47:53 PM ... Report: Log - LANGAN ... Template TEMPLATE.GDT

Project		Project No.									
105 West 57th Street		170173001									
Location		Elevation and Datum									
New York, NY		Approx. EL. 60.9 BPMD									
MATERIAL SYMBOL	Elev. (ft)	Sample Description	Coring (min)	Depth Scale	Sample Data				Remarks (Drilling Fluid, Depth of Casing, Fluid Loss, Drilling Resistance, etc.)		
					Number	Type	Recov. (in)	Penetr. resist. BL/6in		N-Value (Blows/ft)	
									10 20 30 40		
	+40.4	black to gray, quartz mica SCHIST, slightly to moderately weathered, moderately fractured, some oxidation at fractures, medium hard BC: Class 1	8	20							Spin casing to approximately 20 ft
			6	21							Clean out casing with roller bit to 20 ft
			6.5	22	C-1	NX CORE BARREL	REC=51"/60" =85%	RQD=39"/60" =65%			Brick and gravel in wash
			9	23							Apparent top of rock at 20.5 ft, rock/mica fragments in wash at 20.5 ft
			7.5	24							Potential decomposed/weather rock zone at about 20 to 20.5 ft
				25							Slight rig chatter at 20.5 ft
	+35.4	End of boring at 25.5 ft		26							Begin core C-1 at 4 pm from 20.5 ft
				27							Good wash return, wash is brownish transitioning to gray/clear
				28							Slow advance at about 25 ft.
				29							Boring terminated at 5:00 pm at 25 ft.
				30							Driller off-site at 5:15 pm
				31							
				32							
				33							
				34							
				35							
				36							
				37							
				38							
				39							
				40							
				41							
				42							
				43							
				44							
				45							

I:\LANGAN.COM\DATA\170173001\ENGINEERING DATA\GEO\TECHNICAL\GINTLOGS\170173001 BORING LOGS.GPJ ... 4/4/2012 12:47:56 PM ... Report: Log - LANGAN ... Template TEMPLATE.GDT

APPENDIX D

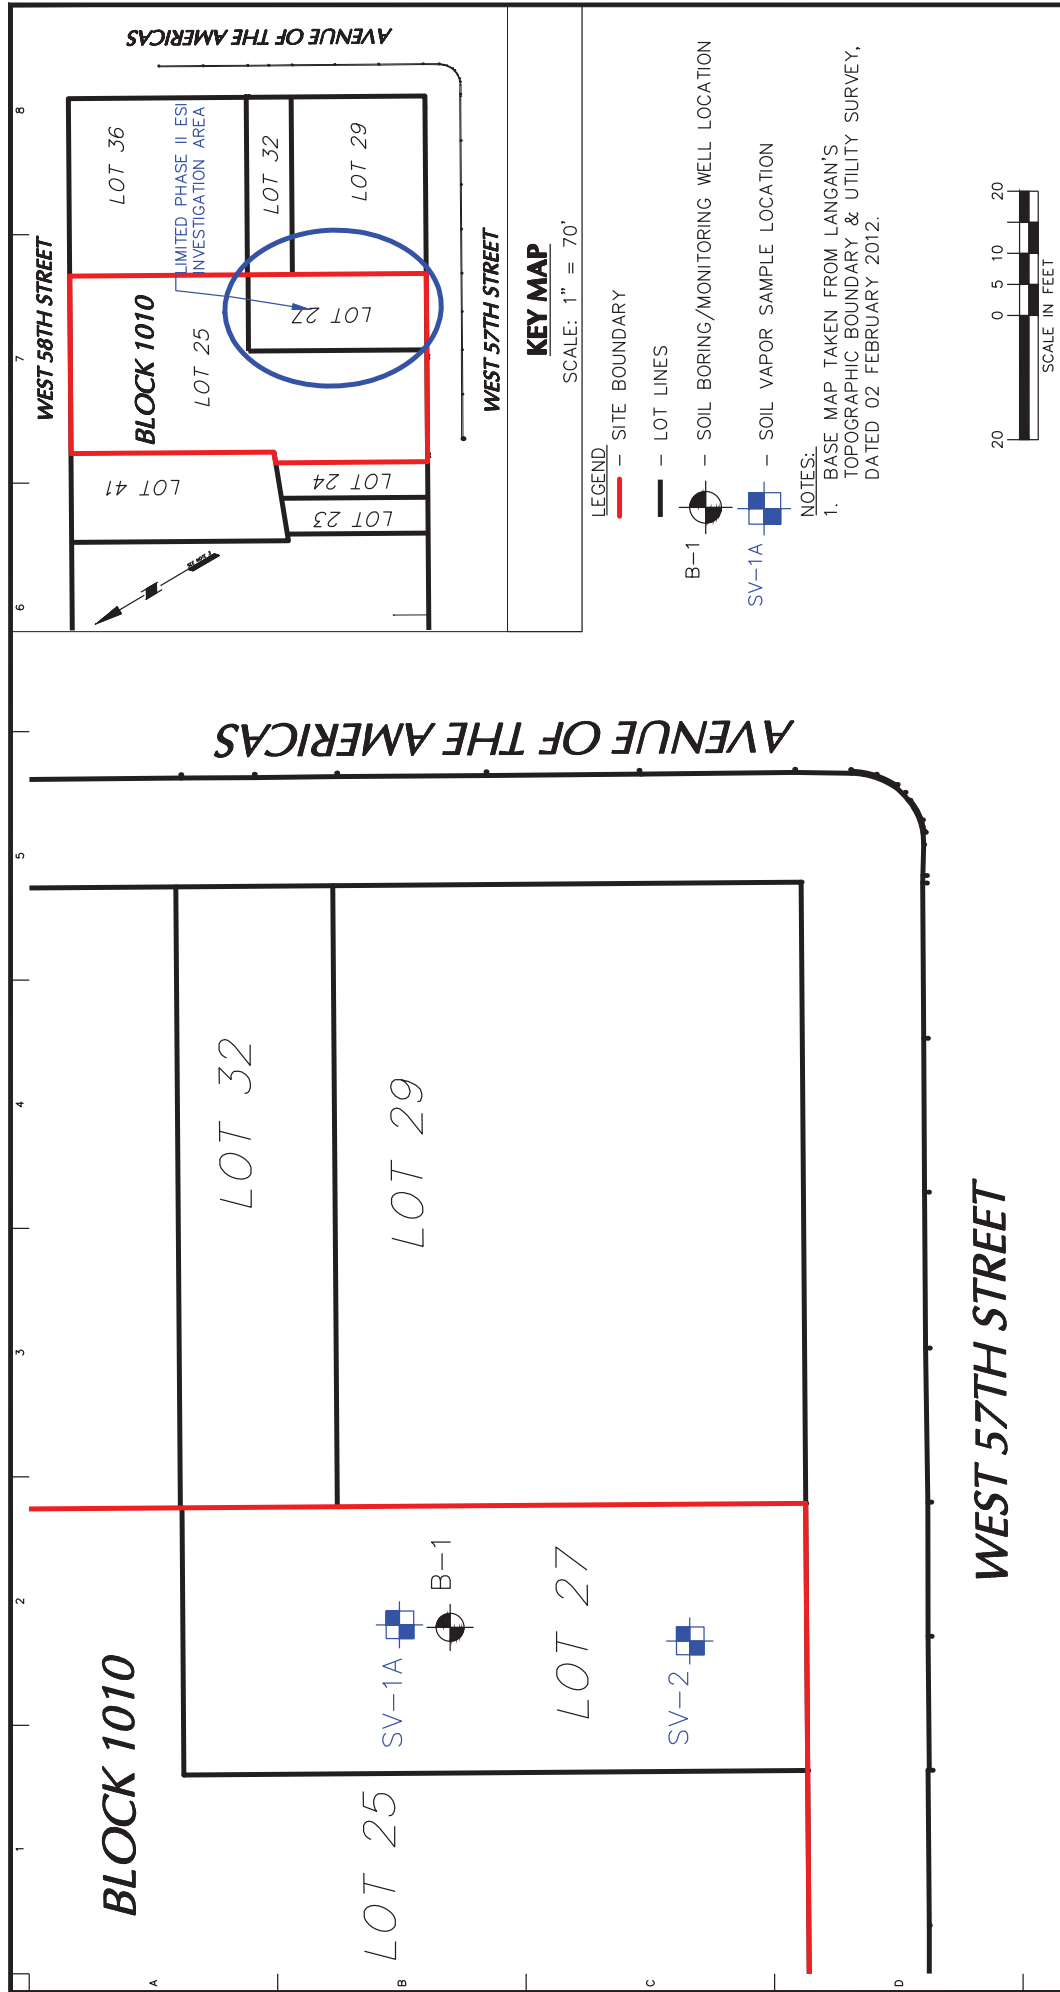

LANGAN 21 Penn Plaza, 360 West 31st Street, 8th Floor New York, NY 10001 T: 212.479.5400 F: 212.479.5444 www.langan.com Langan Engineering, Environmental, Surveying and Landscape Architecture, D.P.C. Langan Engineering and Environmental Services, Inc. Langan International LLC Collectively known as Langan	Project 105-109 WEST 57th St. BLOCK 1010, LOT 27 MANHATTAN NEW YORK	Figure Title SAMPLE LOCATION MAP	Figure No. 2
	Project No. 170173001	Date 15 AUGUST 2013	Scale 1" = 20'
		Submission Date 15 AUGUST 2013	

PROJECT 107 W 57TH STREET			PROJECT NO. 170173001		
LOCATION NEW YORK, NEW YORK			ELEVATION AND DATUM		
DRILLING AGENCY ADT, INC			DATE STARTED 2013.07.22		DATE FINISHED 2013.07.22
DRILLING EQUIPMENT SONIC 17C (AMS COMPACT ROTO SONIC)			COMPLETION DEPTH 29'		ROCK DEPTH 23'
SIZE AND TYPE OF BIT 6" SONIC BIT			NO. SAMPLES	DIST.	UNDIST.
CASING			WATER LEVEL	FIRST	COMPL.
CASING HAMMER		WEIGHT	DROP	FOREMAN T. SHEERIN	
SAMPLER 3.5" SONIC SAMPLING BIT			INSPECTOR D. CARRUS		
SAMPLER HAMMER		WEIGHT	DROP		

SYMBOL	SAMPLE DESCRIPTION	DEPTH SCALE	SAMPLES				REMARKS (DRILLING FLUID, DEPTH OF CASING, CASING BLOWS, FLUID LOSS, ETC.)
			NO. LOC.	TYPE	RECOV. FT.	PENETR. RESIST. BLANK	
	brown m-f SAND some concrete tr. brick tr. gravel	1	S-1	PLASTIC SAMPLE BAG	3.5'	0.0	
		2				0.0	
		3				0.0	
		4				0.0	
		5				0.0	
	Brown m-f SAND and COARSE GRAVEL	6	S-2	PLASTIC SAMPLE BAG	3.5'	0.0	
		7				0.0	
		8				0.0	
	brown m-f SAND some concrete tr. brick tr. trash, debris	9	S-3	PLASTIC SAMPLE BAG	4'	0.0	
		10				0.0	
		11				0.0	
	brown SAND some gravel tr. brick tr. wood	12				0.0	
		13				0.0	
		14				0.0	

JOB NO. 170173001

LOG OF BORING NO. B-1

DATE 2013.07.22

SHEET 2 OF 2

Symbol	SAMPLE DESCRIPTION	DEPTH SCALE	SAMPLES				REMARKS (DRILLING FLUID, DEPTH OF CASING, CASING BLOWS, FLUID LOSS, ETC.)
			NO. LOC.	TYPE	RECOV. FT.	PENETR. RESIST. BLG IN.	
		14					
	WOOD, brick, little sand	15				0.0	14:10: VOID ENCOUNTERED @ 15'
		16					
		17					
		18	S-4	PLASTIC SAMPLE BAG	0.5		
		19					
		20				0.0	
	CONCRETE SLAB	20					
	BROWN C-f SAND AND DECOMPOSED BEDROCK WET	21				0.0	
	BROKEN & PULVERIZED BEDROCK	22				0.0	
		23	S-5	PLASTIC SAMPLE BAG	4'	0.0	
		24				0.0	
		25				0.0	
	NO SAMPLES TAKEN	25					
		26					
		27					
		28					
		29					
	EOB @ 29 ft bg	29					

PROJECT 107 W57TH STREET		PROJECT NO. 170173001	
LOCATION NEW YORK, NEW YORK		ELEVATION AND DATUM	
DRILLING AGENCY ADT		DATE STARTED 2013.07.22	DATE FINISHED 2013.07.22
DRILLING EQUIPMENT AMS COMPACT ROTO SONIC 17C		COMPLETION DEPTH 20'	ROCK DEPTH
SIZE AND TYPE OF BIT 6" SONIC BIT		NO. SAMPLES	DIST. UNDIST. CORE
CASING		WATER LEVEL	FIRST COMPL. 24 HR.
CASING HAMMER	WEIGHT	DROP	
SAMPLER 3.5" SONIC SAMPLING BIT		FOREMAN T. SHEERIN	
SAMPLER HAMMER		INSPECTOR D. CARRUS	

SYMBOL	SAMPLE DESCRIPTION	DEPTH SCALE	SAMPLES				REMARKS (DRILLING FLUID, DEPTH OF CASING, CASING BLOWS, FLUID LOSS, ETC.)
			NO. LOC.	TYPE	RECOV. FT.	PENETR. RESIST. BLG/N	
	brown m-f SAND and BRICK tr. gravel tr. COAL (fill)	1	S-1	PLASTIC SAMPLE BAG	4'	0.0	<p>BACK OF SITE</p> <p>W57TH STREET.</p>
	brown m-f SAND some gravel (fill)	2				0.0	
	brown m-f SAND AND CONCRETE some gravel tr. brick (fill)	3				0.0	
	brown m-f SAND some gravel some brick (fill)	4				0.0	
	brown m-f SAND some gravel some brick (fill)	5	S-2	PLASTIC SAMPLE BAG	4'	0.0	
		6				0.0	
		7				0.0	
	brown m-f SAND some gravel some coal tr. brick	8	S-3	PLASTIC SAMPLE BAG	3'	0.0	
		9				0.0	
	brown SAND and CONCRETE some gravel tr. brick tr. wood tr. concrete	10				0.0	
		11	0.0				
		12	0.0				
		13	0.0				
		14	0.0				

JOB NO. 170173001
 DATE 2013.07.22

LOG OF BORING NO. SV-1

SHEET 2 OF 2

Symbol	SAMPLE DESCRIPTION	DEPTH SCALE	SAMPLES				REMARKS (DRILLING FLUID, DEPTH OF CASING, CASING BLOWS, FLUID LOSS, ETC.)
			NO. LOC.	TYPE	RECOV. FT.	PENETR. RESIST. BL/6 IN.	
		14					P10
□	Brown m-f SAND some gravel some brick	15				0.0	
△		16				0.0	
○		17				0.0	
▽		18	5-4	PLASTIC SAMPLE BAG	4'	0.0	
◇		19				0.0	
○	brown m-f SAND and CONCRETE tr. wood	18				0.0	
△	grey CONCRETE AND m-f SAND	19				0.0	
▨	SLAB? EOB @ 20'	20					10:45 - HY CONCRETE

PROJECT 107 W. 57TH STREET		PROJECT NO 170173001	
LOCATION NEW YORK, NEW YORK		ELEVATION AND DATUM	
DRILLING AGENCY ADT, INC		DATE STARTED 2013.07.22	DATE FINISHED 2013.07.22
DRILLING EQUIPMENT AMS COMPACT ROTO SONIC 17C		COMPLETION DEPTH 15'	ROCK DEPTH
SIZE AND TYPE OF BIT 6" SONIC BIT		NO. SAMPLES	DIST.
CASING		WATER LEVEL	FIRST
CASING HAMMER	WEIGHT	DROP	FOREMAN T. SHEERIN
SAMPLER 3.5" SONIC SAMPLING BIT		INSPECTOR D. CARRUS	
SAMPLER HAMMER	WEIGHT	DROP	

SYMBOL	SAMPLE DESCRIPTION	DEPTH SCALE	SAMPLES				REMARKS (DRILLING FLUID, DEPTH OF CASING, CASING BLOWS, FLUID LOSS, ETC.)
			NO. LOG.	TYPE	RECOV. FT.	PENETR. RESIST. BLOW/FT.	
Δ	brown m-f SAND and GRAVEL some concrete tr. brick	1			0.0		<p>PROPERTY LINE</p> <p>35'</p> <p>18' 10"</p> <p>PROPERTY LINE</p> <p>W 57TH ST SIDEWALK</p> <p>PID</p>
Δ		2	S-1	PLASTIC SAMPLE BAG	2-5'	0.0	
Δ		3				0.0	
Δ		4				0.0	
Δ		5				0.0	
Δ	brown m-f SAND some gravel tr. concrete (moist)	6				0.0	
Δ		7				0.0	
Δ	grey m-f SAND and GRAVEL some concrete (dry)	8	S-2	PLASTIC SAMPLE BAG	2-5'	0.0	
Δ		9				0.0	
Δ		10				0.0	
Δ	brown SAND AND GRAVEL tr. brick tr. coal	11				0.0	
Δ		12	S-3	PLASTIC SAMPLE BAG	4'	0.0	
Δ		13				0.0	
Δ	brown SAND some gravel tr. brick	14				0.0	

JOB NO. 170173001
DATE 2013.07.22

LOG OF BORING NO. SV-1A

SHEET 2 OF 2

	SAMPLE DESCRIPTION	DEPTH SCALE	SAMPLES				REMARKS (DRILLING FLUID, DEPTH OF CASING, CASING BLOWS, FLUID LOSS, ETC.)
			NO. LOC.	TYPE	RECOV. FT.	PENETR. RESIST. BLOWN.	
		14					P10
		15					
	EoB @ 15'						

PROJECT 107 W57TH STREET			PROJECT NO. 170173001		
LOCATION NEW YORK, NY			ELEVATION AND DATUM		
DRILLING AGENCY ADT, INC			DATE STARTED 2013-07-22	DATE FINISHED 2013-07-22	
DRILLING EQUIPMENT SONIC 17C (AMS COMPACT ROTO SONK)			COMPLETION DEPTH 15'	ROCK DEPTH	
SIZE AND TYPE OF BIT 6" SONIC BIT			NO. SAMPLES	DIST.	UNDIST. CORE
CASING			WATER LEVEL	FIRST	COMPL. 24 HR.
CASING HAMMER	WEIGHT	DROP	FOREMAN T. SHEERIN		
SAMPLER 3.5" SONIC SAMPLING BIT			INSPECTOR D. CARRUS		
SAMPLER HAMMER	WEIGHT	DROP			

SYMBOL	SAMPLE DESCRIPTION	DEPTH SCALE	SAMPLES				REMARKS (DRILLING FLUID, DEPTH OF CASING, CASING BLOWS, FLUID LOSS, ETC.)
			NO. LOC.	TYPE	RECOV. FT.	PENETR. RESIST. BLG/IN.	
	brown m-f SAND some brick some gravel tr. wood tr. concrete	1	S-1	PLASTIC SAMPLE BAG	1'	0.0	PID
	brown m-f SAND some gravel tr. concrete	2				0.0	
		3	0.0				
		4	0.0				
	brown m-f SAND some concrete tr. brick tr. coal tr. wood	5	S-2	PLASTIC SAMPLE BAG	4'	0.0	
		6				0.0	
		7				0.0	
		8	0.0				
		9	0.0				
	brown m-f SAND tr. brick tr. concrete	10	S-3	PLASTIC SAMPLE BAG	4'	0.0	
		11				0.0	
		12				0.0	
	brown m-f SAND AND BRICK	13				0.0	
		14	0.0				

JOB NO. 170173001
 DATE 2013.07.22

LOG OF BORING NO. SV-2

SHEET 2 OF 2

Symbol	SAMPLE DESCRIPTION	DEPTH SCALE	SAMPLES				PID	REMARKS (DRILLING FLUID, DEPTH OF CASING, CASING BLOWS, FLUID LOSS, ETC.)
			NO. LOG.	TYPE	RECOV. FT.	PENETR. RESIST. BLU/IN.		
		14						
	EOB @ 15'	15						